

Project: AD600E
Committed: -
Customer: -
Drawer: 01
Date: 06/02/2013

Exercise tension:	400Vac + 3Ph + N + PE
Auxiliary tension	230Vac
Frequency	50Hz
Nominal current	10,4A
Total power	6,4 KW
Protection level	IP54




TECNOFRIGO TUSCANY srl
*Via J.F.Kennedy, 25/27/29 - 56020 Z.Ind.Fontanelle
Capanne - Montopoli Val D'Arno (Pisa)
Tel. +39 0571 467351 Fax +39 0571 469217
e-mail: info@tftdryair.com - www.tftdryair.com*

☐ OPTION 1 - KIT HUMIDISTAT WITH PROBE DUCT 0-100%

☐ OPTION 2 - KIT HUMIDISTAT WITH PROBE WALL 20-90%

1	Added terminal for fan selection always on or controlled by a humidistat.	21/02/2018			
Rev.	Changes	Date	Prepared	Verified	Approved

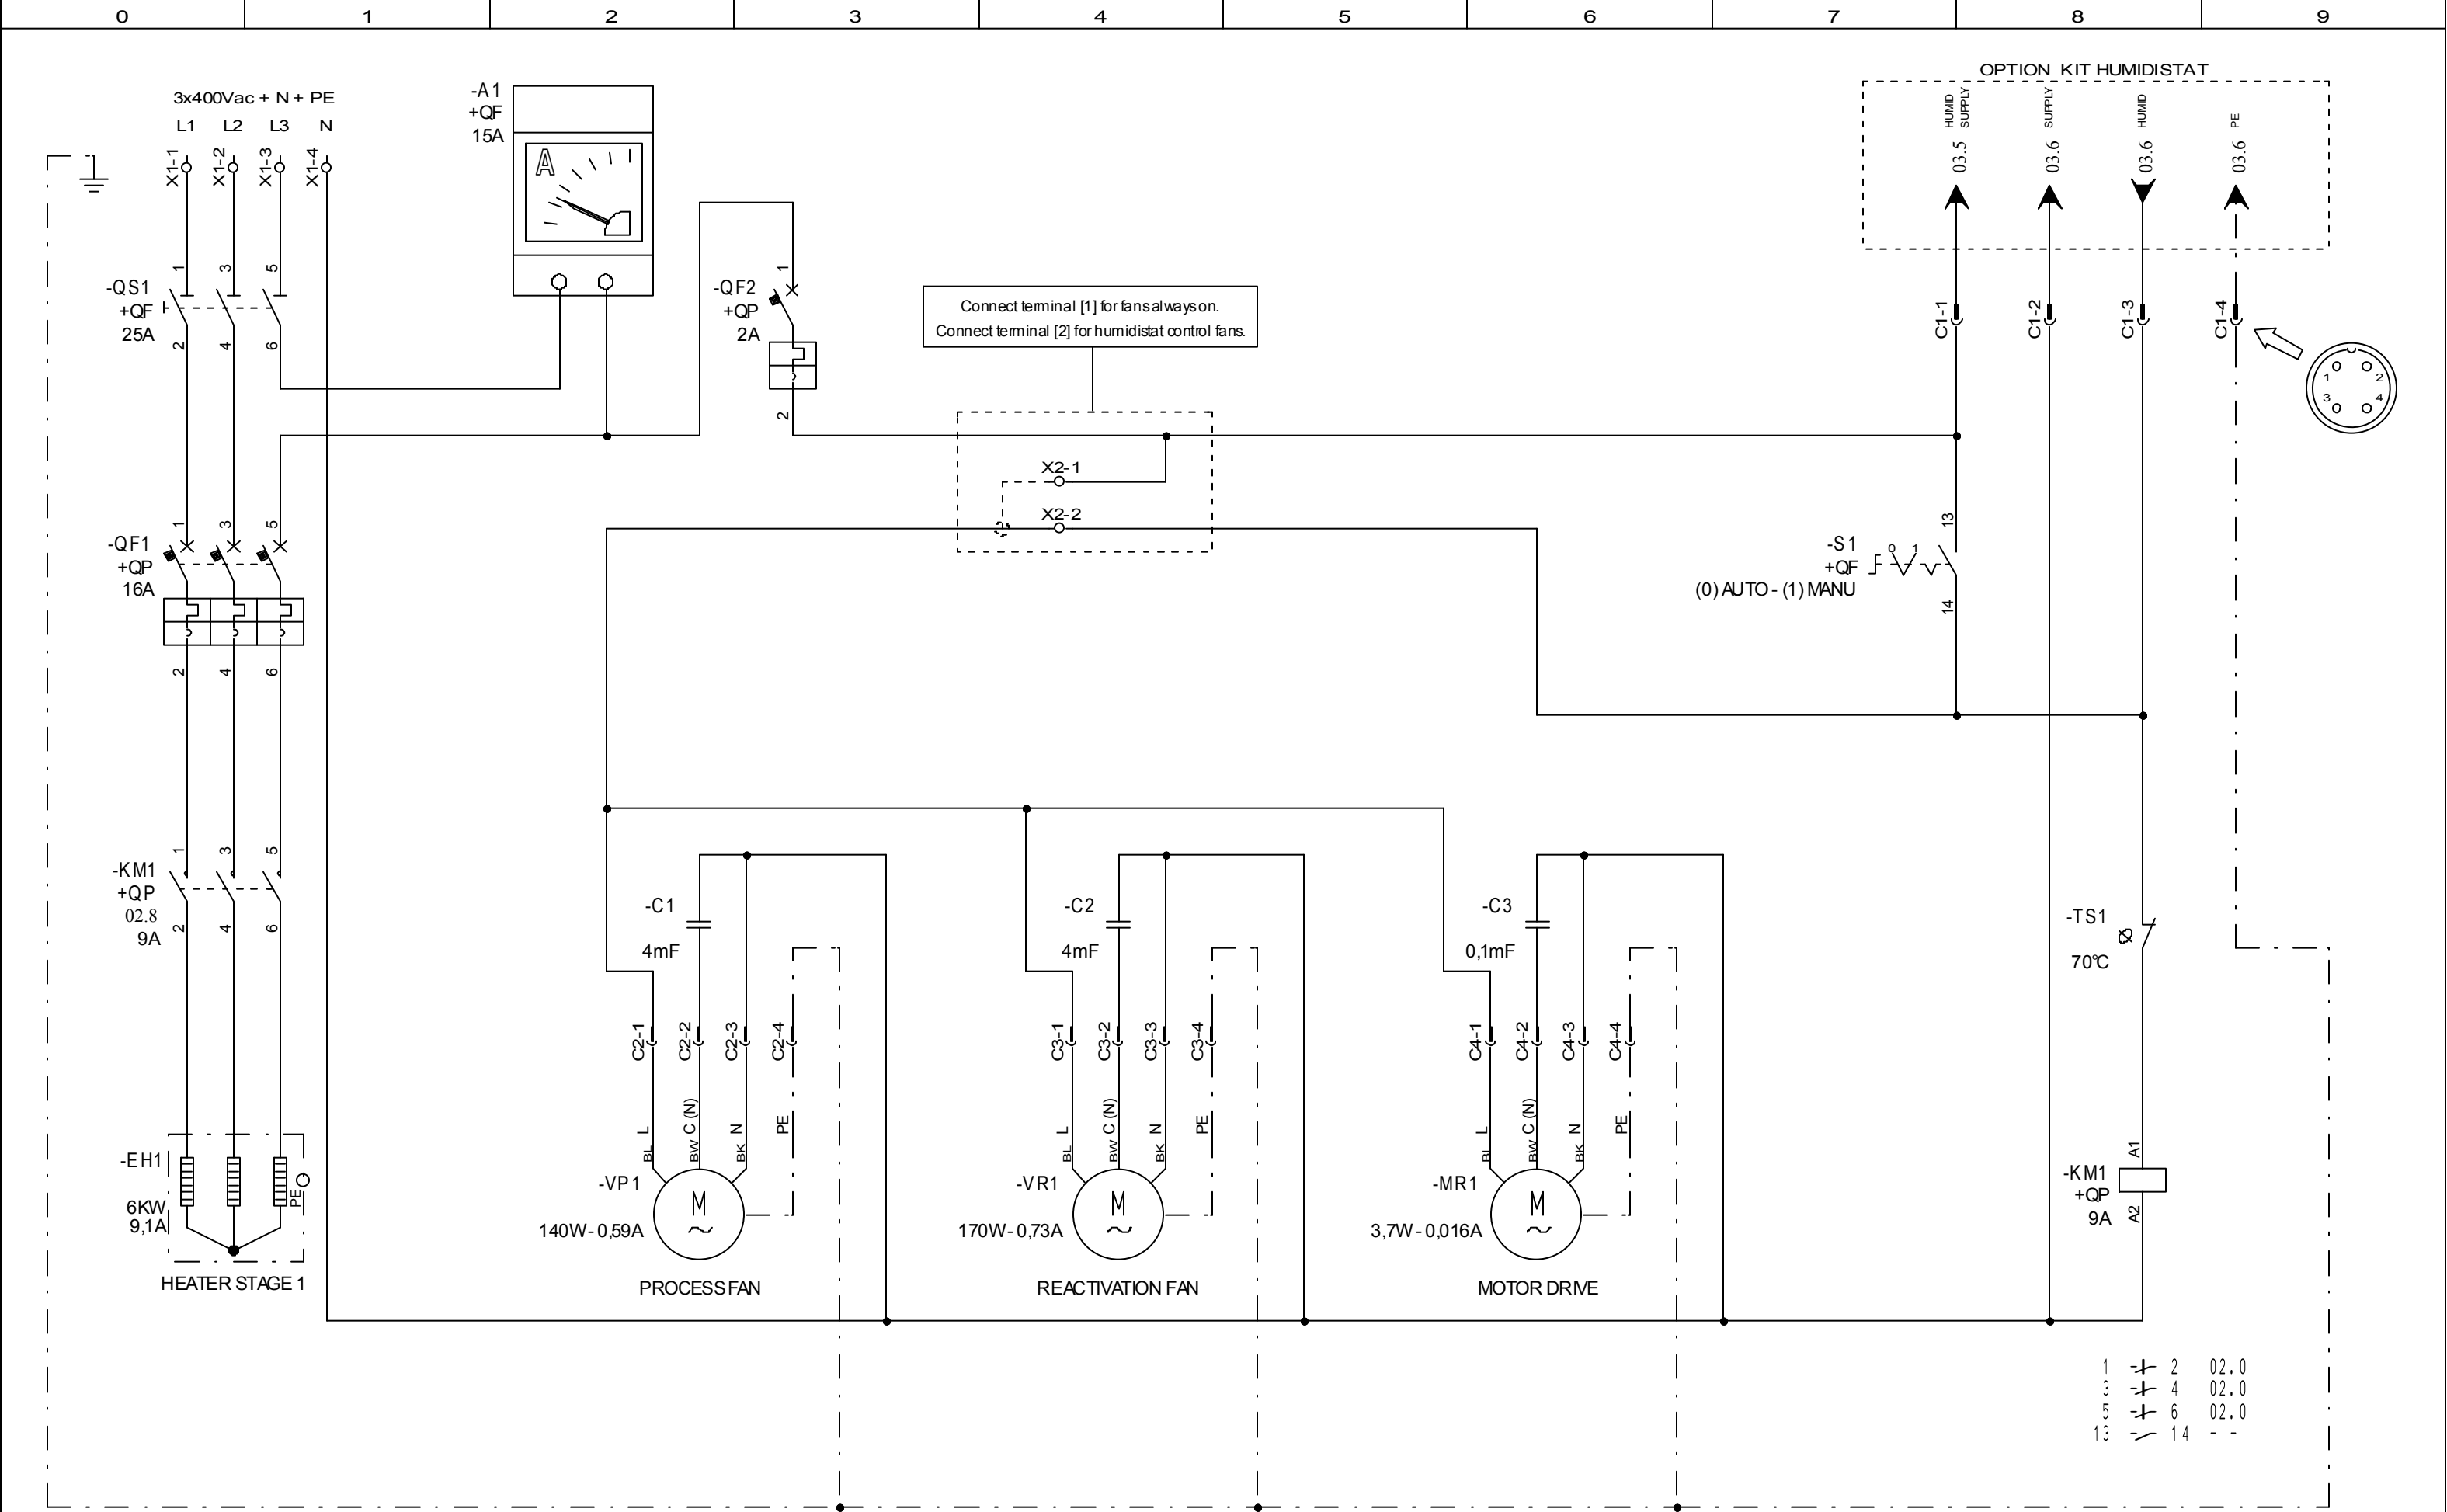

REV.	DATE	SIGNAT.	CHANGE

