

Project: ADP3500E (Electrical Regen.)
Committed: -
Customer: -
Drawer: 01
Date: 12/11/2018


Exercise tension:	3x400Vac + PE
Auxiliary tension	24Vdc
Frequency	50Hz
Nominal current	72,3 A
Total power	48,3 KW
Protection level	IP54




TECNOFRIGO TUSCANY srl
*Via J.F.Kennedy, 25/27/29 - 56020 Z.Ind.Fontanelle
Capanne - Montopoli Val D'Arno (Pisa)*
Tel. +39 0571 467351 Fax +39 0571 469217
e-mail: info@tftdryair.com - www.tftdryair.com

Rev.	Changes	Date	Prepared	Verified	Approved

OPTION TABLE			
	OPTION	DESCRIPTION	PAGES
STD	N.1	PROCESS FAN SPEED VARIATOR	04
STD	N.2	RIGENERATION FAN SPEED VARIATOR	05
STD	N.3	MODULATING CONTROL RIGENERATION HEATERS (PWM)	07
	N.4	ALARM FILTER PROCESS AIR	12
	N.5	ALARM FILTER RIGENERATION AIR	12
	N.6	PRE-TREATMENT TEMPERATURE PROBE	13
	N.7	POST-TREATMENT TEMPERATURE PROBE (PASSIVE)	13
	N.8	RELATIVE HUMIDITY / TEMPERATURE POST-TREATMENT/AMBIENT (ACTIVE)	13
	N.9	SIGNAL PROPORTIONAL OR AIR SPEED PROBE FOR PROCESS FAN CONTROL	13
	N.10	3 WAY VALVE FOR PRE-COOLING WATER	14
	N.11	3 WAY VALVE FOR POST-COOLING WATER	14

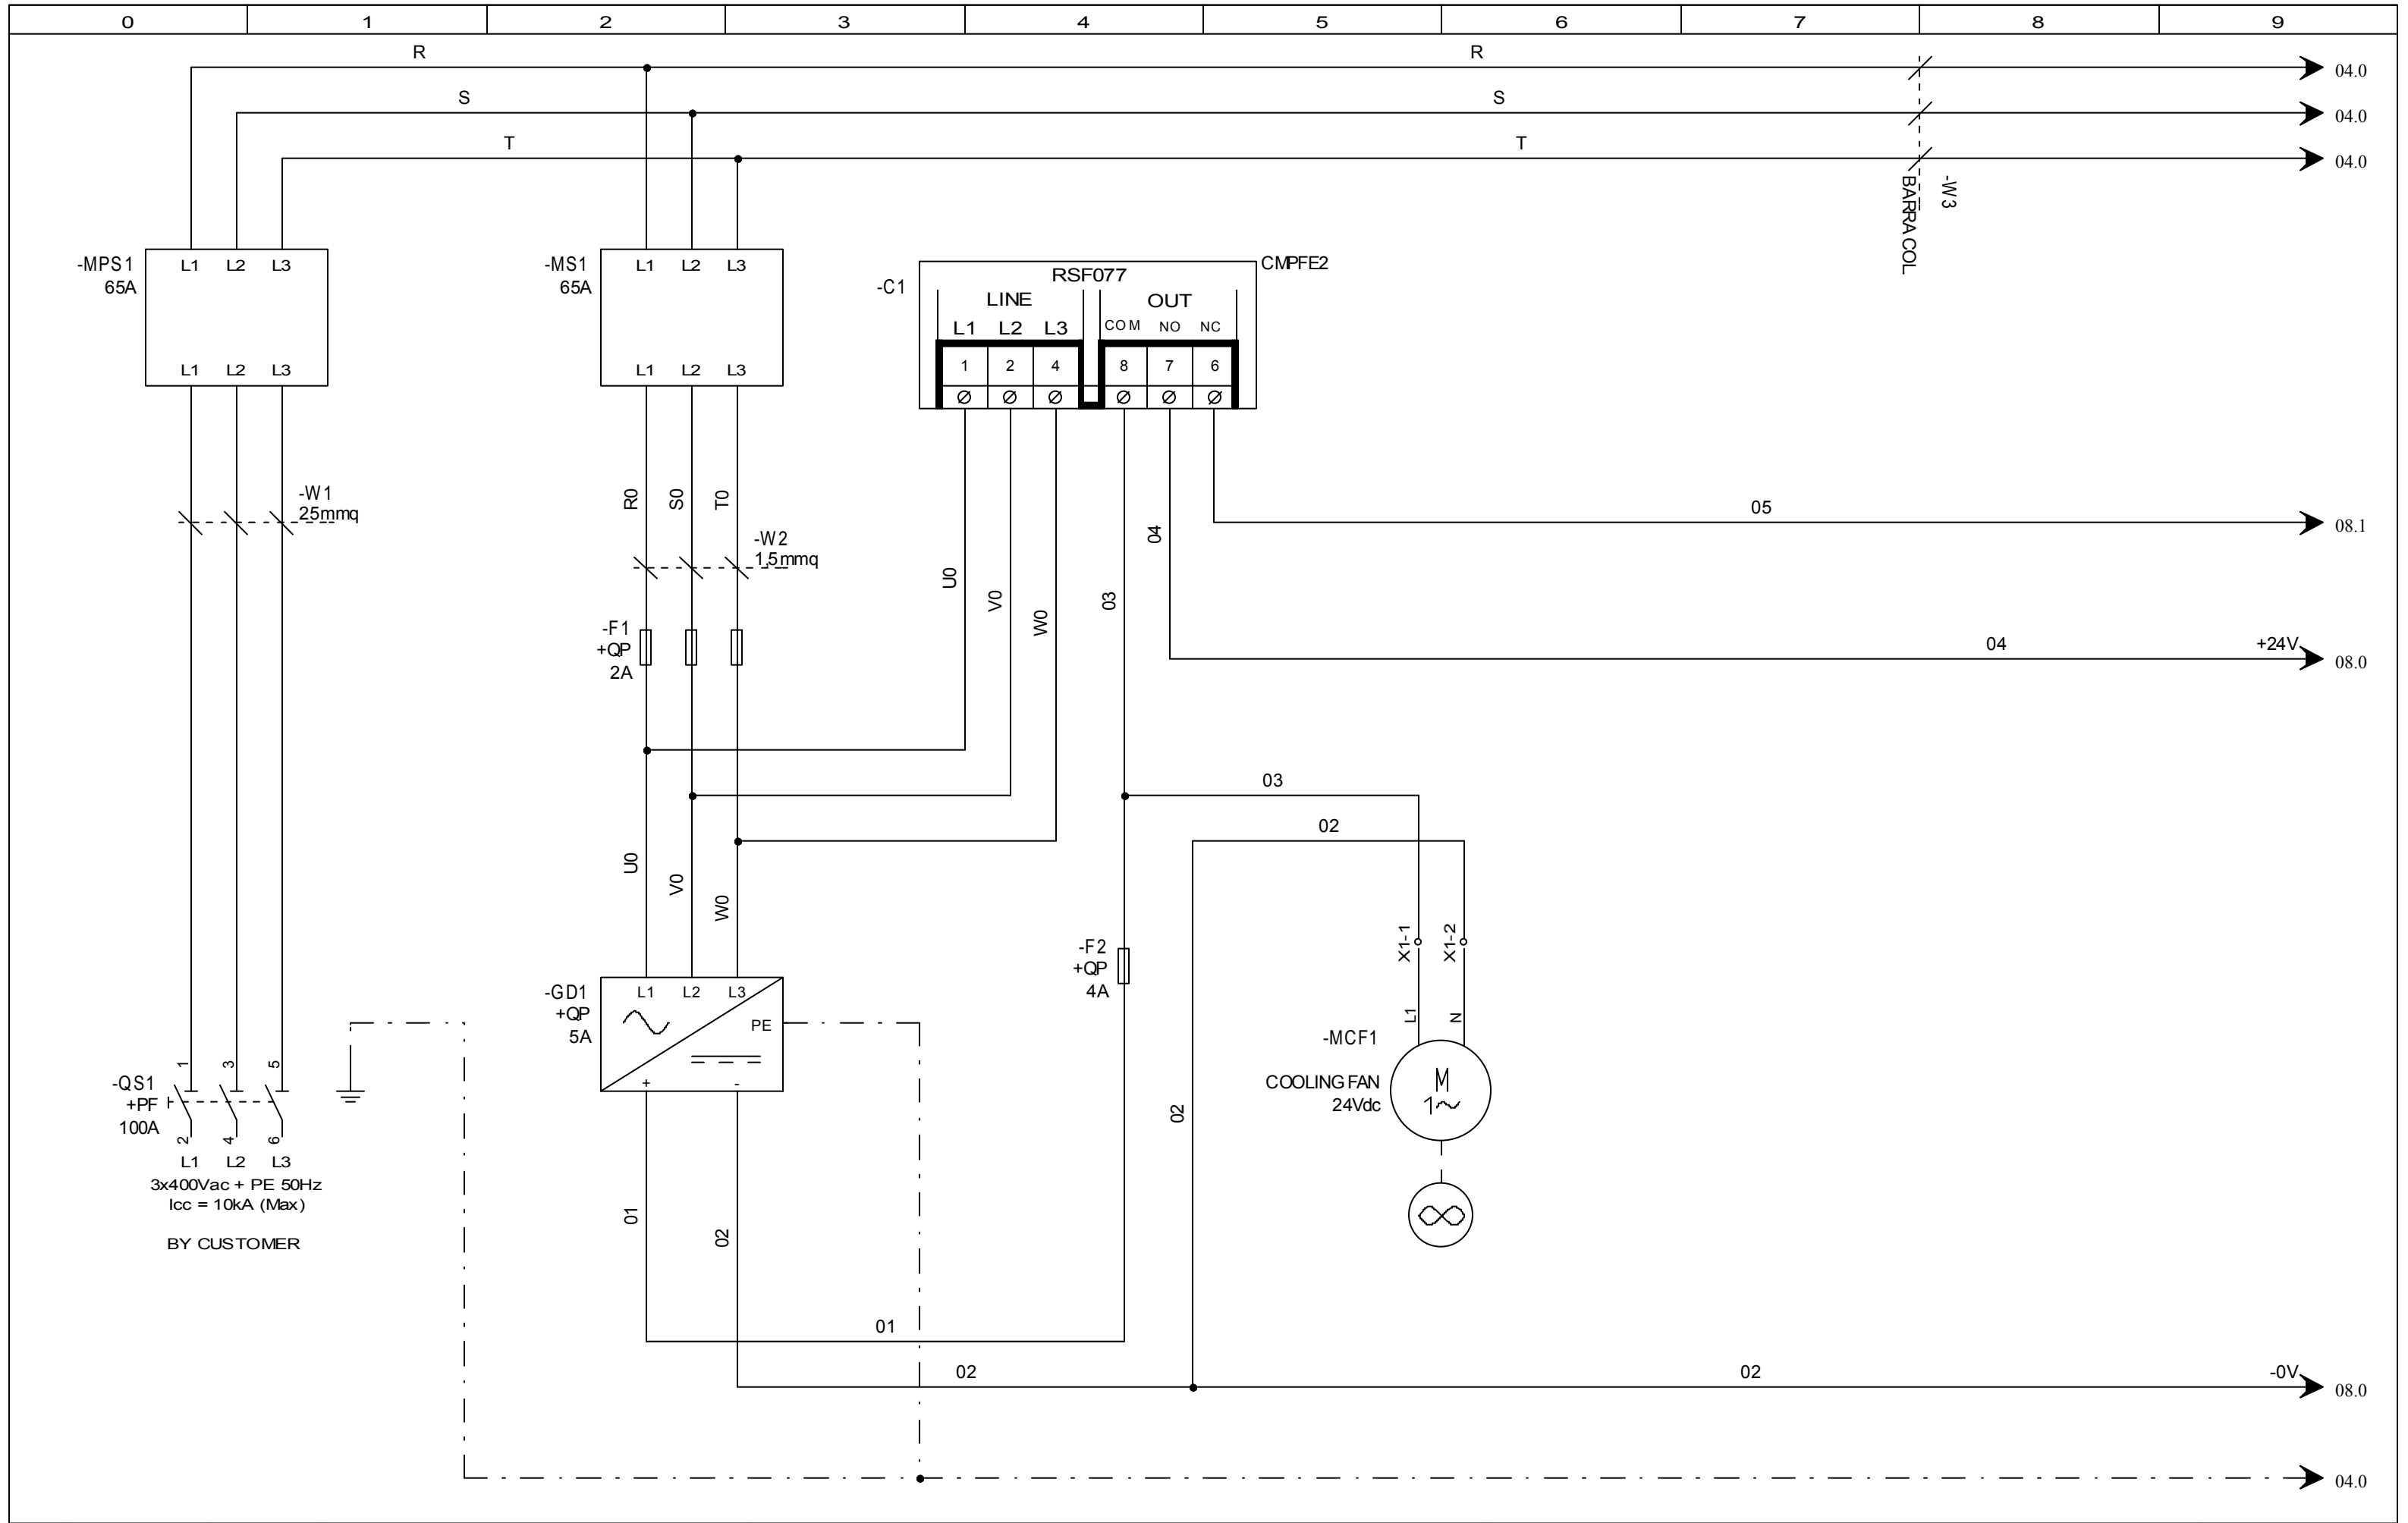


				 DRY AIR SOLUTIONS Via J.F.Kennedy, 25/27/29 - 56020 Capanne Z.I.Fontanelle	PROJECT: ADP3500E (Electrical Regen.)			SHEET 03
					CUSTOMER: -			
					COMMITTED:-			OF 19
					TITLE: Circuito POWER SUPPLY			02◀▶04
REV.	DATE	SIGNAT.	CHANGE					

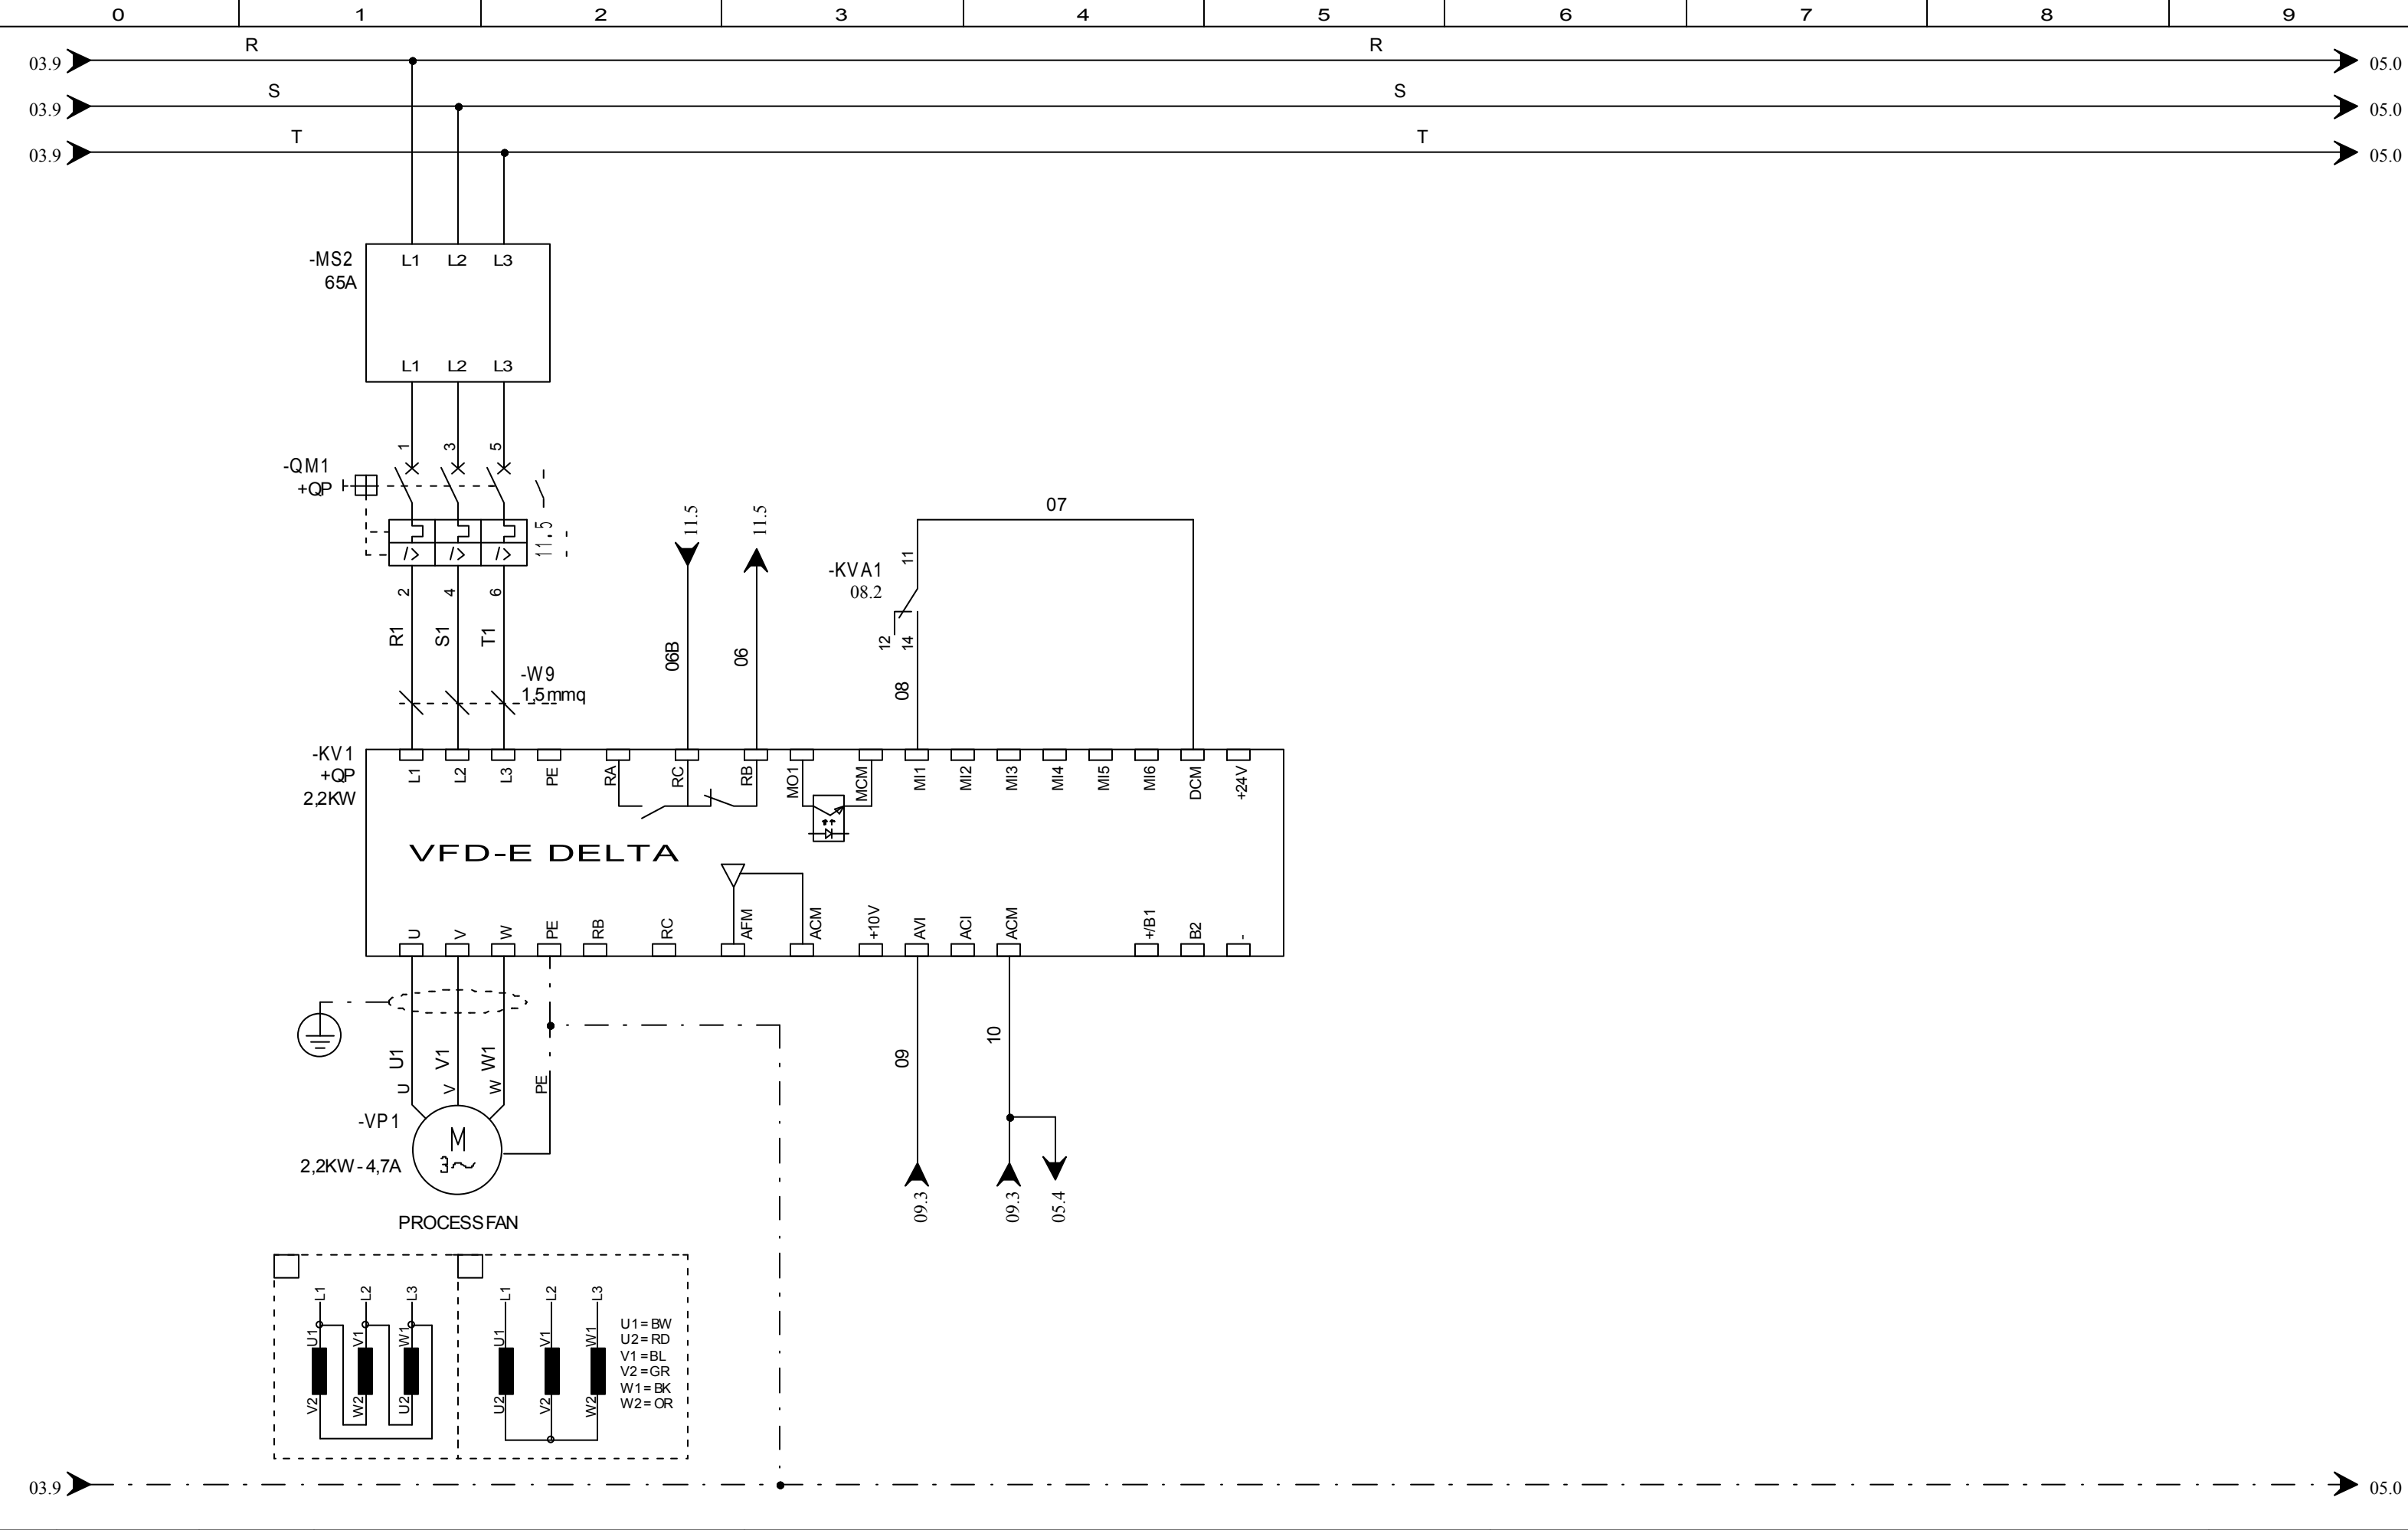


				 DRY AIR SOLUTIONS Via J.F.Kennedy, 25/27/29 - 56020 Capanne Z.I.Fontanelle	PROJECT: ADP3500E (Electrical Regen.)			SHEET 04
					CUSTOMER: -			
					COMMITTED:-			
					TITLE: Circuito Potenza			OF 19
REV.	DATE	SIGNAT.	CHANGE		DRA.: 01	DATE: 12/11/2018	LOC.:	03◀▶05



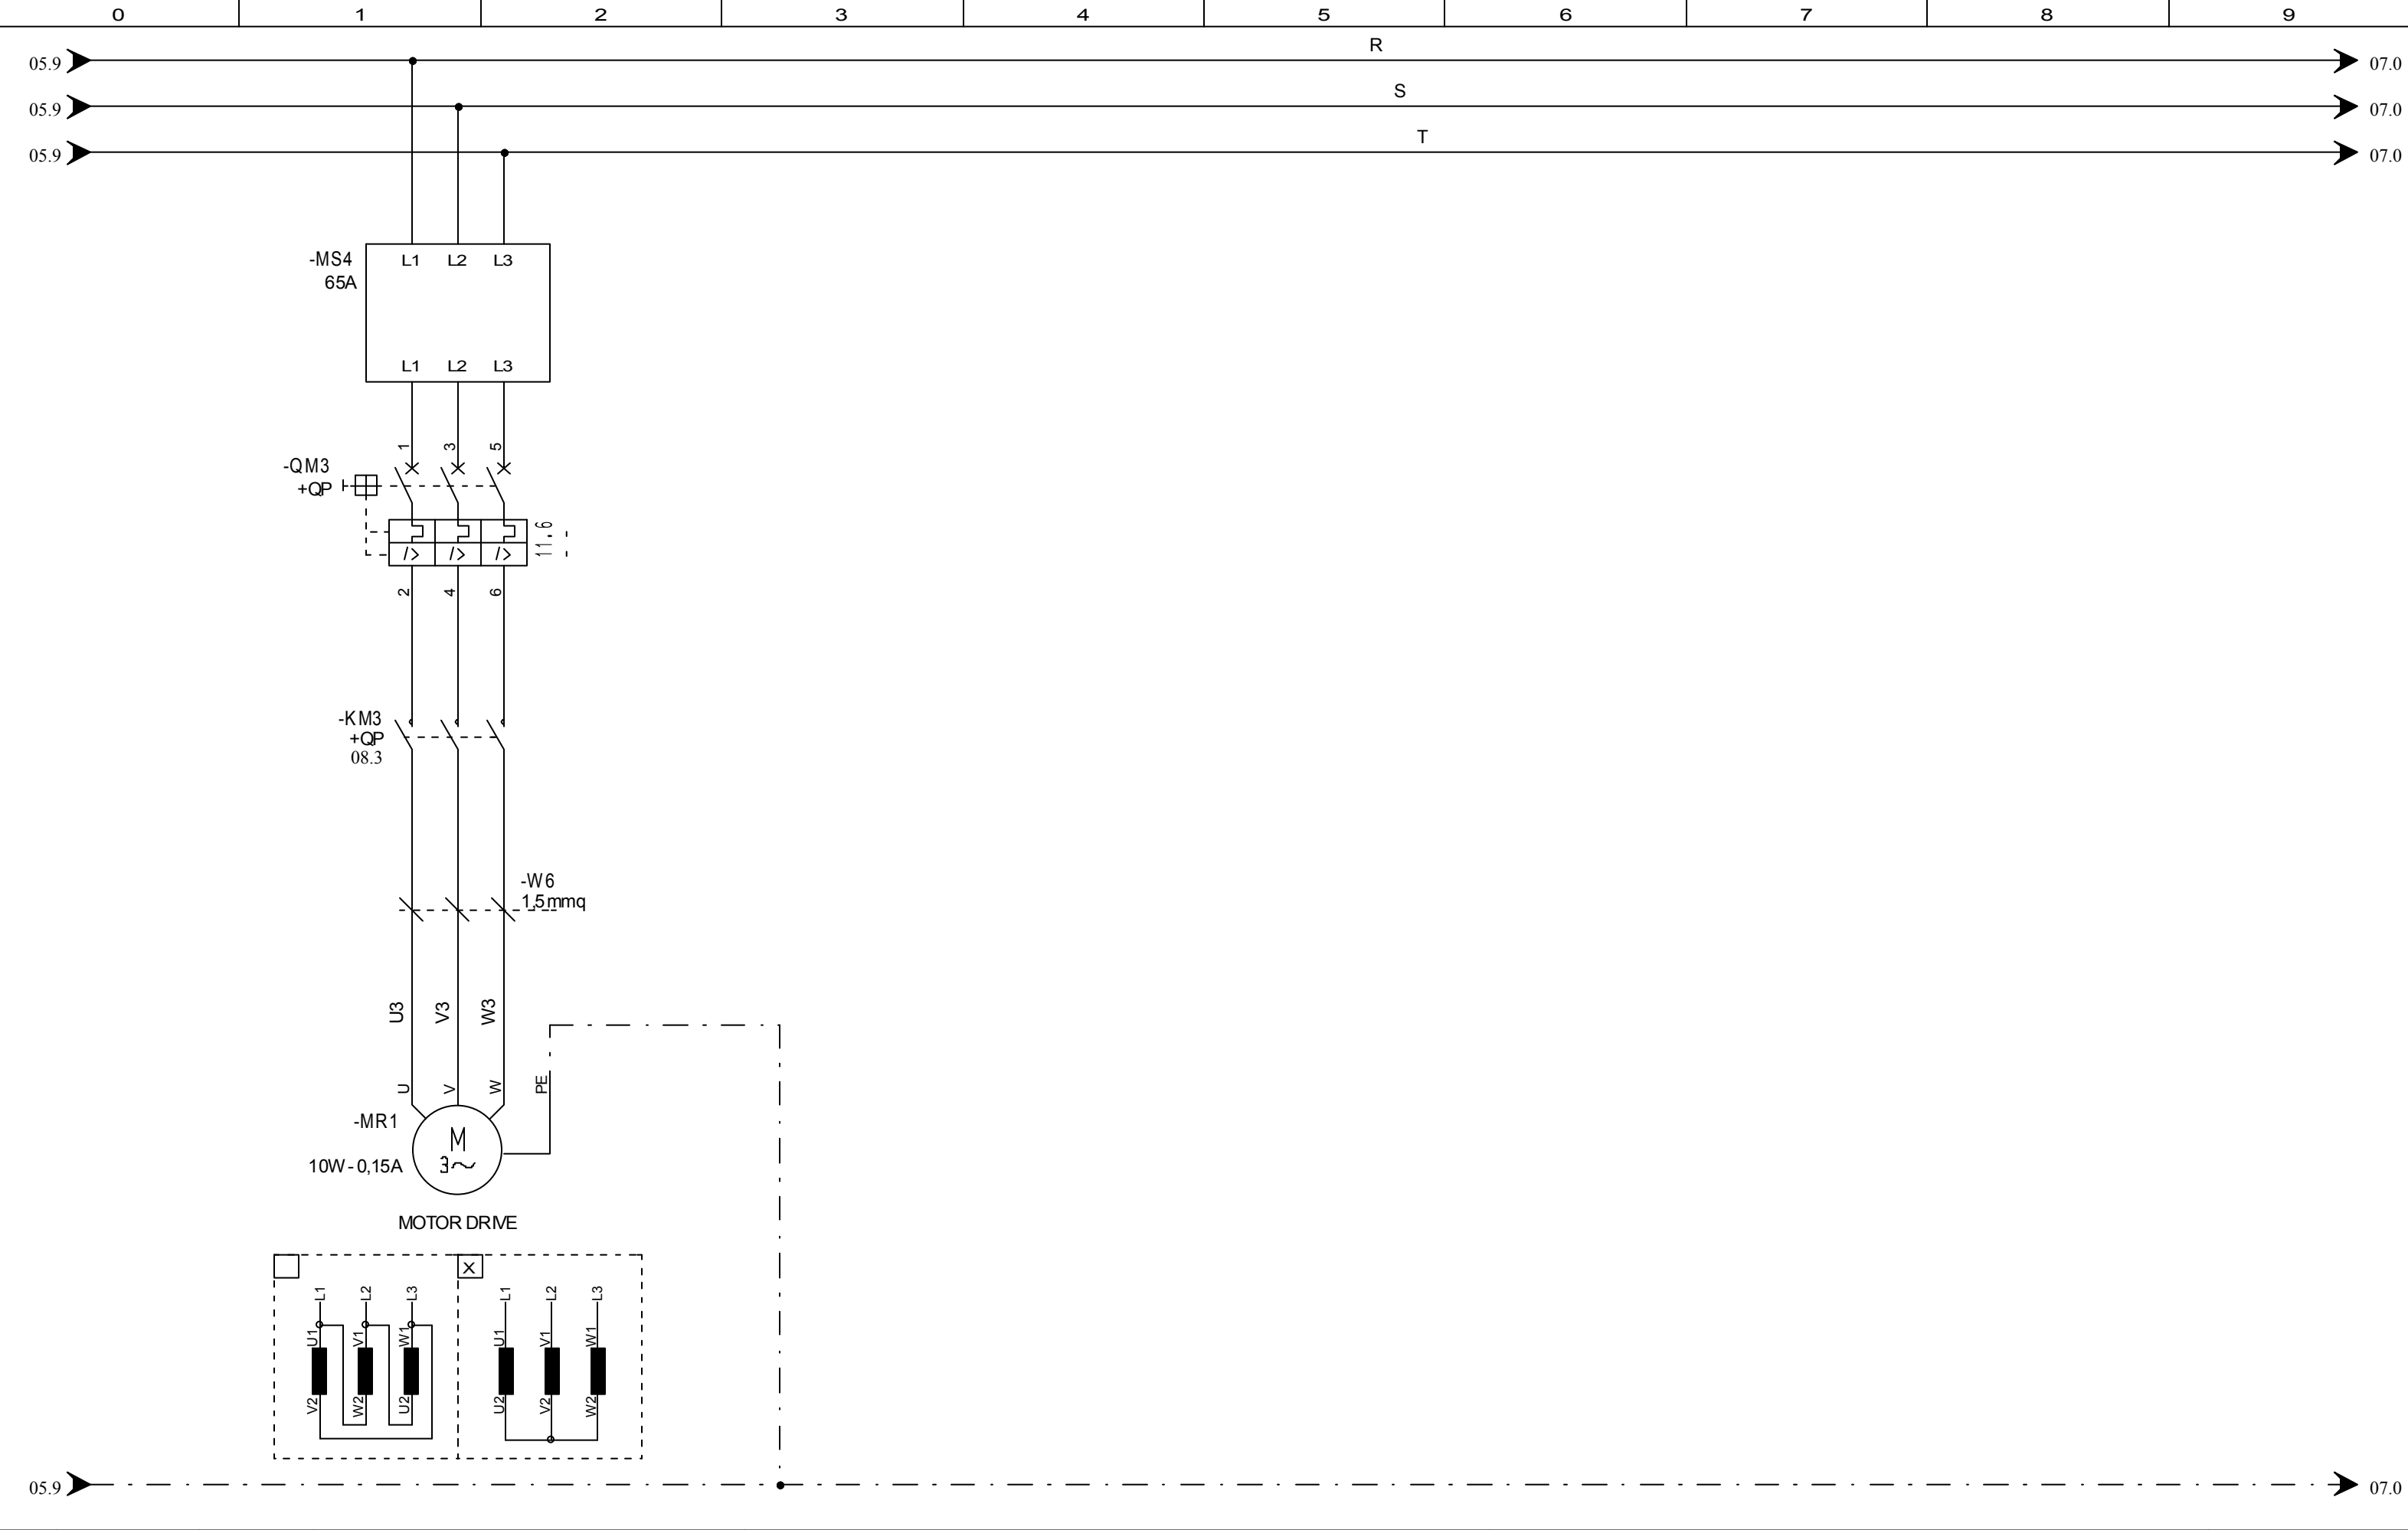

				 DRY AIR SOLUTIONS Via J.F.Kennedy, 25/27/29 - 56020 Capanne Z.I.Fontanelle	PROJECT: ADP3500E (Electrical Regen.)			SHEET 06 OF 19
					CUSTOMER: -			
					COMMITTED:-			
					TITLE: Circuito Potenza			05◀▶07
REV.	DATE	SIGNAT.	CHANGE		DRA.: 01 DATE: 12/11/2018 LOC.:			

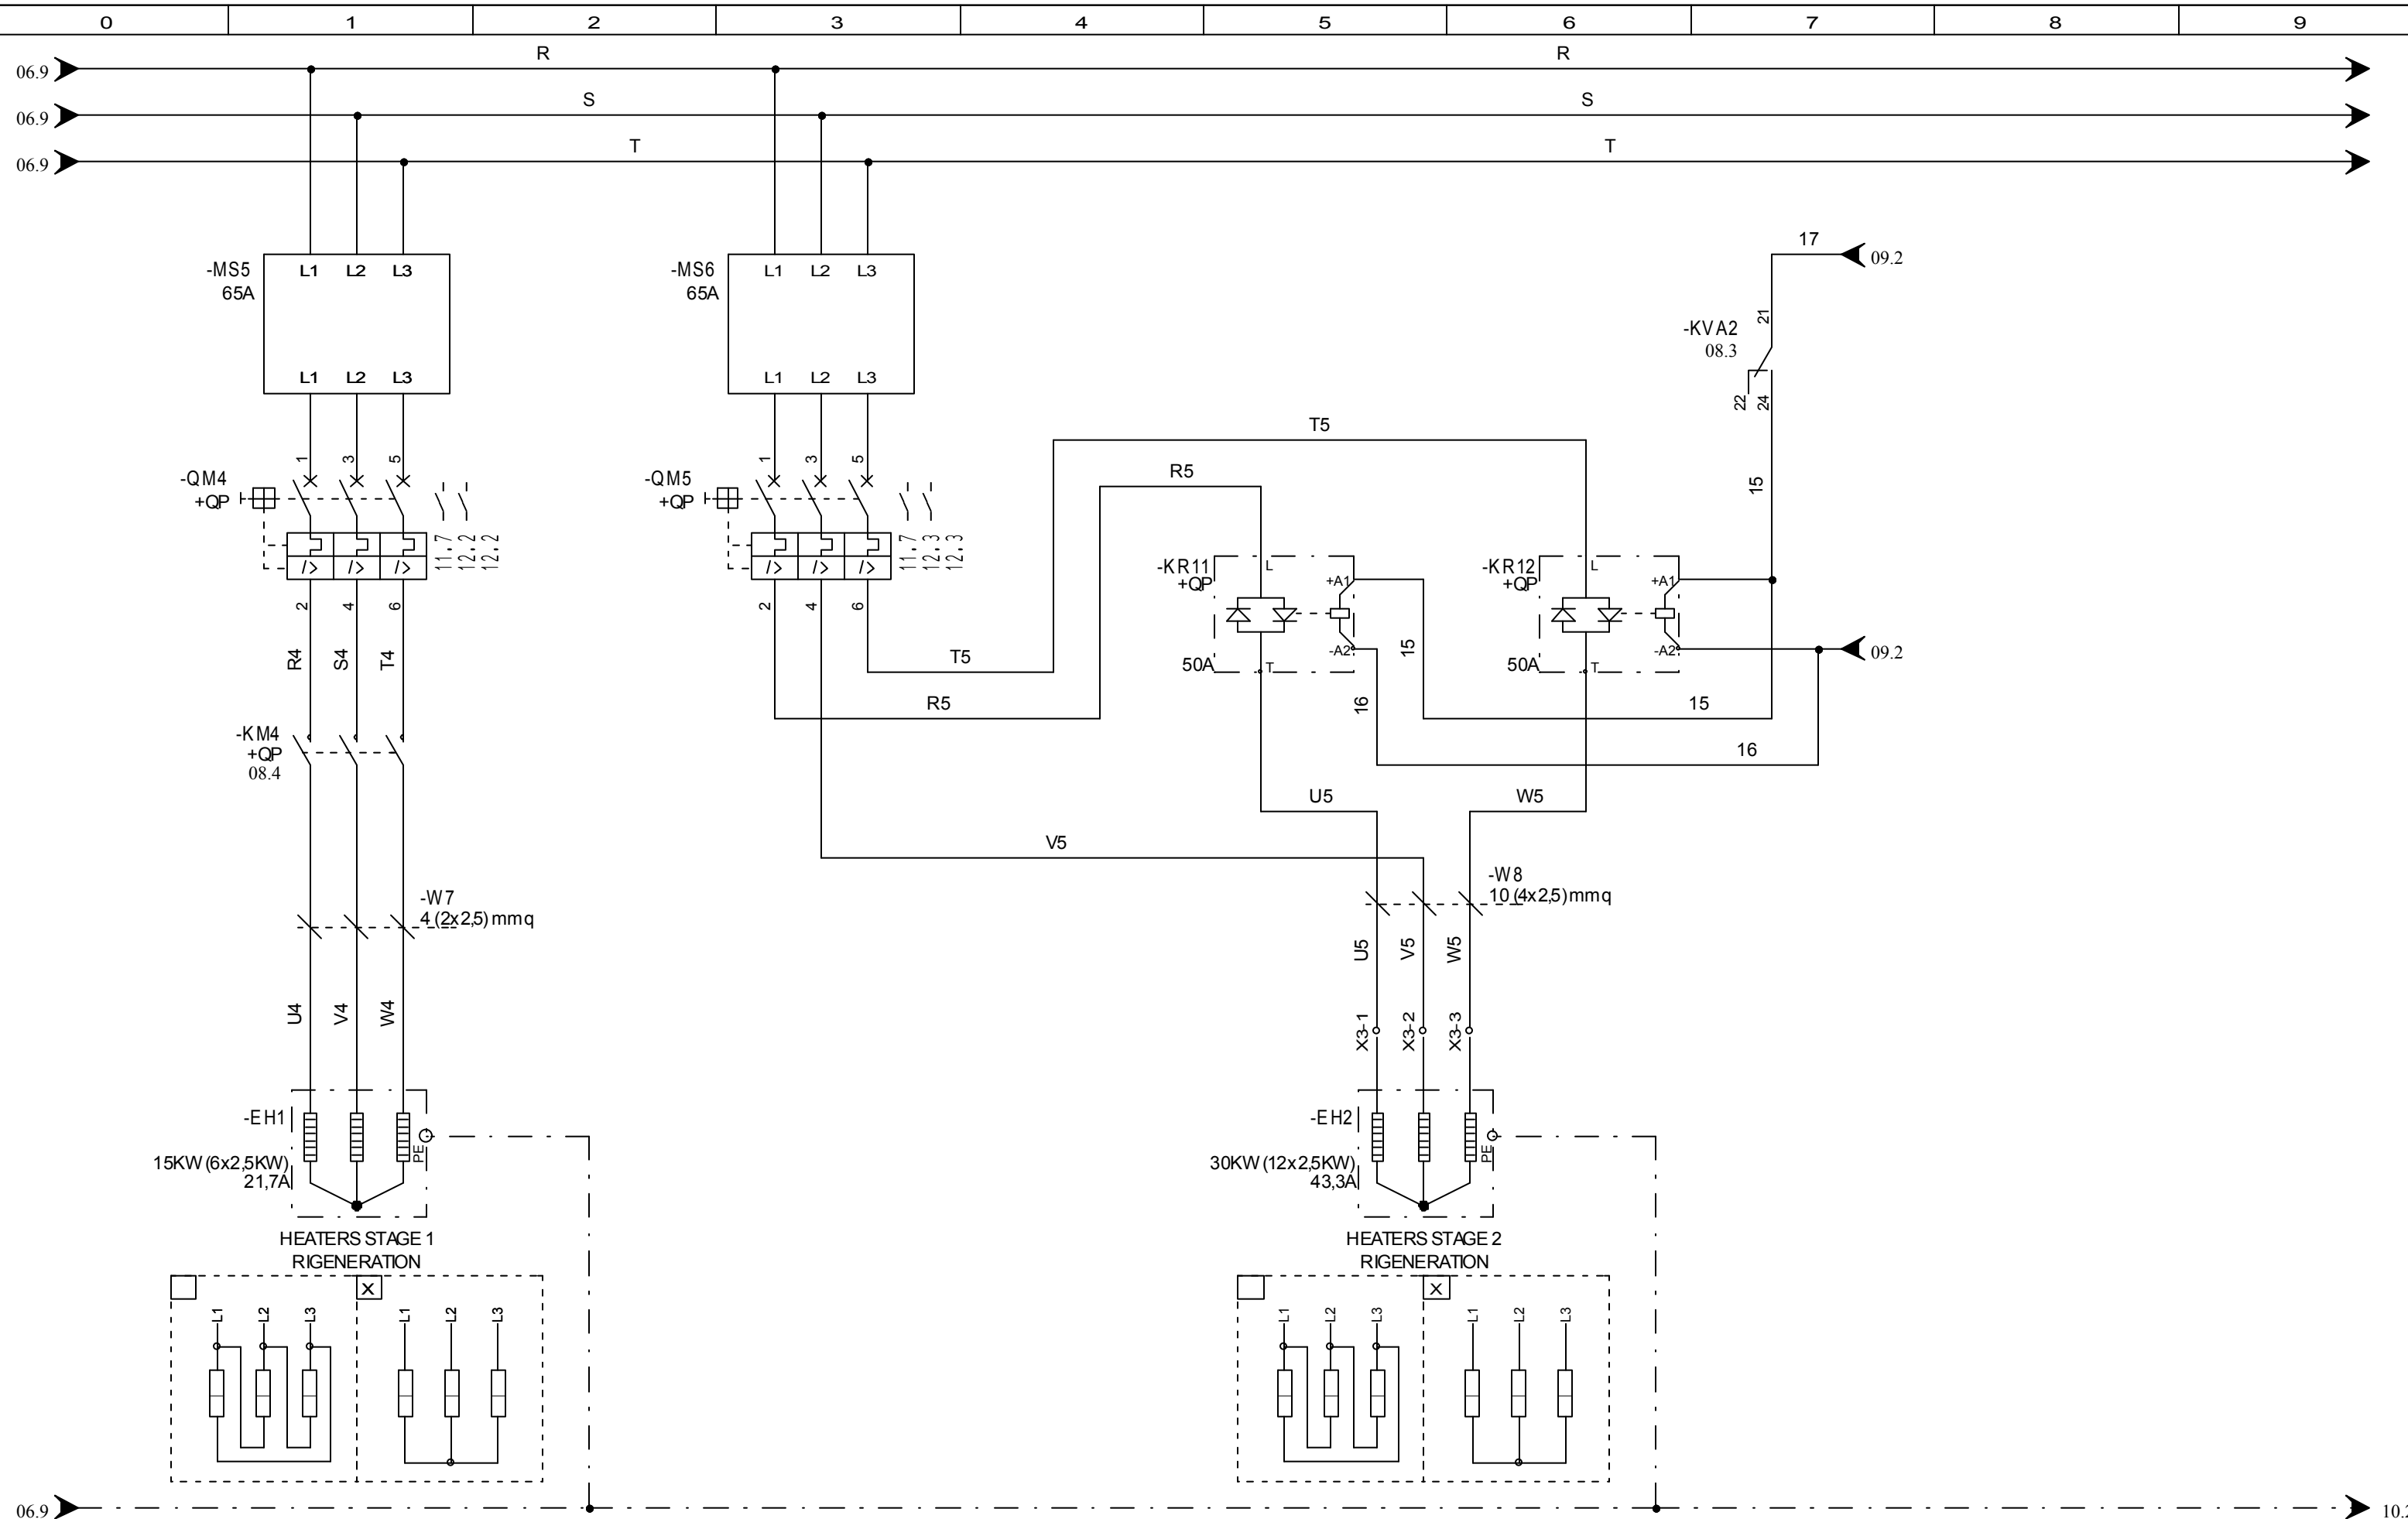



REV.	DATE	SIGNAT.	CHANGE




Via J.F.Kennedy, 25/27/29 - 56020 Capanne Z.I.Fontanelle


PROJECT: ADP3500E (Electrical Regen.)			SHEET 07
CUSTOMER: -			
COMMITTED:-			OF 19
TITLE: Circuito Potenza			06◀▶08
DRA.: 01	DATE: 12/11/2018	LOC.:	

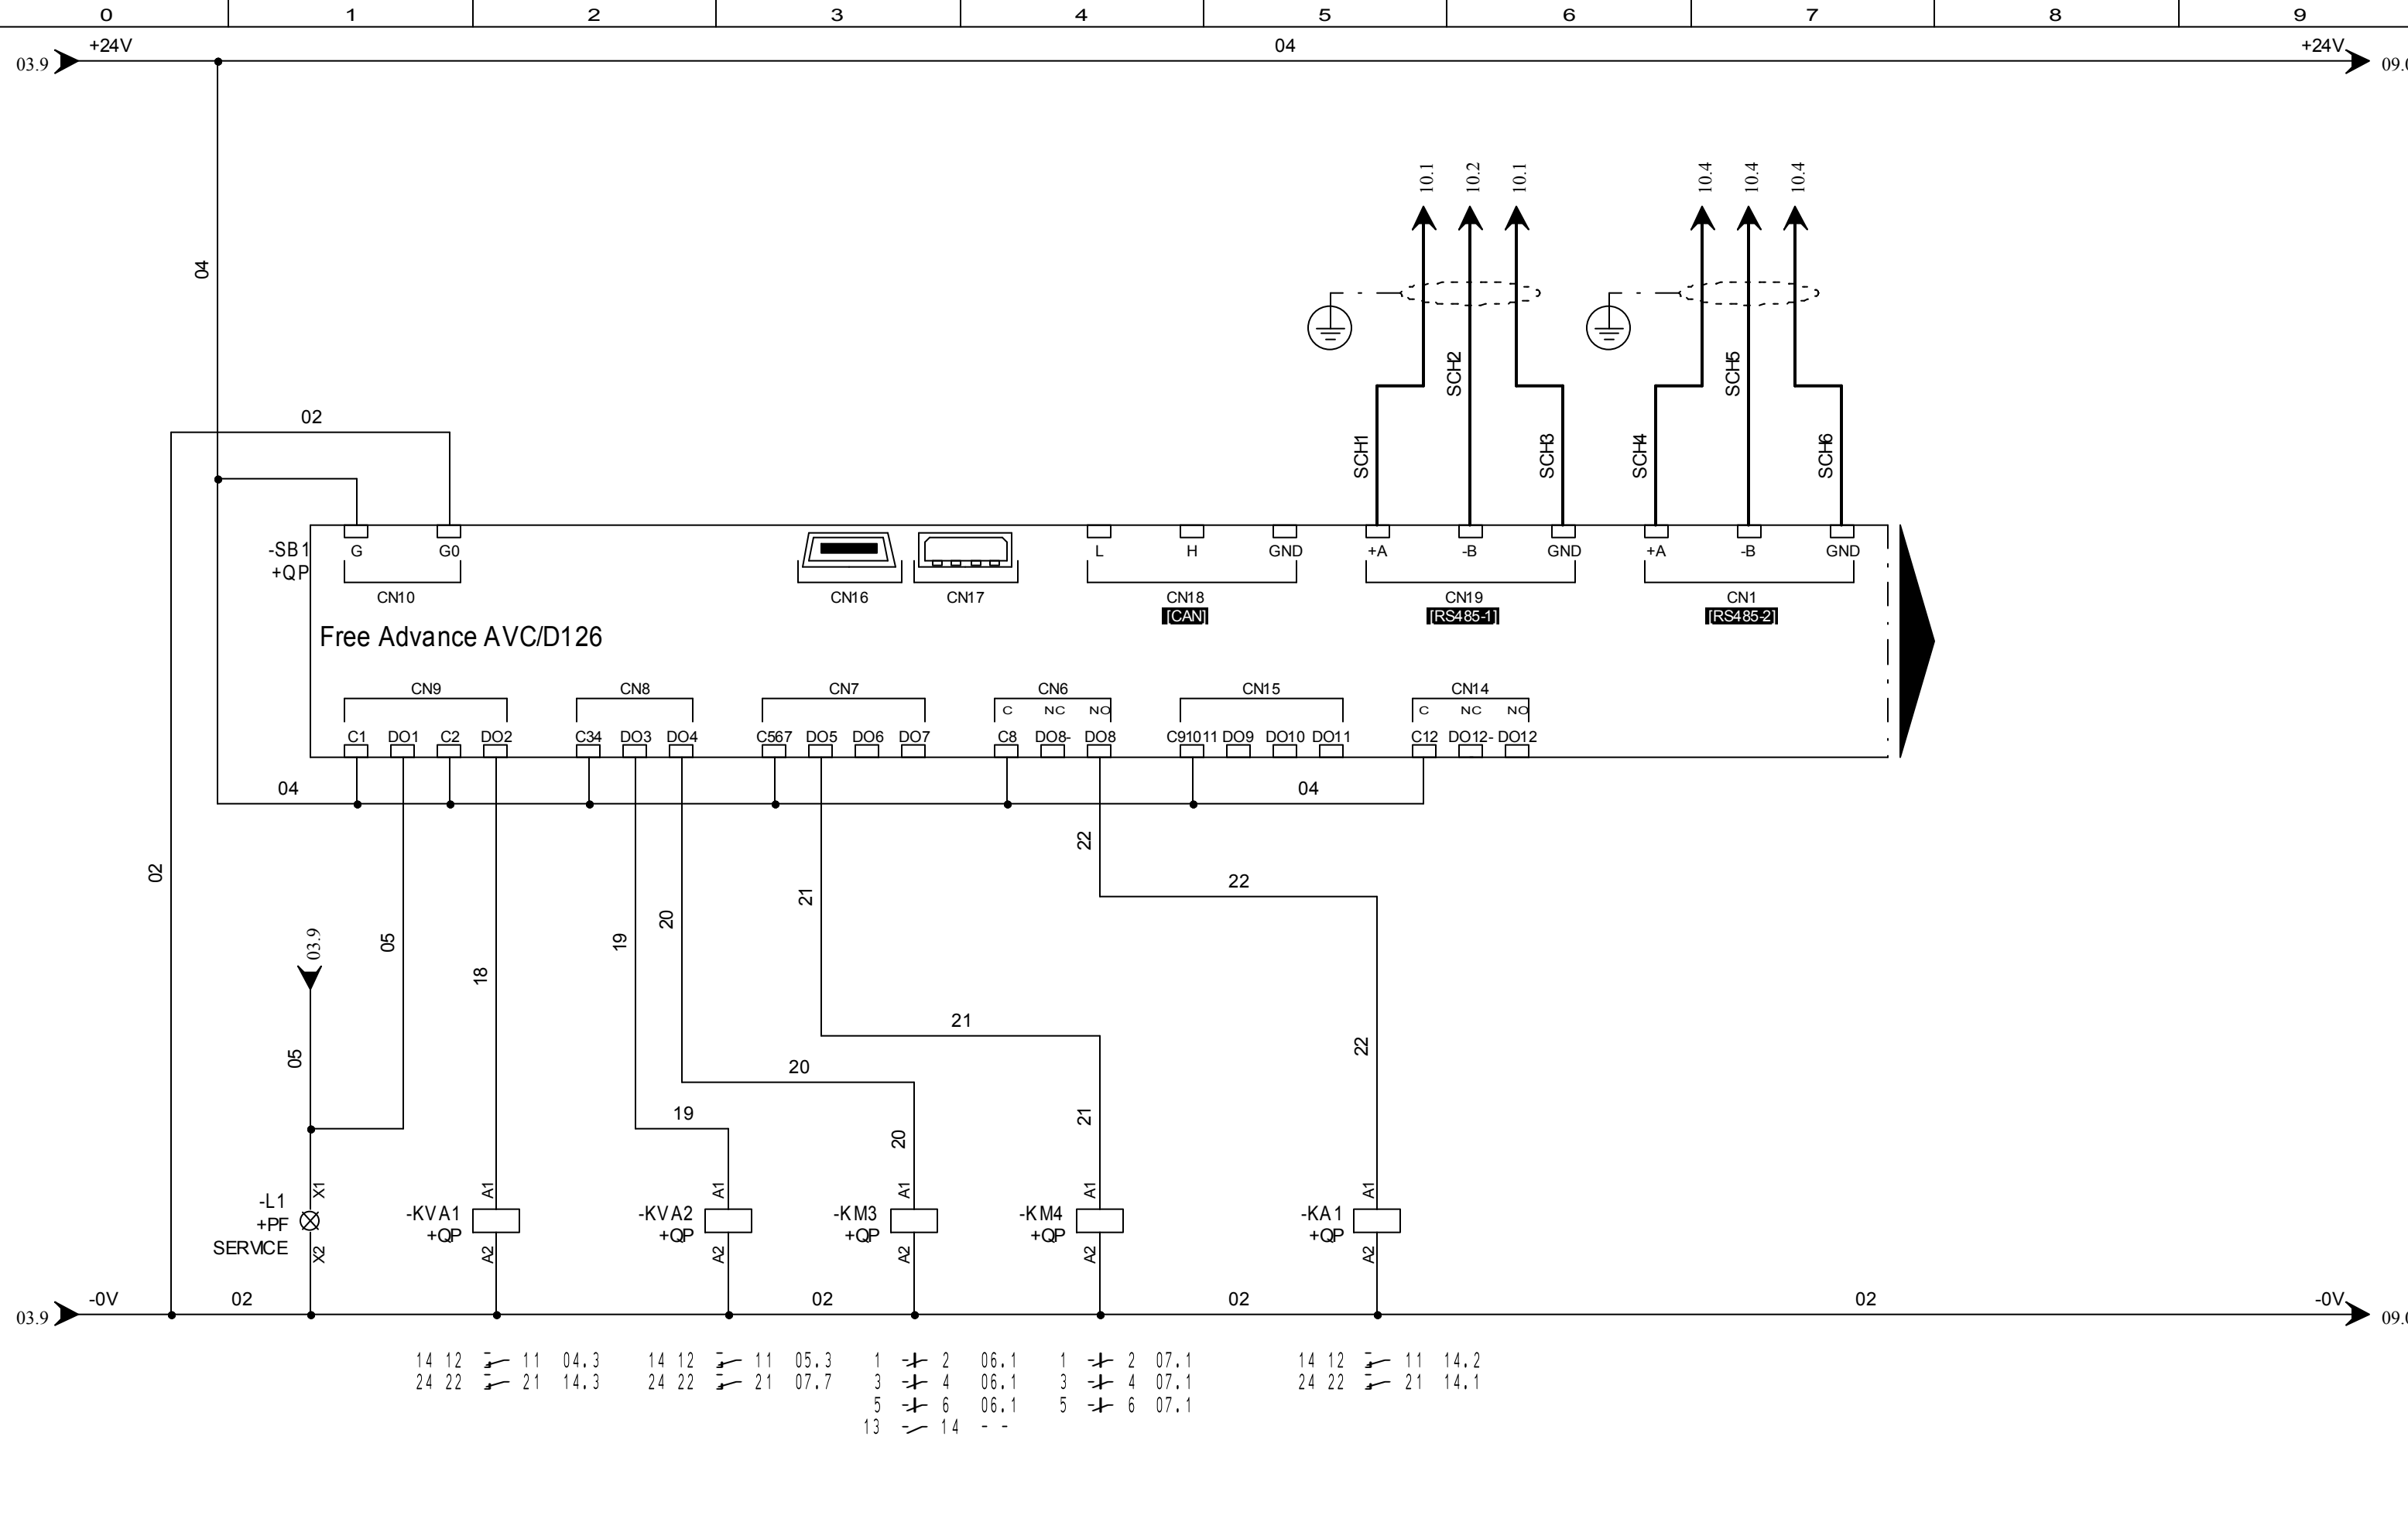


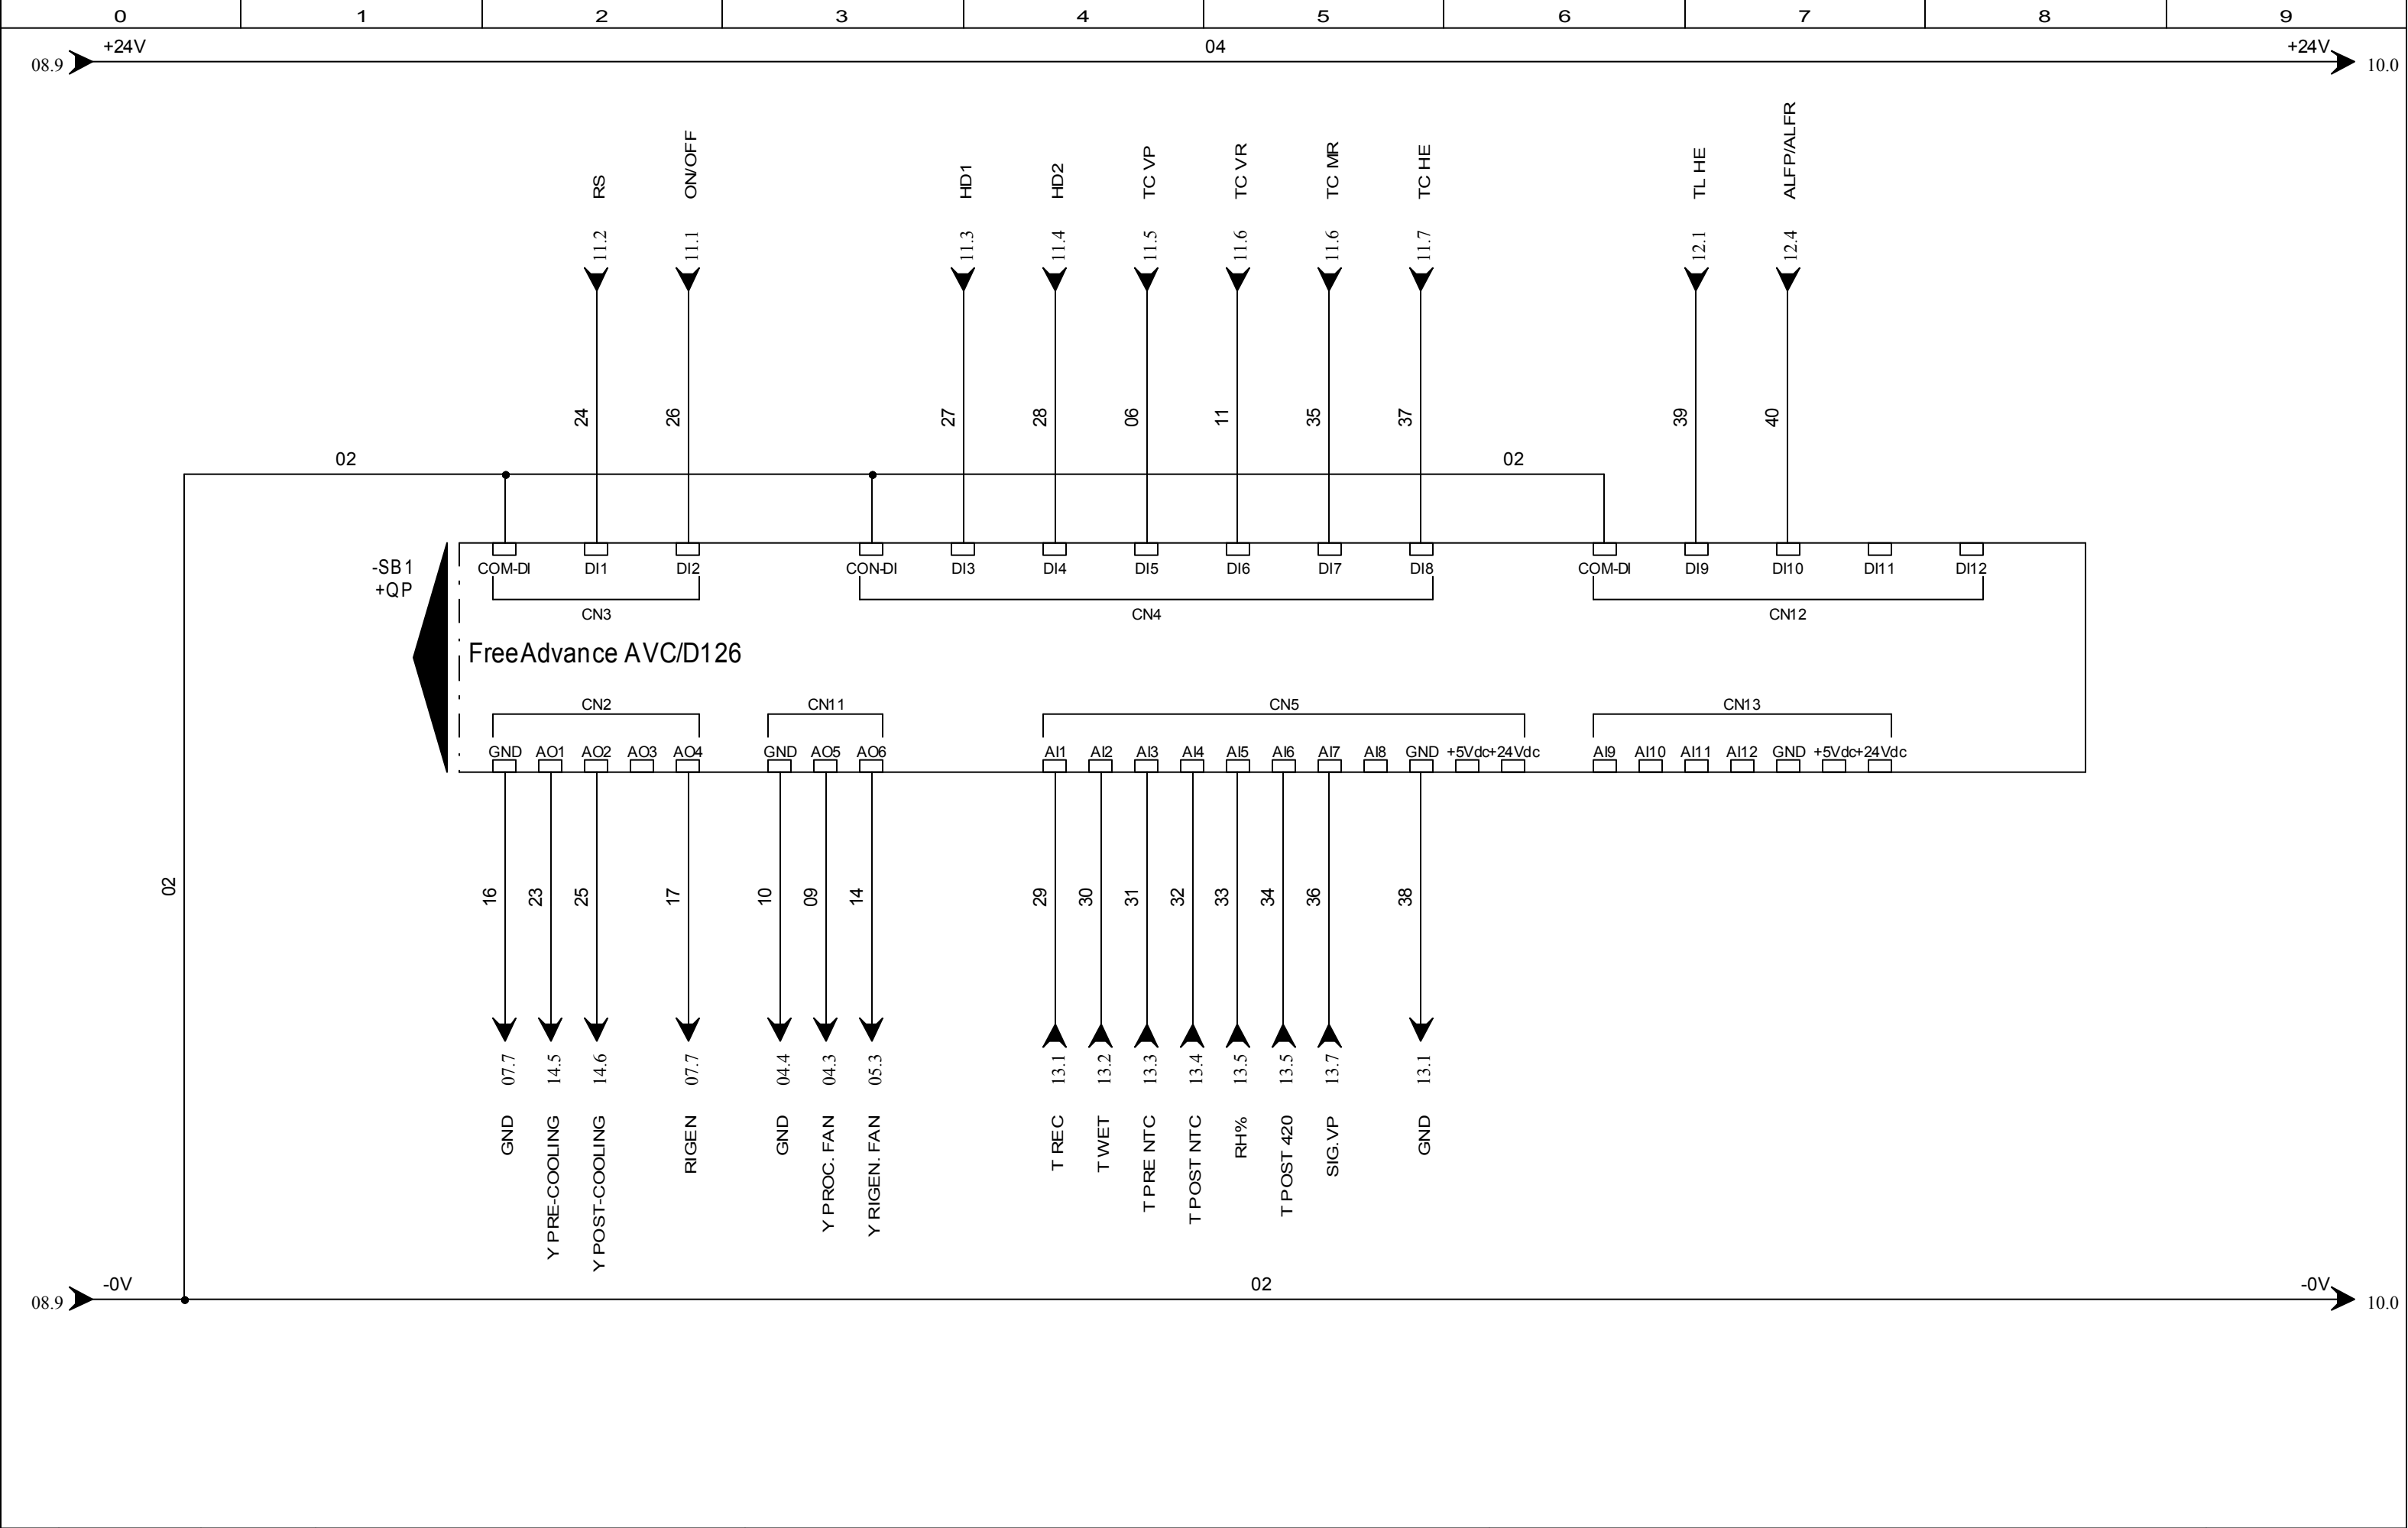


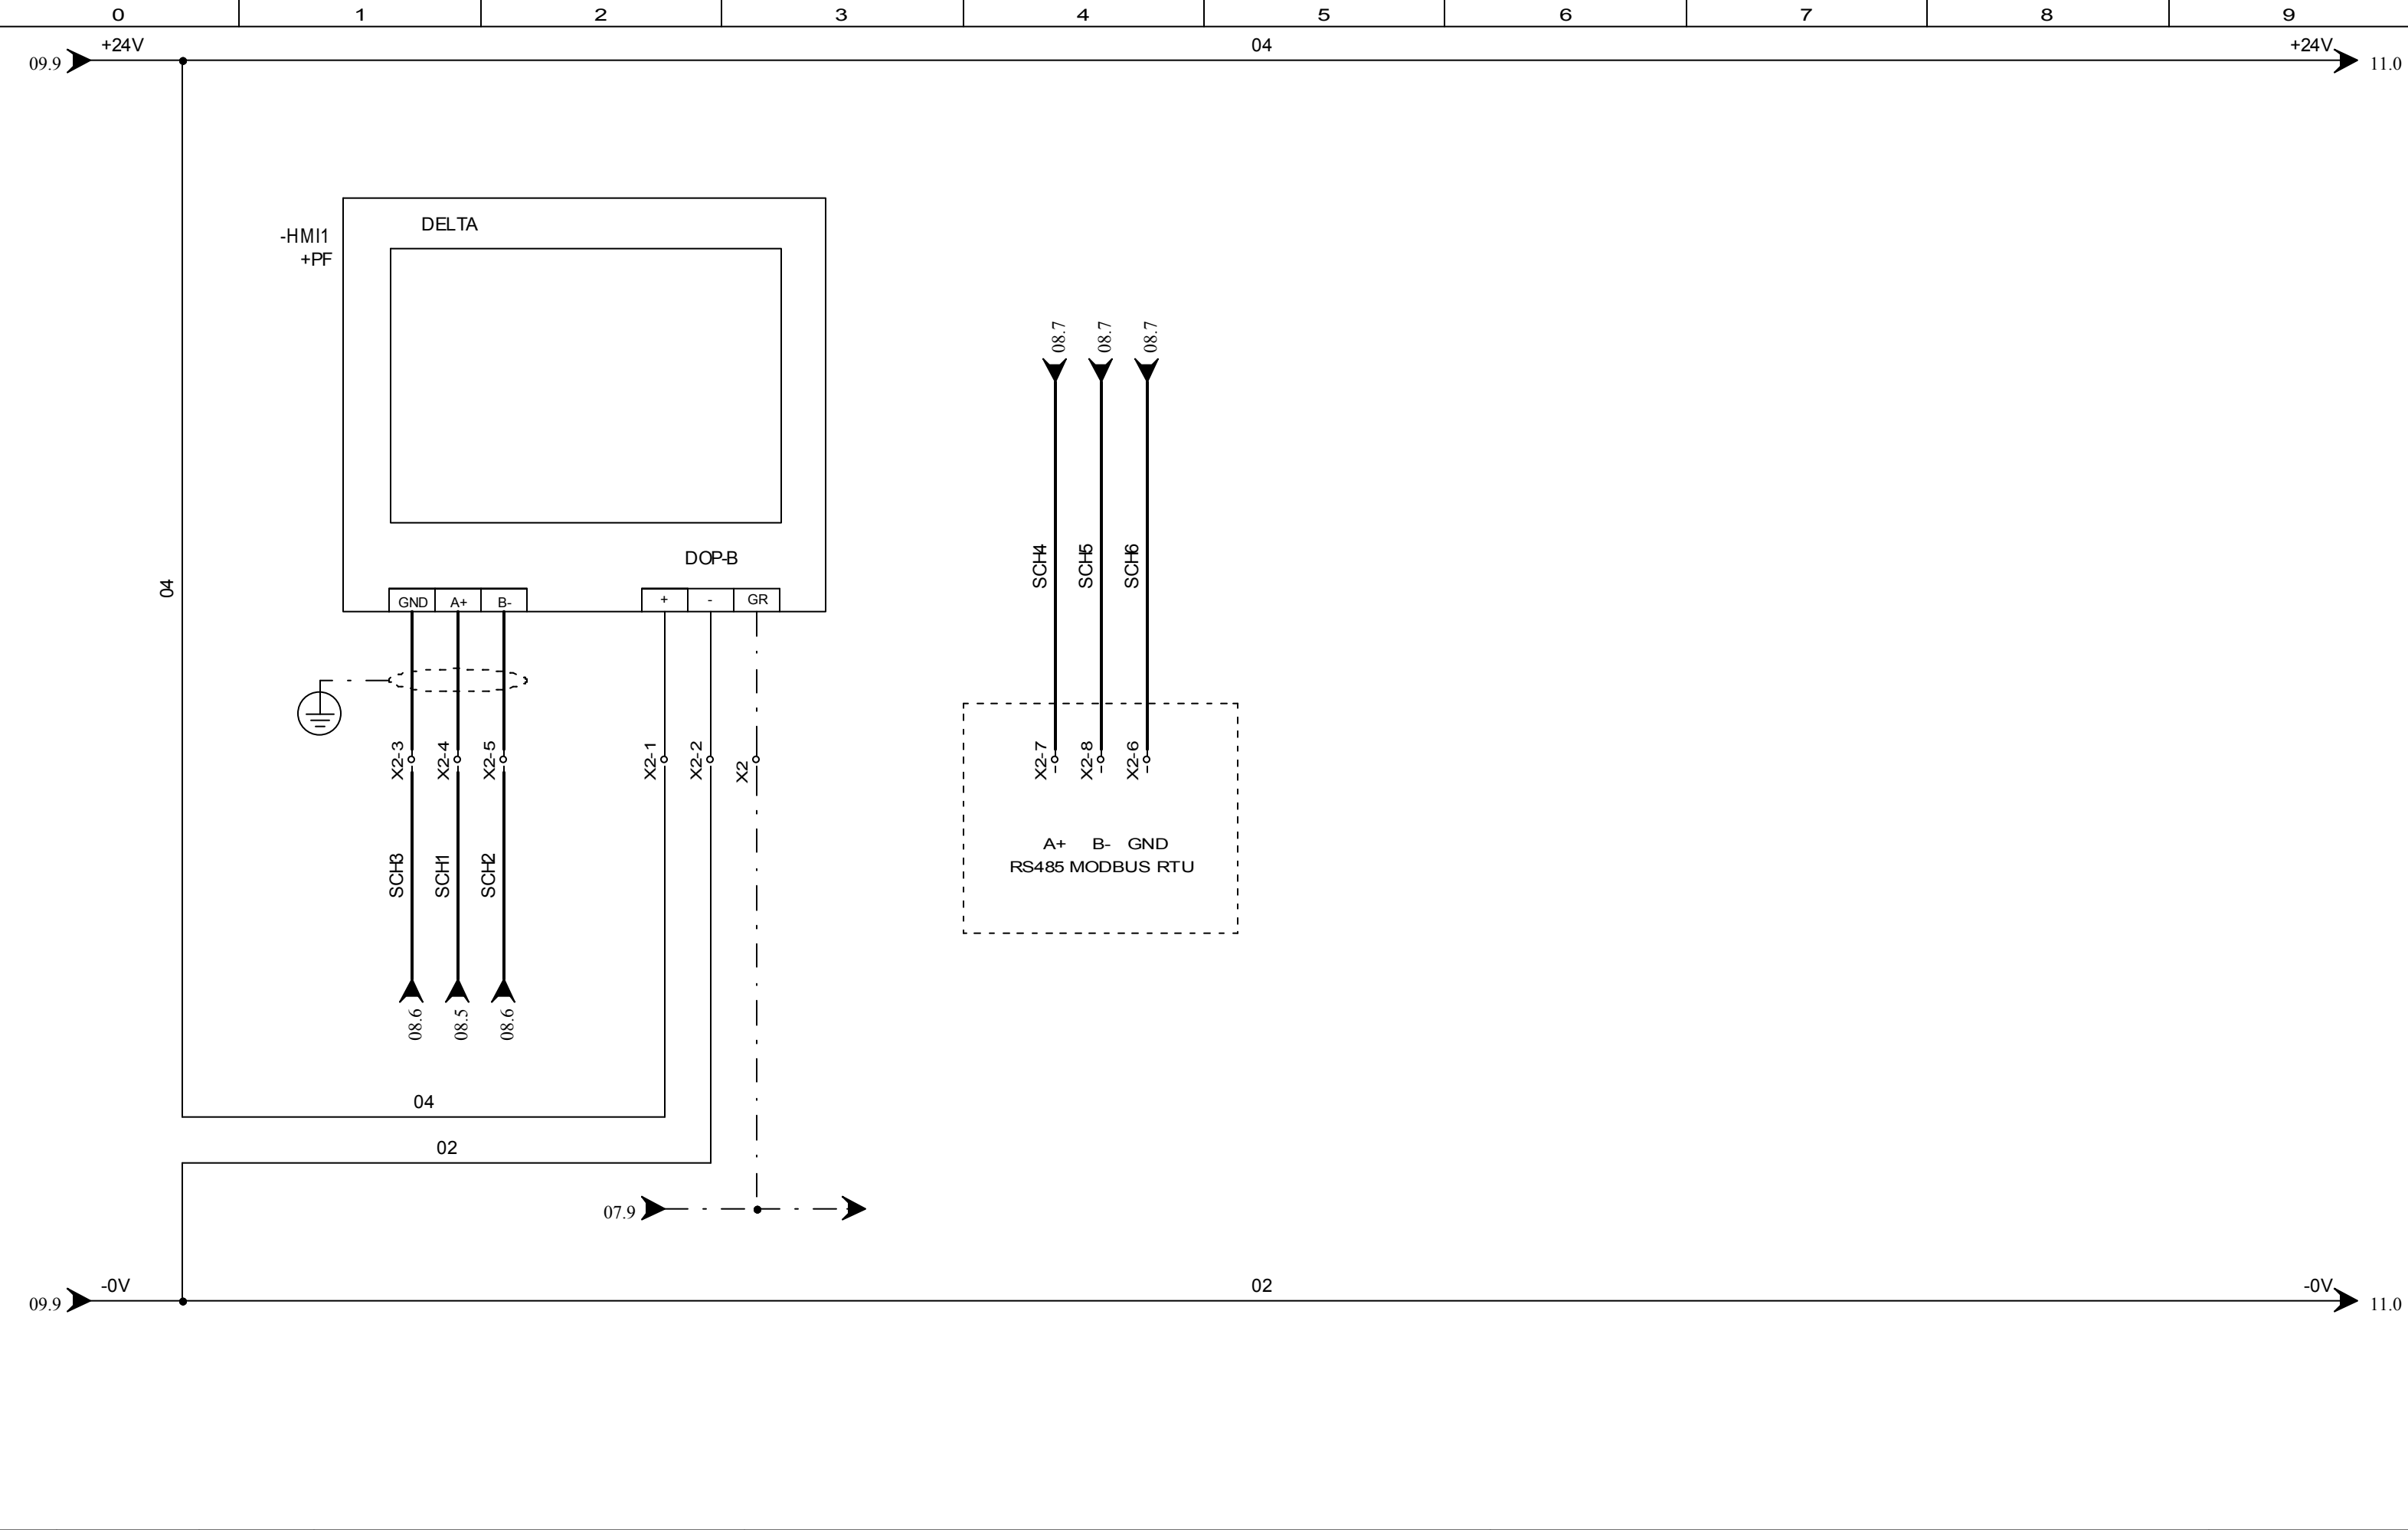

				 TFT DRY AIR SOLUTIONS Via J.F.Kennedy, 25/27/29 - 56020 Capanne Z.I.Fontanelle	PROJECT: ADP3500E (Electrical Regen.)			SHEET 10 OF 19
					CUSTOMER: -			
					COMMITTED:-			
					TITLE: Circuito Ausiliario			09◀▶11
REV.	DATE	SIGNAT.	CHANGE		DRA.: 01 DATE: 12/11/2018 LOC.:			

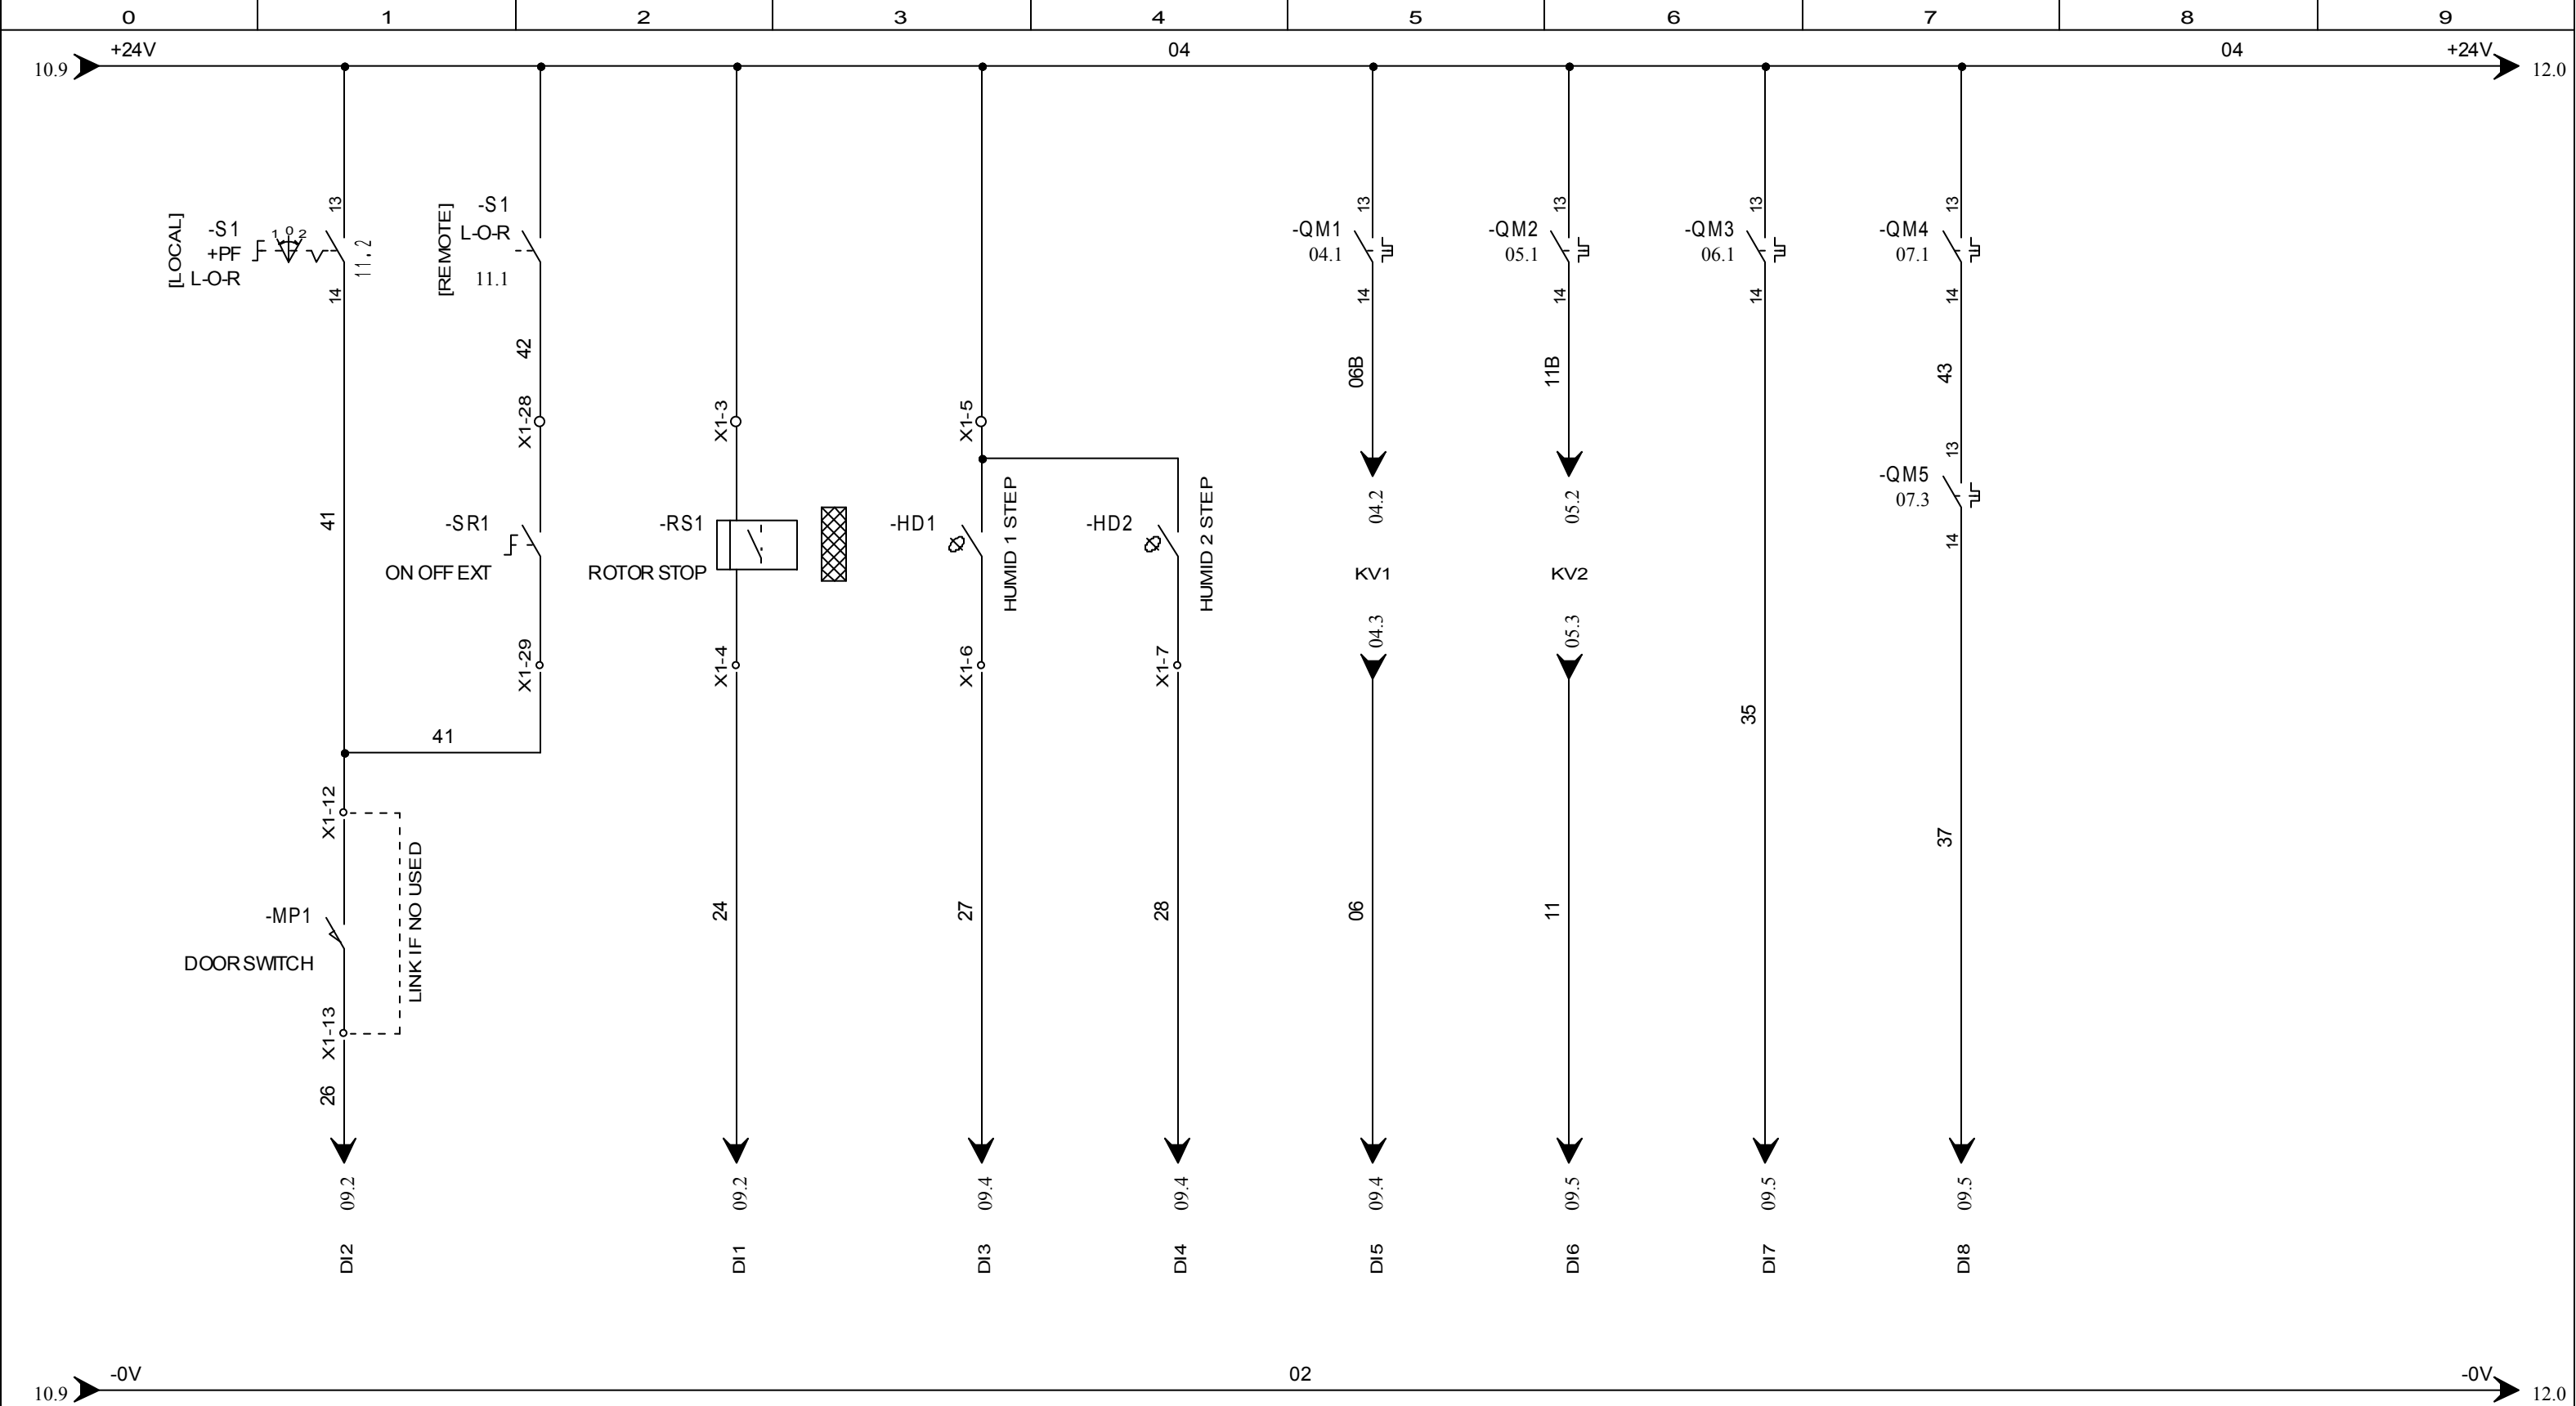

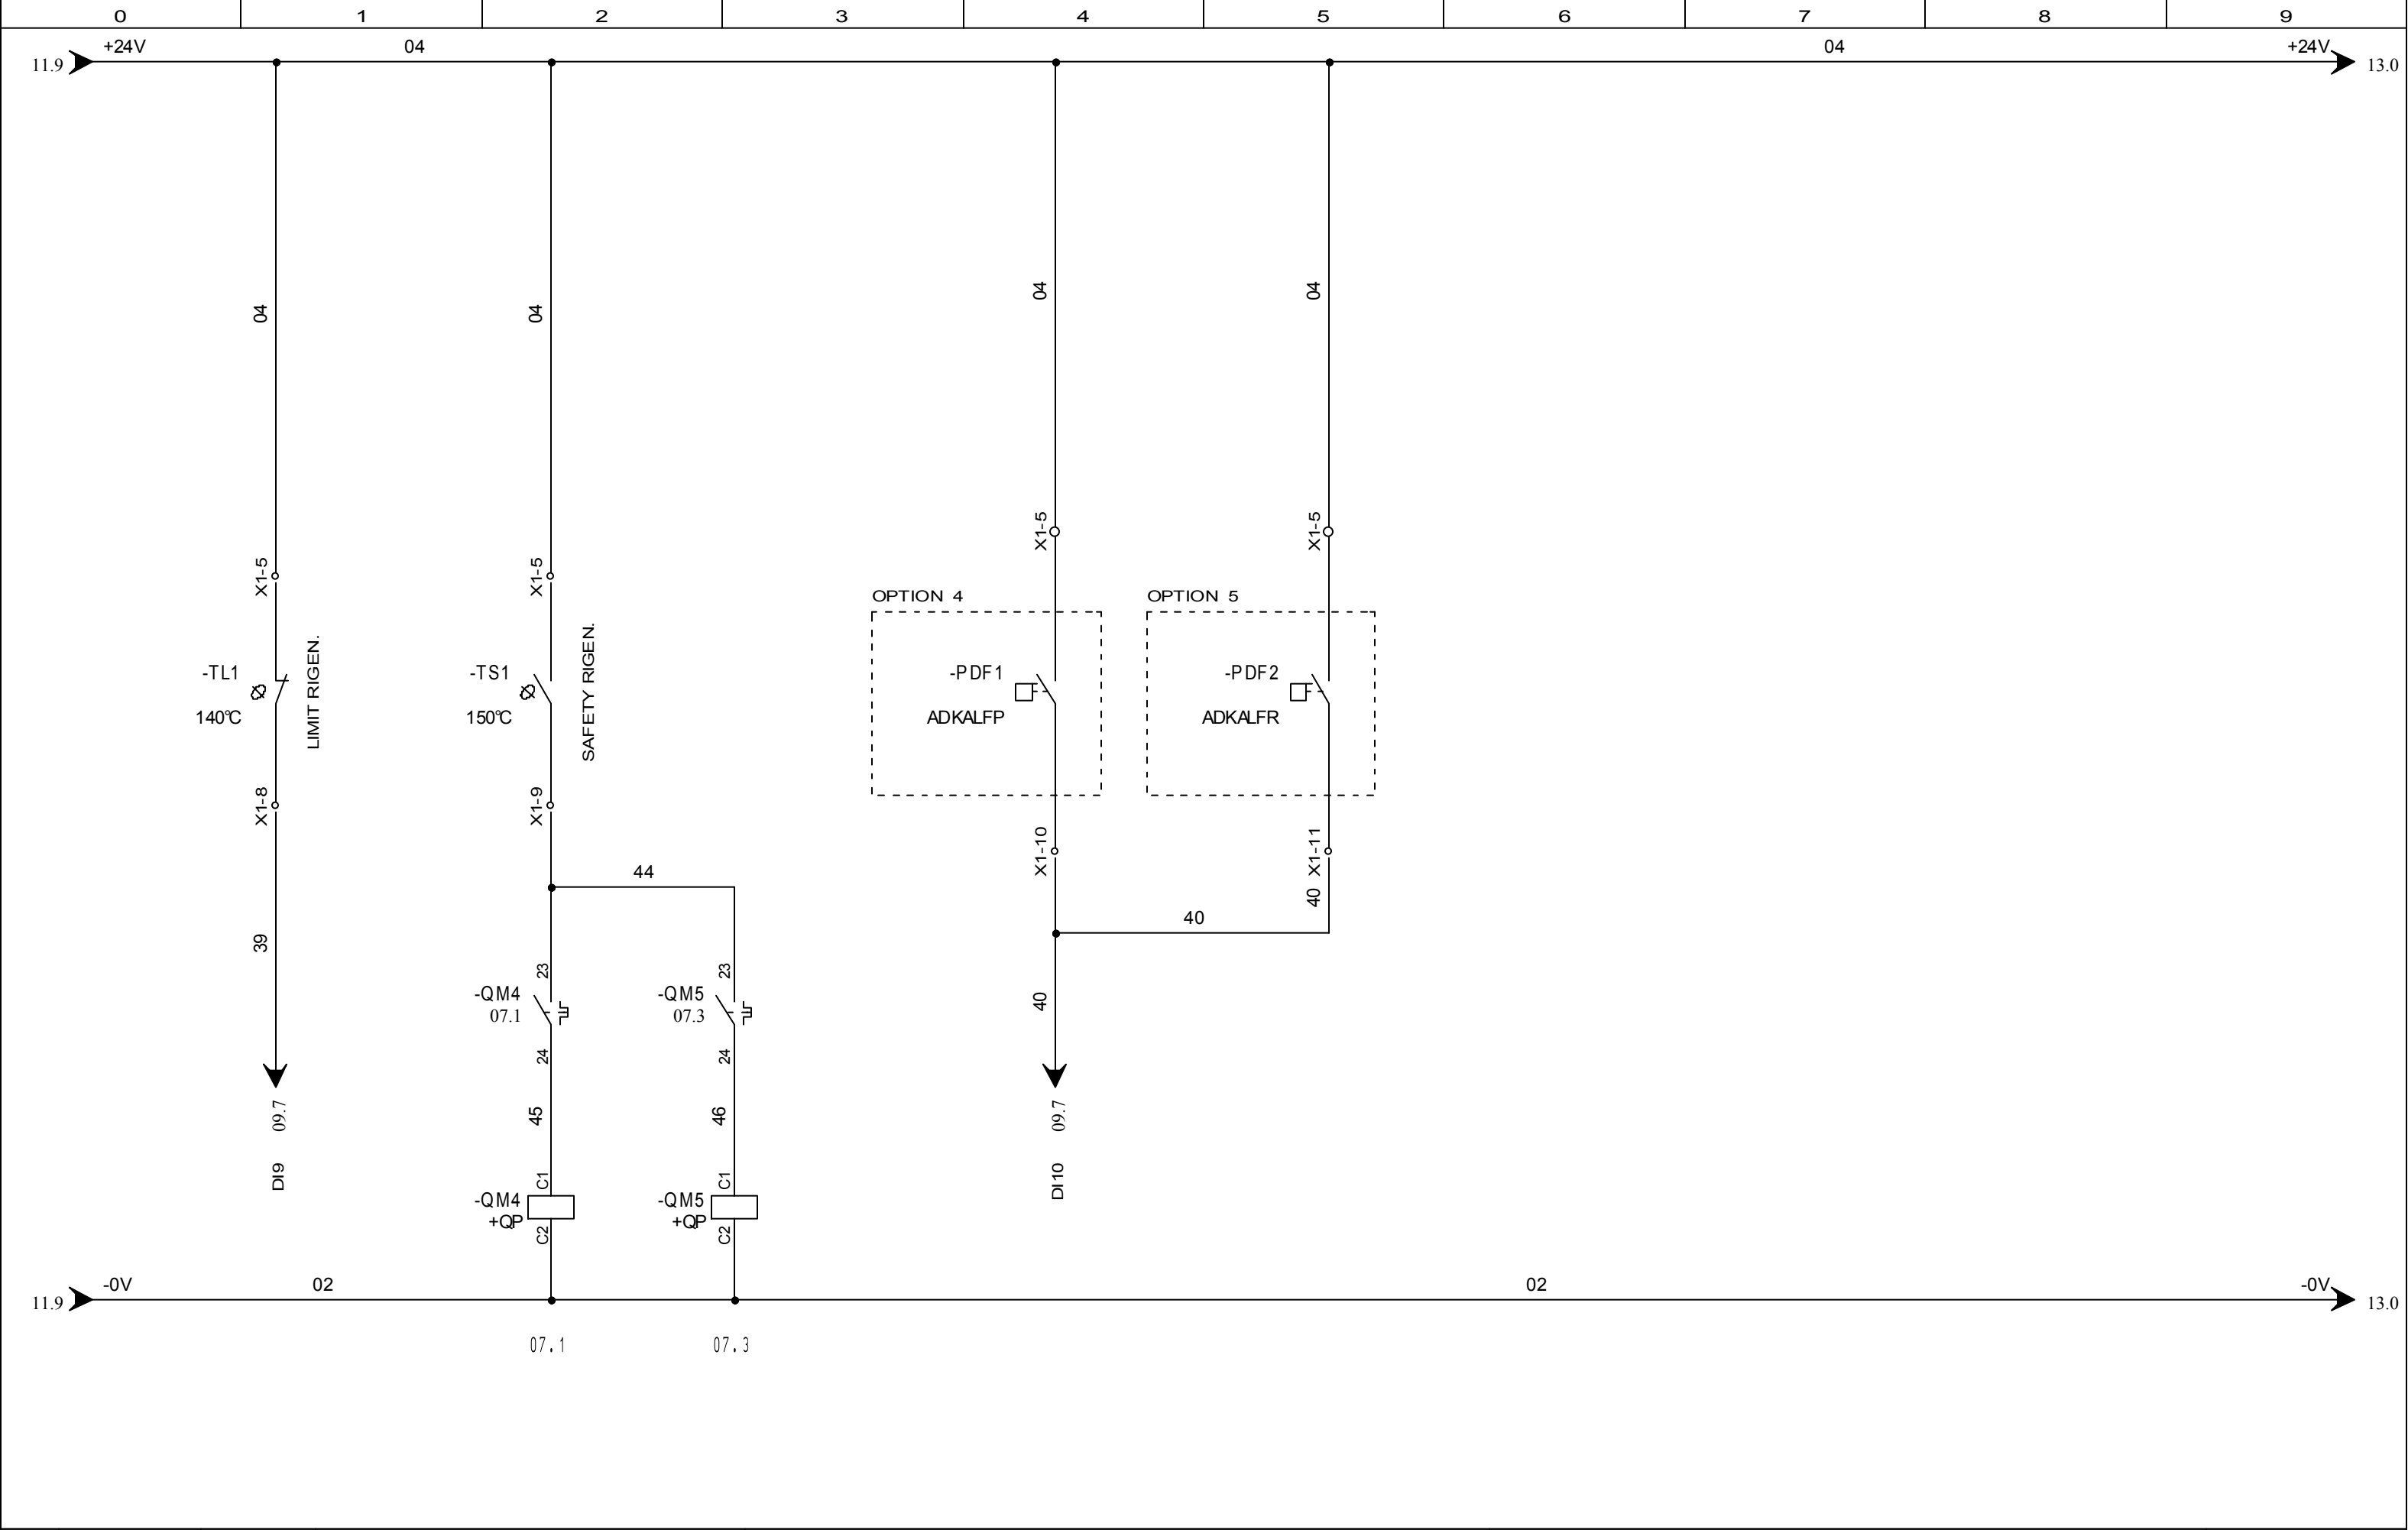

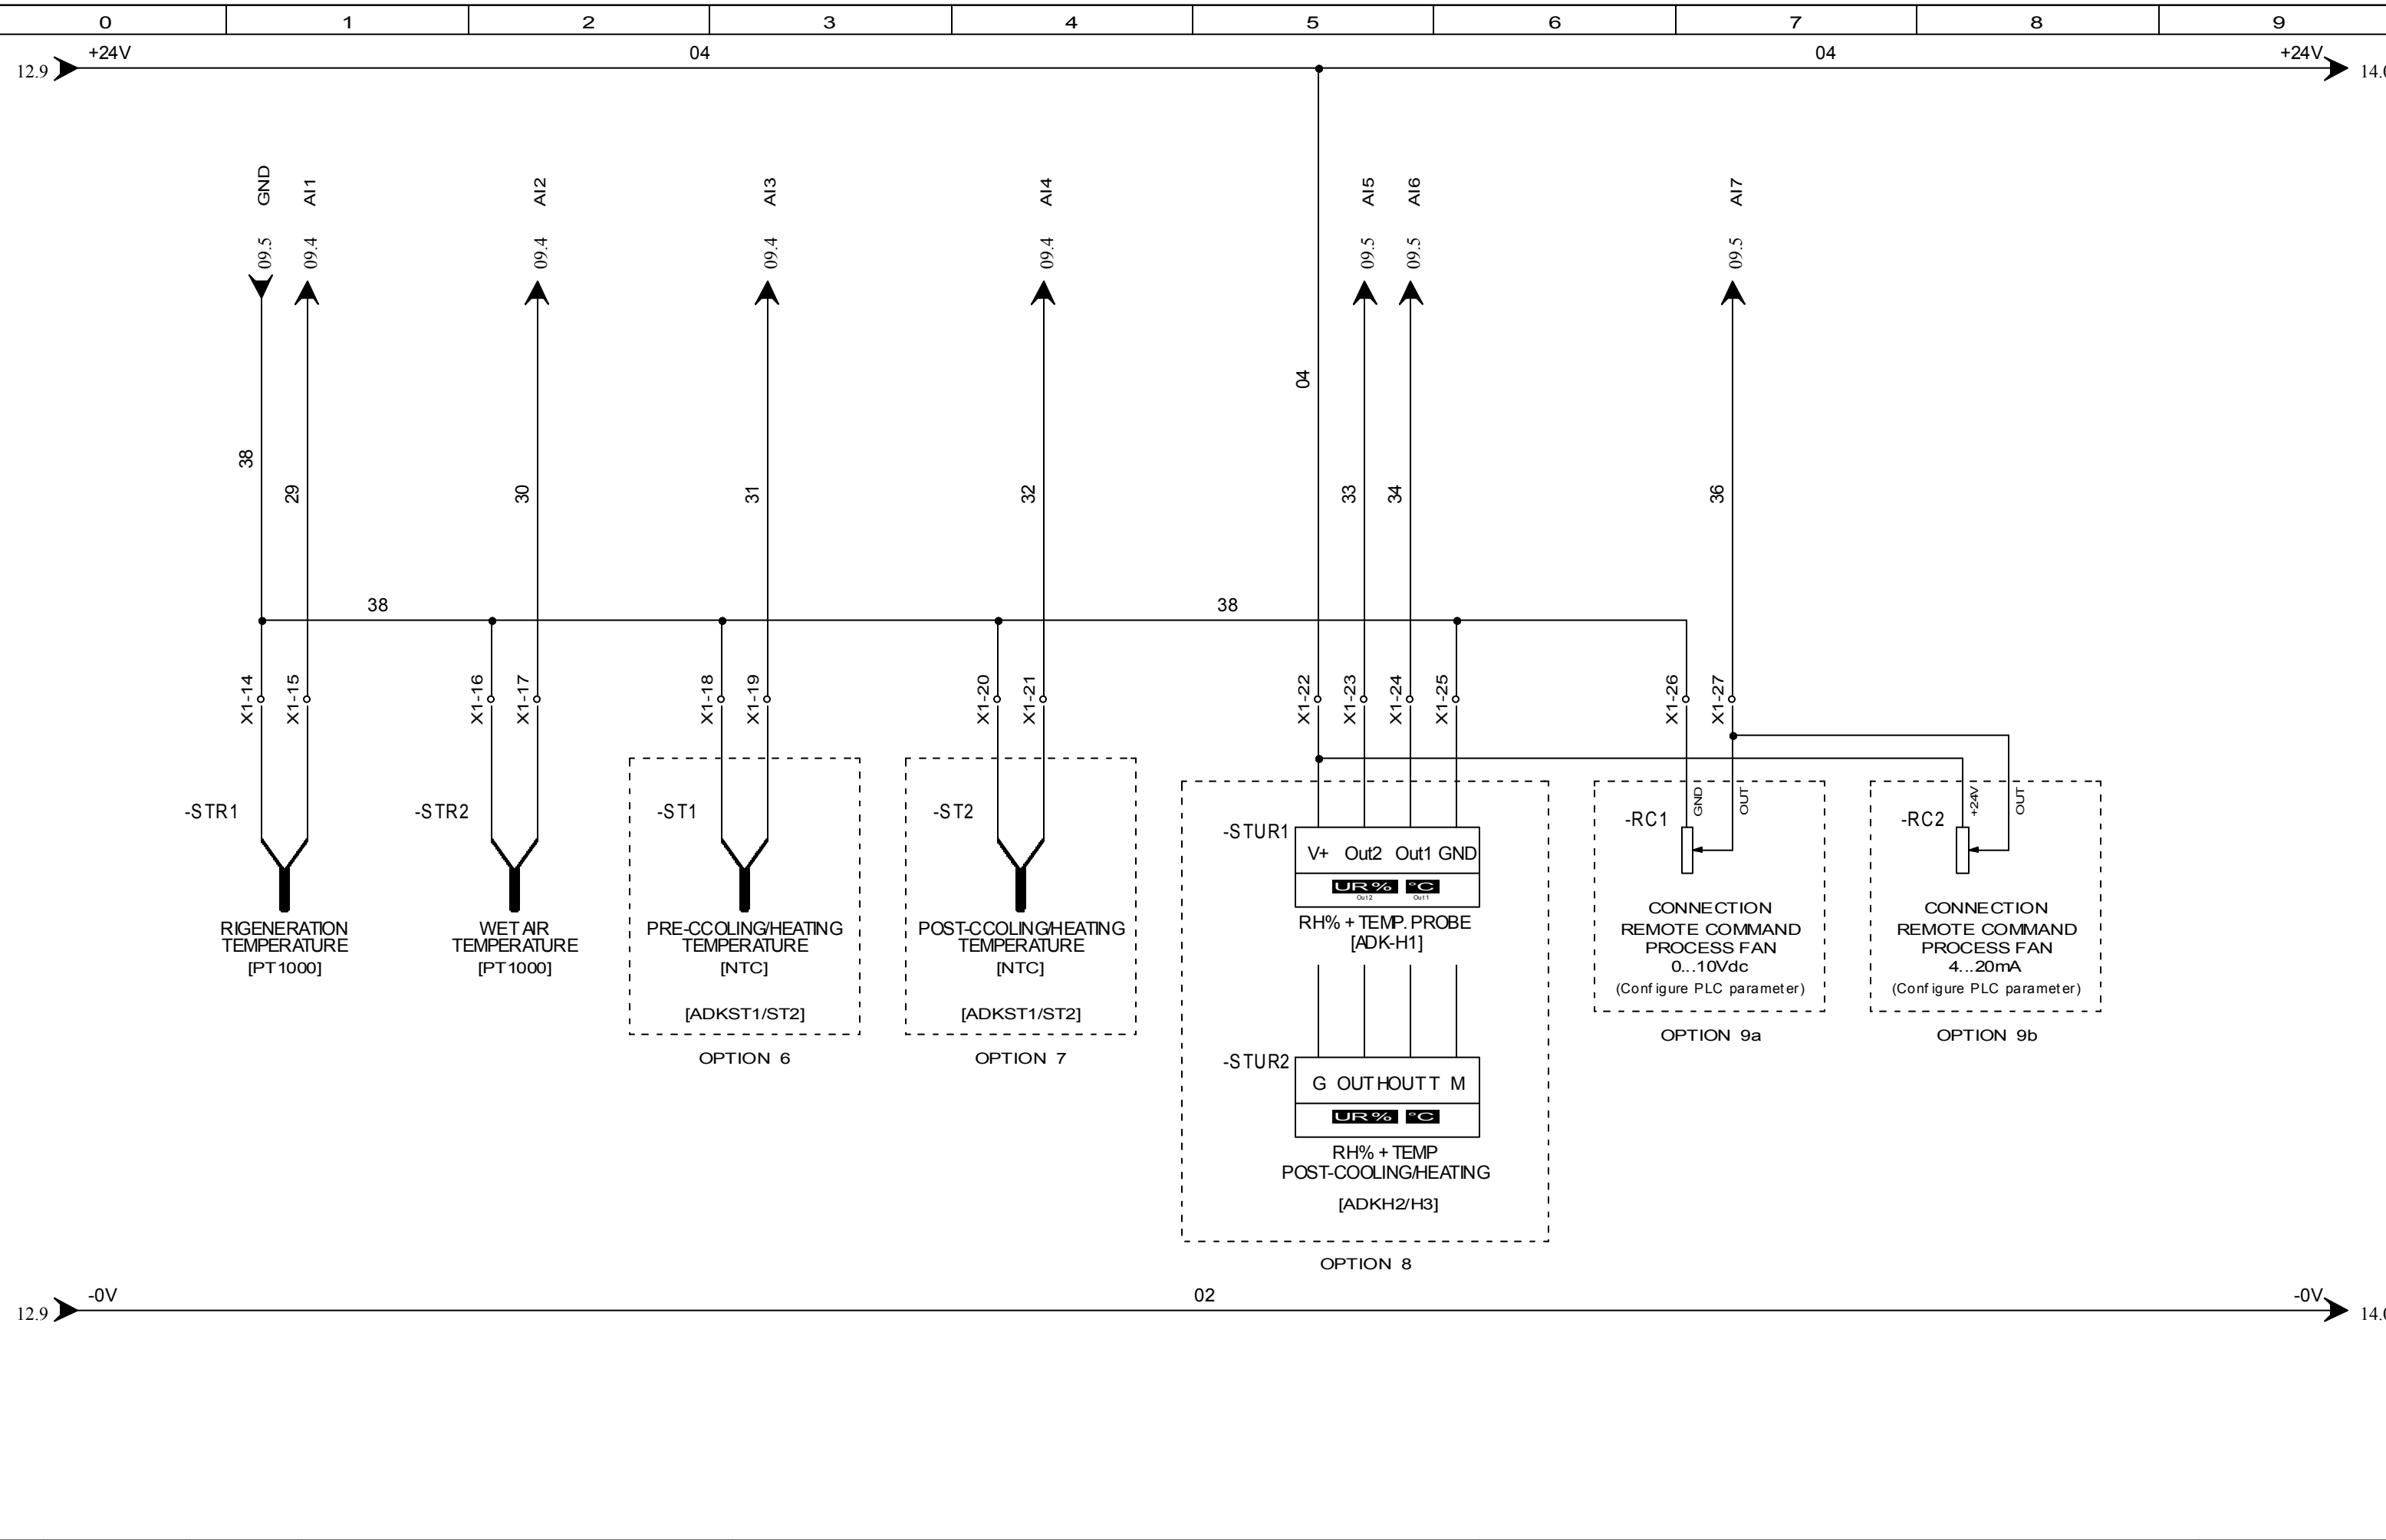

				 Via J.F.Kennedy, 25/27/29 - 56020 Capanne Z.I.Fontanelle	PROJECT: ADP3500E (Electrical Regen.)			SHEET 13
					CUSTOMER: -			
					COMMITTED:-			OF 19
					TITLE: Circuito Ausiliario			
								12◀▶14
REV.	DATE	SIGNAT.	CHANGE	DRA.: 01			DATE: 12/11/2018	

