

SAMSUNG

VRF

Technical Data Book

**DVM S Water for Europe
(R410A, 50/60Hz, HP/HR)**



Model : Premium energy efficiency Type
Premium compact type

History

Version	Modification	Date	Remark
Ver. 1.0	Release DVM S Water TDB	'14. 06. 17	
Ver. 1.1	Add Note information in Specification regarding EU F-Gas regulation.	'15. 06. 17	
Ver. 2.0	Update all contents	'16. 09. 12	
Ver. 2.1	Add tCO2e data (Specifications)	'16. 12. 09	
Ver. 3.0	Add New Model (30HP) & Premium compact type	'17. 02. 23	

Nomenclature

Outdoor units

Model name

AM	080	F	X	W	A	N	R	/	EU
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)		(Buyer)

(1) Classification

AM	DVM
----	-----

(5) Feature1

W	DVM WATER
---	-----------

(2) Capacity

x 1/10 HP (3 digits)

(6) Feature2

A	Standard + General Temp.+ Module
---	----------------------------------

(3) Version

F	2013
H	2014
J	2015
K	2016

(7) Rating Voltage

N	3Ø, 380~415V, 50/60Hz
G	3Ø, 380~415V, 50Hz

(4) Product Type

X	Outdoor Unit
N	Indoor Unit

(8) Mode

R	Heat Recovery
H	Heat Pump

Features & Benefits


More efficient, more eco-friendly

The DVM S WATER air conditioning system saves money and the environment, while providing a powerful performance. Its innovative Dual Inverter Compressor with a high efficiency Vapor Injection System ensures powerful, rapid cooling and heating with minimum energy consumption, so it's very eco-friendly. A Plate Heat Exchanger also improves the heat exchange efficiency and ensures stable cooling and heating performances.




Flexible installation almost anywhere

The DVM S WATER air conditioning system can be installed almost anywhere, regardless of its location or distance from the building. It has a maximum piping length of up to 170 meters (558 feet) between the outdoor and indoor units, while still ensuring complete reliability. It can also reach up to a height of 50 meters (164 feet), which is the equivalent of 10 stories.

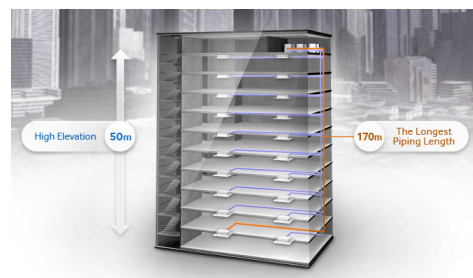


Lower installation costs, great capacity

The DVM S WATER air conditioning system is much more economical to install as it has a small footprint and lightweight design, but a large 30 horsepower (HP) capacity. So instead of installing two 10HP units you only need one 30HP Samsung unit – using 56% less space and significantly reducing the costs of valves, fittings and gauges. You can also combine up to three units to create a total capacity of 90HP.

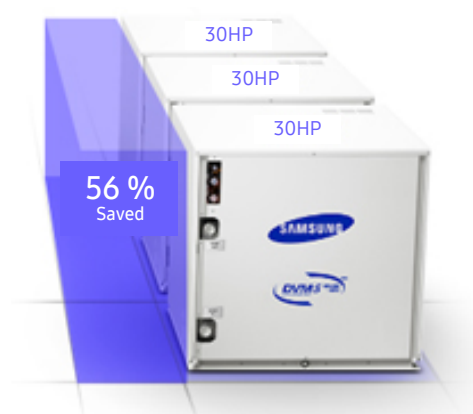

Independently cool and heat

With the DVM S WATER air conditioning system's optional Mode Control Unit (MCU) you can independently cool and heat different spaces at the same time. Instead of just heating or cooling all spaces at the same time, with the MCU each indoor unit can be operated separately, so you can simultaneously heat some rooms or areas of the building, while cooling others.

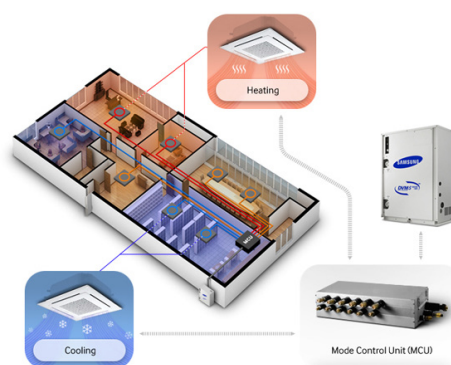

Contents

1. Line-up	6
2. Specification	10
3. Electric Characteristics	21
4. Dimensional Drawing	23
5. Center of Gravity	26
6. Electrical Wiring Diagram	28
7. Sound Level	30
8. Operating Range	34
9. Piping Diagram	37
10. Installation	40
11. Accessory	60

1. Line-up

1) Outdoor units combination Table

Premium energy efficiency type

System Model			Capacity (HP)			
Capa.(HP)	Model	No. of Modules	8	10	12	20
8	AM080FXWANR	1	1			
10	AM100FXWANR	1		1		
12	AM120FXWANR	1			1	
16	AM160FXWANR2	2	2			
18	AM180FXWANR2	2	1	1		
20	AM200FXWANR	1				1
22	AM220FXWANR2	2		1	1	
24	AM240FXWANR2	2			2	
26	AM260FXWANR2	3	2	1		
28	AM280FXWANR2	2	1			1
30	AM300FXWANR2	2		1		1
32	AM320FXWANR2	2			1	1
34	AM340FXWANR2	3		1	2	
36	AM360FXWANR2	3	2			1
38	AM380FXWANR2	3	1	1		1
40	AM400FXWANR2	2				2
42	AM420FXWANR2	3		1	1	1
44	AM440FXWANR2	3			2	1
48	AM480FXWANR2	3	1			2
50	AM500FXWANR2	3		1		2
52	AM520FXWANR2	3			1	2
60	AM600FXWANR2	3				3

1. Line-up

1) Outdoor units combination Table

Premium compact type

System Model			Capacity (HP)				
Capa.(HP)	Model	No. of Modules	8	10	12	20	30
30	AM300KXWANR	1					1
38	AM380KXWANR1	2	1				1
40	AM400KXWANR1	2		1			1
42	AM420KXWANR1	2			1		1
46	AM460KXWANR1	3	2				1
48	AM480KXWANR1	3	1	1			1
50	AM500KXWANR1	2				1	1
52	AM520KXWANR1	3		1	1		1
54	AM540KXWANR1	3			2		1
58	AM580KXWANR1	3	1			1	1
60	AM600KXWANR1	2					2
62	AM620KXWANR1	3			1	1	1
68	AM680KXWANR1	3	1				2
70	AM700KXWANR1	3		1			2
80	AM800KXWANR1	3				1	2
90	AM900KXWANR1	3					3

NOTE

- Make sure to use an indoor unit that is compatible with DVM S WATER-GEO.
- Indoor units can be connected within the range indicated in following table.
- If the total capacity of the connected indoor units exceeds the indicated maximum capacity, cooling and heating capacity of the indoor unit may decrease.
- Total capacity of the connected indoor units can be allowed from 50% to 130% of the total outdoor unit capacity.
 $0.5 \times \sum(\text{Outdoor unit capacity}) \leq \text{Total capacity of the connected indoor units} \leq 1.3 \times \sum(\text{Outdoor unit capacity})$
- You can connect maximum 64 indoor units to the outdoor unit. Maximum quantity of connectable indoor unit is set to 64 since outdoor unit only support up to 64 communication address. Indoor unit address can be assigned from 0~63. If the indoor unit address was assigned from 64~79, E201 error will occur.
- Minimum capacity of the indoor unit is 1.7 kW.
- Installation combination must be complied when composing outdoor unit combination.
- Sum of total amount of additional refrigerant and the basic amount of refrigerant should not exceed 100kg (220lb). If the refrigerant exceeds 100kg (220lb), separate the module so that the weight of the refrigerant doesn't exceed 100kg.

2) External appearance (outdoor unit)

Capacity (HP)	8	10	12	20	30
Type	HR / HP				
Model					

1. Line-up

3) Indoor units

Model	Capacity (kW)								
	1.7	2.2	2.8	3.6	4.5	5.6	6.0	7.1	9.0
Slim 1way cassette (JSF)									
2way cassette									
Global 4way cassette									
4way CST (600 X 600)									
360 CST									
Floor Standing Unit									
Slim duct									
MSP duct									
HSP duct									
Ceiling									
Console									
Neo forte									
Neo forte (with EEV)									
Hydro unit / HE									
Hydro unit / HT									
ERV plus									

1. Line-up

3) Indoor units

Model	Capacity (kW)							
	11.2	12.8	14.0	22.0	28.0	44.8	500CMH	1000CMH
Slim 1way cassette(JSF)								
2way cassette								
Global 4way cassette								
4way CST (600 X 600)								
360 CST								
Floor Standing Unit								
Slim duct								
MSP duct								
HSP duct								
Ceiling								
Console								
Neo forte								
Neo forte (with EEV)								
Hydro unit / HE								
Hydro unit / HT								
ERV plus								

2. Specification

Premium Energy Efficiency

Type				DVM S Water	DVM S Water	DVM S Water	DVM S Water	
Model Name	Outdoor unit module 1			AM080FXWANR	AM100FXWANR	AM120FXWANR	AM160FXWANR2	
	Outdoor unit module 2			AM080FXWANR	AM100FXWANR	AM120FXWANR	AM080FXWANR	
	Outdoor unit module 3						AM080FXWANR	
	Outdoor unit module 4							
Power Supply				Ø, #, V, Hz	3,4,380-415,50/60	3,4,380-415,50/60	3,4,380-415,50/60	
Mode				-	HEAT RECOVERY	HEAT RECOVERY	HEAT RECOVERY	
Performance	HP			HP	8	10	12	
	Ton			Ton	6.37	7.96	9.55	
	Capacity (Nominal)	Cooling	kW	22.4	28.0	33.6	44.8	
			Btu/h	76,400	95,500	114,600	152,900	
		Heating ²⁾	kW	25.2	31.5	37.8	50.4	
			Btu/h	86,000	107,500	129,000	172,000	
		Heating ⁴⁾	kW	21.64	25.75	31.1	-	
Btu/h			73,700	88,000	106,500	-		
Maximum number of connectable indoor units	Total capacity of the connected Indoor Units 3)	Min.	ea	14	18	22	29	
		Max.	kW	11.2	14.0	16.8	22.4	
			kW	29.1	36.4	43.7	58.2	
Power	Power Input (Nominal)	Cooling ¹⁾	kW	3.84	5.05	6.46	7.68	
		Heating ²⁾		4.12	5.25	6.51	8.24	
		Heating ⁴⁾		4.65	5.70	7.05	-	
	Current Input (Nominal)	Cooling ¹⁾	A	6.2	8.1	10.3	12.4	
		Heating ²⁾		6.6	8.4	10.4	13.2	
	Current	Minimum Ssc value	MVA	3.9	3.9	4.8	7.8	
		MCA	A	16.1	16.1	20.0	31.8	
		MFA	A	20.0	20.0	25.0	40.0	
COP	Nominal Cooling ¹⁾		W/W	5.83	5.54	5.20	5.83	
	Nominal Heating ²⁾		W/W	6.12	6.00	5.81	6.12	
	Nominal Heating ⁴⁾		W/W	4.65	4.52	4.41	-	
Casing	Material	Cabinet	-	EGI steel plate	EGI steel plate	EGI steel plate	EGI steel plate	
		Base	-	EGI steel plate	EGI steel plate	EGI steel plate	EGI steel plate	
Compressor	Type		-	Inverter Scroll	Inverter Scroll	Inverter Scroll	Inverter Scroll	
	Output		kW × n	(4.96) × 1	(4.96) × 1	(6.13) × 1	(4.96) × 2	
	Model Name		-	DS-GB052FAVB SG x 1	DS-GB052FAVB SG x 1	DS-GB052FAVB SG x 1	DS-GB052FAVB SG x 2	
	Oil	Type	-	PVE	PVE	PVE	PVE	
Initial Charge		Liter	3.9	3.9	3.9	3.9 × 2		
Condenser	Type		Type	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)	
	Pipe Size		Ø, inch	PT 1-1/4	PT 1-1/4	PT 1-1/4	PT 1-1/4 × 2	
	Pressure Drop		kPa	22.0	30.0	43.0	22.0 × 2	
	Water Flow Rate		LPM	80.0	96.0	114.0	80.0 × 2	
	Max. Pressure		Mpa	1.96	1.96	1.96	1.96	
Piping Connections	Liquid Pipe	Type		Type	Braze connection	Braze connection	Braze connection	
		Ø, mm		9.52	9.52	12.7	12.7	
		Ø, inch		3/8"	3/8"	1/2"	1/2"	
	Gas Pipe	Type		Type	Braze connection	Braze connection	Braze connection	
		Ø, mm		19.05	22.22	28.58	28.58	
		Ø, inch		3/4"	7/8"	1 1/8"	1 1/8"	
	Discharge Gas Pipe		Ø, mm	15.88	19.05	19.05	22.22	
			Ø, inch	5/8"	3/4"	3/4"	7/8"	
	Heat insulation		-	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes	
	Piping length	ODU-IDU	Max.	m	170 (190)	170 (190)	170 (190)	170 (190)
		After branch	Max.	m	90	90	90	90
	Total piping length	System	Actual	m	500	500	500	500
Level difference	ODU-IDU	Outdoor unit in highest position	m	50	50	50	50	
		Indoor unit in highest position	m	40	40	40	40	
Wiring connections	Communication	IDU-IDU	Max.	m	50	50	50	
		Minimum	mm²	0.75	0.75	0.75	0.75	
		Remark	-	F1, F2	F1, F2	F1, F2	F1, F2	
Refrigerant	Type		-	R410A	R410A	R410A	R410A	
	Factory Charging		kg/tCO ₂ e	5.5/11.48	5.8/12.11	6.0/12.53	11.0/22.97	
Sound ³⁾	Sound Pressure	Cooling	dB(A)	48	48	50	51	
		Heating		51	51	52	54	
	Sound Power			70	70	70	73	
External Dimension	Net Weight		kg	160	160	160	160 × 2	
	Shipping Weight		kg	167	167	167	167 × 2	
	Net Dimensions (WxHxD)		mm	770 × 1,000 × 545	770 × 1,000 × 545	770 × 1,000 × 545	(770 × 1,000 × 545) × 2	
	Shipping Dimensions (WxHxD)		mm	840 × 1,200 × 620	840 × 1,200 × 620	840 × 1,200 × 620	(840 × 1,200 × 620) × 2	
Operating Temp. Range	Cooling		°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	
	Heating		°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	

2. Specification

Premium Energy Efficiency

Type				DVM S Water	DVM S Water	DVM S Water	DVM S Water	
Model Name	Outdoor unit module 1			AM180FXWANR2	AM200FXWANR	AM220FXWANR2	AM240FXWANR2	
	Outdoor unit module 2			AM080FXWANR	AM200FXWANR	AM100FXWANR	AM120FXWANR	
	Outdoor unit module 3			AM100FXWANR		AM120FXWANR	AM120FXWANR	
	Outdoor unit module 4							
Power Supply				Ø, #, V, Hz	3,4,380-415,50/60	3,4,380-415,50/60	3,4,380-415,50/60	
Mode				-	HEAT RECOVERY	HEAT RECOVERY	HEAT RECOVERY	
Performance	HP		HP	18	20	22	24	
	Ton		Ton	14.33	15.92	17.52	19.11	
	Capacity (Nominal)	Cooling	kW	50.4	56.0	61.6	67.2	
			Btu/h	172,000	191,100	210,200	229,300	
		Heating ²⁾	kW	56.7	63.0	69.3	75.6	
			Btu/h	193,500	215,000	236,500.0	258,000	
		Heating ⁴⁾	kW	-	-	-	-	
			Btu/h	-	-	-	-	
Maximum number of connectable indoor units			ea	32	36	40	44	
	Total capacity of the connected Indoor Units 3)	Min.	kW	25.2	28.0	30.8	33.6	
		Max.	kW	65.5	72.8	80.1	87.4	
Power	Power Input (Nominal)	Cooling ¹⁾	kW	8.89	10.77	11.51	12.02	
		Heating ²⁾		9.37	10.86	11.76	13.02	
		Heating ⁴⁾		-	-	-	-	
	Current Input (Nominal)	Cooling ¹⁾	A	14.3	17.3	18.4	20.6	
		Heating ²⁾		15.0	17.4	18.8	20.8	
	Current	Minimum Ssc value	MVA	7.8	7.7	8.7	9.6	
		MCA	A	32.2	32.2	36.1	40.0	
		MFA	A	40.0	40.0	40.0	50.0	
COP	Nominal Cooling ¹⁾		W/W	5.67	5.20	5.35	5.20	
	Nominal Heating ²⁾		W/W	6.05	5.80	5.89	5.81	
	Nominal Heating ⁴⁾		W/W	-	-	-	-	
Casing	Material	Cabinet	-	EGI steel plate	EGI steel plate	EGI steel plate	EGI steel plate	
		Base	-	EGI steel plate	EGI steel plate	EGI steel plate	EGI steel plate	
Compressor	Type		-	Inverter Scroll	Inverter Scroll	Inverter Scroll	Inverter Scroll	
	Output		kW × n	(4.96) × 2	(4.96) × 2	(4.96) × 1 + (6.13) × 1	(6.13) × 2	
	Model Name		-	DS-GB052FAVBSG × 2	DS-GB052FAVBSG × 2	DS-GB052FAVBSG × 1 + DS-GB066FAVBSG × 1	DS-GB066FAVBSG × 2	
	Oil	Type	-	PVE	PVE	PVE	PVE	
		Initial Charge	Liter	3.9 × 2	6.2	3.9 × 2	3.9 × 2	
Condenser	Type		Type	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)	
	Pipe Size		Ø, inch	PT 1-1/4 × 2	PT 1-1/4	PT 1-1/4 × 2	PT 1-1/4 × 2	
	Pressure Drop		kPa	22.0 + 30.0	54.0	30.0 + 43.0	43.0 × 2	
	Water Flow Rate		LPM	80.0 + 96.0	190.0	96.0 + 114.0	114.0 × 2	
	Max. Pressure		Mpa	1.96	1.96	1.96	1.96	
Piping Connections	Liquid Pipe		Type	Braze connection	Braze connection	Braze connection	Braze connection	
			Ø, mm	15.88	15.88	15.88	15.88	
			Ø, inch	5/8"	5/8"	5/8"	5/8"	
	Gas Pipe		Type	Braze connection	Braze connection	Braze connection	Braze connection	
			Ø, mm	28.58	28.58	28.58	28.58	
			Ø, inch	1 1/8"	1 1/8"	1 1/8"	1 1/8"	
	Discharge Gas Pipe		Ø, mm	22.22	28.58	28.58	28.58	
			Ø, inch	7/8"	1 1/8"	1 1/8"	1 1/8"	
	Heat insulation		-	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes	
	Piping length	ODU-IDU	Max.	m	170 (190)	170 (190)	170 (190)	170 (190)
		After branch	Max.	m	90	90	90	90
	Total piping length	System	Actual	m	500	500	500	500
		Level difference	ODU-IDU	Outdoor unit in highest position	m	50	50	50
	Indoor unit in highest position		m	40	40	40	40	
Wiring connections	Communication	IDU-IDU	Max.	m	50	50	50	
		Minimum	mm²	0.75	0.75	0.75	0.75	
		Remark	-	F1, F2	F1, F2	F1, F2	F1, F2	
Refrigerant	Type		-	R410A	R410A	R410A	R410A	
	Factory Charging		kg/tCO ₂ e	11.3/23.59	9.8/20.46	11.8/24.64	12.0/25.06	
Sound ³⁾	Sound Pressure	Cooling	dB(A)	51	51	52	53	
		Heating		54	52	55	55	
	Sound Power			73	73	73	73	
External Dimension	Net Weight		kg	160 × 2	240	160 × 2	160 × 2	
	Shipping Weight		kg	167 × 2	250	167 × 2	167 × 2	
	Net Dimensions (WxHxD)		mm	(770 × 1,000 × 545) × 2	1,100 × 1,000 × 545	(770 × 1,000 × 545) × 2	(770 × 1,000 × 545) × 2	
	Shipping Dimensions (WxHxD)		mm	(840 × 1,200 × 620) × 2	1,170 × 1,200 × 620	(840 × 1,200 × 620) × 2	(840 × 1,200 × 620) × 2	
Operating Temp. Range	Cooling		°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	
	Heating		°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	

2. Specification

Premium Energy Efficiency

Type				DVM S Water	DVM S Water	DVM S Water	DVM S Water		
Model Name	Outdoor unit module 1			AM260FXWANR2	AM280FXWANR2	AM300FXWANR2	AM320FXWANR2		
	Outdoor unit module 2			AM080FXWANR	AM080FXWANR	AM100FXWANR	AM120FXWANR		
	Outdoor unit module 3			AM080FXWANR	AM200FXWANR	AM200FXWANR	AM200FXWANR		
	Outdoor unit module 4								
Power Supply				Ø, #, V, Hz	3,4,380-415,50/60	3,4,380-415,50/60	3,4,380-415,50/60	3,4,380-415,50/60	
Mode				-	HEAT RECOVERY	HEAT RECOVERY	HEAT RECOVERY	HEAT RECOVERY	
Performance	HP			HP	26	28	30	32	
	Ton			Ton	20.70	22.29	23.88	25.48	
	Capacity (Nominal)	Cooling		kW	72.8	78.4	84.0	89.6	
				Btu/h	248,400	267,500	286,600	305,700	
		Heating ²⁾		kW	81.9	88.2	94.5	100.8	
				Btu/h	279,500	301,000	322,400	343,900	
		Heating ⁴⁾		kW	-	-	-	-	
			Btu/h	-	-	-	-		
Maximum number of connectable indoor units				ea	47	51	55	58	
Power	Total capacity of the connected Indoor Units 3)	Min.		kW	36.4	39.2	42.0	44.8	
		Max.		kW	94.6	101.9	109.2	116.5	
	Power Input (Nominal)	Cooling ¹⁾			12.73	14.61	15.82	17.23	
		Heating ²⁾		kW	13.49	14.98	16.11	17.37	
		Heating ⁴⁾			-	-	-	-	
	Current Input (Nominal)	Cooling ¹⁾		A	20.5	23.5	25.4	27.6	
		Heating ²⁾		A	21.6	24.0	25.8	27.8	
	Current	Minimum Ssc value		MVA	11.7	11.6	11.6	12.5	
		MCA		A	48.3	47.9	47.9	51.8	
		MFA		A	63.0	63.0	63.0	63.0	
	COP	Nominal Cooling ¹⁾			W/W	5.72	5.37	5.31	5.20
		Nominal Heating ²⁾			W/W	6.07	5.89	5.87	5.80
Nominal Heating ⁴⁾			W/W	-	-	-	-		
Casing	Material	Cabinet		-	EGl steel plate	EGl steel plate	EGl steel plate	EGl steel plate	
		Base		-	EGl steel plate	EGl steel plate	EGl steel plate	EGl steel plate	
Compressor	Type			-	Inverter Scroll	Inverter Scroll	Inverter Scroll	Inverter Scroll	
	Output			kW × n	(4.96) x 3	(4.96) x 3	(4.96) x 3	(4.96) x 2 + (6.13) x 1	
	Model Name			-	DS-GB052FAVBGS x 3	DS-GB052FAVBGS x 3	DS-GB052FAVBGS x 3	DS-GB066FAVBGS x 1 + DS-GB052FAVBGS x 2	
	Oil	Type		-	PVE	PVE	PVE	PVE	
Initial Charge			Liter	3.9 x 3	3.9+6.2	3.9+6.2	3.9+6.2		
Condenser	Type			Type	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)	
	Pipe Size			Ø, inch	PT 1-1/4 x 3	PT 1-1/4 x 2	PT 1-1/4 x 2	PT 1-1/4 x 2	
	Pressure Drop			kPa	22.0 x 2 + 30.0	22.0 + 54.0	30.0 +54.0	43.0 + 54.0	
	Water Flow Rate			LPM	80.0 x 2 + 96.0	80.0 + 190.0	96.0 + 190.0	114.0 + 190.0	
	Max. Pressure			Mpa	1.96	1.96	1.96	1.96	
Piping Connections	Liquid Pipe			Type	Braze connection	Braze connection	Braze connection	Braze connection	
				Ø, mm	19.05	19.05	19.05	19.05	
				Ø, inch	3/4"	3/4"	3/4"	3/4"	
	Gas Pipe			Type	Braze connection	Braze connection	Braze connection	Braze connection	
				Ø, mm	34.92	34.92	34.92	34.92	
				Ø, inch	1 3/8"	1 3/8"	1 3/8"	1 3/8"	
	Discharge Gas Pipe			Ø, mm	28.58	28.58	28.58	28.58	
				Ø, inch	1 1/8"	1 1/8"	1 1/8"	1 1/8"	
	Heat insulation				-	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes
	Piping length	ODU-IDU	Max.		m	170 (190)	170 (190)	170 (190)	170 (190)
		After branch	Max.		m	90	90	90	90
	Total piping length	System	Actual		m	500	500	500	500
Level difference	ODU-IDU	Outdoor unit in highest position		m	50	50	50	50	
		Indoor unit in highest position		m	40	40	40	40	
	IDU-IDU	Max.		m	50	50	50	50	
Wiring connections	Communication	Minimum		mm²	0.75	0.75	0.75	0.75	
		Remark		-	F1, F2	F1, F2	F1, F2	F1, F2	
Refrigerant	Type			-	R410A	R410A	R410A	R410A	
	Factory Charging			kg/tCO ₂ e	16.8/35.08	15.3/31.95	15.6/32.57	15.8/32.99	
Sound ³⁾	Sound Pressure	Cooling		dB(A)	53	53	53	54	
		Heating			56	55	55	55	
	Sound Power					75	75	75	75
External Dimension	Net Weight			kg	160 x 3	160 + 240	160 + 240	160 + 240	
	Shipping Weight			kg	167 x 3	167 + 250	167 + 250	167 + 250	
	Net Dimensions (WxHxD)			mm	(770 x 1,000 x 545) x 3	770 x 1,000 x 545 + 1,100 x 1,000 x 545	770 x 1,000 x 545 + 1,100 x 1,000 x 545	770 x 1,000 x 545 + 1,100 x 1,000 x 545	
	Shipping Dimensions (WxHxD)			mm	(840 x 1,200 x 620) x 3	840 x 1,200 x 620 + 1,170 x 1,200 x 620	840 x 1,200 x 620 + 1,170 x 1,200 x 620	840 x 1,200 x 620 + 1,170 x 1,200 x 620	
Operating Temp. Range	Cooling			°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	
	Heating			°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	

2. Specification

Premium Energy Efficiency

Type				DVM S Water	DVM S Water	DVM S Water	DVM S Water		
Model Name	Outdoor unit module 1			AM340FXWANR2	AM360FXWANR2	AM380FXWANR2	AM400FXWANR2		
	Outdoor unit module 2			AM100FXWANR	AM080FXWANR	AM080FXWANR	AM200FXWANR		
	Outdoor unit module 3			AM120FXWANR	AM080FXWANR	AM100FXWANR	AM200FXWANR		
	Outdoor unit module 4								
Power Supply				Ø, #, V, Hz	3,4,380-415,50/60	3,4,380-415,50/60	3,4,380-415,50/60		
Mode				-	HEAT RECOVERY	HEAT RECOVERY	HEAT RECOVERY		
Performance	HP			HP	34	36	38	40	
	Ton			Ton	27.07	28.66	30.26	31.85	
	Capacity (Nominal)	Cooling		kW	95.2	100.8	106.4	112.0	
				Btu/h	324,800	343,900	363,100	382,200	
		Heating ²⁾		kW	107.1	113.4	119.7	126.0	
				Btu/h	365,400	386,900	408,400	429,900	
		Heating ⁴⁾		kW	-	-	-	-	
			Btu/h	-	-	-	-		
Maximum number of connectable indoor units			ea	62	64	64	64		
	Total capacity of the connected Indoor Units 3)	Min.	kW	47.6	50.4	53.2	56.0		
		Max.	kW	123.8	131.0	138.3	145.6		
Power	Power Input (Nominal)	Cooling ¹⁾	kW	17.97	18.45	19.66	21.54		
		Heating ²⁾		18.27	19.10	20.23	21.72		
		Heating ⁴⁾		-	-	-	-		
	Current Input (Nominal)	Cooling ¹⁾	A	28.7	29.7	31.6	34.6		
		Heating ²⁾		29.2	30.6	32.4	34.6		
	Current	Minimum Ssc value	MVA	13.5	15.5	15.5	15.4		
		MCA	A	56.1	64.0	64.0	63.6		
MFA		A	63.0	75.0	75.0	75.0			
COP	Nominal Cooling ¹⁾		W/W	5.30	5.46	5.41	5.20		
	Nominal Heating ²⁾		W/W	5.86	5.94	5.92	5.80		
	Nominal Heating ⁴⁾		W/W	-	-	-	-		
Casing	Material	Cabinet	-	EGI steel plate	EGI steel plate	EGI steel plate	EGI steel plate		
		Base	-	EGI steel plate	EGI steel plate	EGI steel plate	EGI steel plate		
Compressor	Type		-	Inverter Scroll	Inverter Scroll	Inverter Scroll	Inverter Scroll		
	Output		kW × n	(4.96) × 1 + (6.13) × 2	(4.96) × 4	(4.96) × 4	(4.96) × 4		
	Model Name		-	DS-GB052FAVB SG × 1 + DS-GB066FAVB SG × 2	DS-GB052FAVB SG × 4	DS-GB052FAVB SG × 4	DS-GB052FAVB SG × 4		
	Oil	Type	-	PVE	PVE	PVE	PVE		
Condenser	Initial Charge		Liter	3.9 × 3	(3.9 × 2)+6.2	(3.9 × 2)+6.2	(3.9 × 2)+6.2		
	Type		Type	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)		
	Pipe Size		Ø, inch	PT 1-1/4 × 3	PT 1-1/4 × 3	PT 1-1/4 × 3	PT 1-1/4 × 2		
	Pressure Drop		kPa	30.0 + 43.0 × 2	22.0 × 2 + 54.0	22.0 + 30.0 + 54.0	54.0 × 2		
	Water Flow Rate		LPM	96.0 + 114.0 × 2	80.0 × 2 + 190.0	80.0 + 96.0 + 190.0	190.0 × 2		
	Max. Pressure		Mpa	1.96	1.96	1.96	1.96		
Piping Connections	Liquid Pipe			Type	Braze connection	Braze connection	Braze connection	Braze connection	
				Ø, mm	19.05	19.05	19.05	19.05	
				Ø, inch	3/4"	3/4"	3/4"	3/4"	
	Gas Pipe			Type	Braze connection	Braze connection	Braze connection	Braze connection	
				Ø, mm	34.92	41.28	41.28	41.28	
				Ø, inch	1 3/8"	1 5/8"	1 5/8"	1 5/8"	
	Discharge Gas Pipe			Ø, mm	28.58	34.92	34.92	34.92	
				Ø, inch	1 1/8"	1 3/8"	1 3/8"	1 3/8"	
	Heat insulation				-	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes
	Piping length	ODU-IDU	Max.	m	170 (190)	170 (190)	170 (190)	170 (190)	
		After branch	Max.	m	90	90	90	90	
	Total piping length	System	Actual	m	500	500	500	500	
Level difference	ODU-IDU	Outdoor unit in highest position	m	50	50	50	50		
		Indoor unit in highest position	m	40	40	40	40		
	IDU-IDU	Max.	m	50	50	50	50		
Wiring connections	Communication	Minimum	mm²	0.75	0.75	0.75	0.75		
		Remark	-	F1, F2	F1, F2	F1, F2	F1, F2		
Refrigerant	Type		-	R410A	R410A	R410A	R410A		
	Factory Charging		kg/tCO ₂ e	17.8/37.17	20.8/43.43	21.1/44.06	19.6/40.92		
Sound ³⁾	Sound Pressure	Cooling	dB(A)	54	54	54	54		
		Heating		56	56	56	55		
	Sound Power			75	76	76	76		
External Dimension	Net Weight		kg	160 × 3	160 × 2 + 240	160 × 2 + 240	240 × 2		
	Shipping Weight		kg	167 × 3	167 × 2 + 250	167 × 2 + 250	250 × 2		
	Net Dimensions (WxHxD)		mm	(770 × 1,000 × 545) × 3	(770 × 1,000 × 545) × 2 + 1,100 × 1,000 × 545	(770 × 1,000 × 545) × 2 + 1,100 × 1,000 × 545	(1,100 × 1,000 × 545) × 2		
	Shipping Dimensions (WxHxD)		mm	(840 × 1,200 × 620) × 3	(840 × 1,200 × 620) × 2 + 1,170 × 1,200 × 620	(840 × 1,200 × 620) × 2 + 1,170 × 1,200 × 620	(1,170 × 1,200 × 620) × 2		
Operating Temp. Range	Cooling		°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0		
	Heating		°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0		

2. Specification

Premium Energy Efficiency

Type				DVM S Water	DVM S Water	DVM S Water	DVM S Water	
Model Name	Outdoor unit module 1			AM420FXWANR2	AM440FXWANR2	AM480FXWANR2	AM500FXWANR2	
	Outdoor unit module 2			AM100FXWANR	AM120FXWANR	AM080FXWANR	AM100FXWANR	
	Outdoor unit module 3			AM120FXWANR	AM120FXWANR	AM200FXWANR	AM200FXWANR	
	Outdoor unit module 4			AM200FXWANR	AM200FXWANR	AM200FXWANR	AM200FXWANR	
Power Supply				Ø, #, V, Hz	3,4,380-415,50/60	3,4,380-415,50/60	3,4,380-415,50/60	3,4,380-415,50/60
Mode				-	HEAT RECOVERY	HEAT RECOVERY	HEAT RECOVERY	HEAT RECOVERY
Performance	HP			HP	42	44	48	50
	Ton			Ton	33.44	35.03	38.22	39.81
	Capacity (Nominal)	Cooling		kW	117.6	123.2	134.4	140.0
				Btu/h	401,300	420,400	458,600	477,700
		Heating ^{2P}		kW	132.3	138.6	151.2	157.5
				Btu/h	451,400	472,900	515,900	537,400
		Heating ^{4P}		kW	-	-	-	-
			Btu/h	-	-	-	-	
Maximum number of connectable indoor units				ea	64	64	64	64
Power	Total capacity of the connected Indoor Units 3)	Min.	kW	58.8	61.6	67.2	70.0	
		Max.	kW	152.9	160.2	174.7	182.0	
	Power Input (Nominal)	Cooling ^{1P}	kW	22.28	23.69	25.38	26.59	
		Heating ^{2P}		22.62	23.88	25.84	26.97	
		Heating ^{4P}		-	-			
	Current Input (Nominal)	Cooling ^{1P}	A	35.7	37.9	40.8	42.7	
		Heating ^{2P}		36.2	38.2	41.4	43.2	
	Current	Minimum Ssc value	MVA	16.4	17.3	19.3	19.3	
		MCA	A	67.9	71.8	79.7	79.7	
		MFA	A	75.0	80.0	90.0	90.0	
COP	Nominal Cooling ^{1P}		W/W	5.28	5.20	5.30	5.27	
	Nominal Heating ^{2P}		W/W	5.85	5.80	5.85	5.84	
	Nominal Heating ^{4P}		W/W	-	-			
Casing	Material	Cabinet	-	EGI steel plate	EGI steel plate	EGI steel plate	EGI steel plate	
		Base	-	EGI steel plate	EGI steel plate	EGI steel plate	EGI steel plate	
Compressor	Type		-	Inverter Scroll	Inverter Scroll	Inverter Scroll	Inverter Scroll	
	Output		kW x n	(4.96) x 3 + (6.13) x 1	(4.96) x 2 + (6.13) x 2	(4.96) x 5	(4.96) x 5	
	Model Name		-	DS-GB052FAVBSC x 3 + DS-GB066FAVBSC x 1	DS-GB052FAVBSC x 2 + DS-GB066FAVBSC x 2	DS-GB052FAVBSC x 5	DS-GB052FAVBSC x 5	
	Oil	Type	-	PVE	PVE	PVE	PVE	
		Initial Charge	Liter	(3.9 x 2)+6.2	(3.9 x 2)+6.2	3.9+(6.2 x 2)	3.9+(6.2 x 2)	
Condenser	Type		Type	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)	
	Pipe Size		Ø, inch	PT 1-1/4 x 3	PT 1-1/4 x 3	PT 1-1/4 x 3	PT 1-1/4 x 3	
	Pressure Drop		kPa	30.0 + 43.0 + 54.0	43.0 x 2 + 54.0	22.0 + 54.0 x 2	30.0 + 54.0 x 2	
	Water Flow Rate		LPM	96.0 + 114.0 + 190.0	114.0 x 2 + 190.0	80.0 + 190.0 x 2	96.0 + 190.0 x 2	
	Max. Pressure		Mpa	1.96	1.96	1.96	1.96	
Piping Connections	Liquid Pipe			Type	Braze connection	Braze connection	Braze connection	Braze connection
				Ø, mm	19.05	19.05	19.05	19.05
				Ø, inch	3/4"	3/4"	3/4"	3/4"
	Gas Pipe			Type	Braze connection	Braze connection	Braze connection	Braze connection
				Ø, mm	41.28	41.28	41.28	41.28
				Ø, inch	1 5/8"	1 5/8"	1 5/8"	1 5/8"
	Discharge Gas Pipe			Ø, mm	34.92	34.92	34.92	34.92
				Ø, inch	1 3/8"	1 3/8"	1 3/8"	1 3/8"
	Heat insulation		-	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes	
	Piping length	ODU-IDU	Max.	m	170 (190)	170 (190)	170 (190)	170 (190)
		After branch	Max.	m	90	90	90	90
	Total piping length	System	Actual	m	500	500	500	500
Level difference	ODU-IDU	Outdoor unit in highest position	m	50	50	50	50	
		Indoor unit in highest position	m	40	40	40	40	
	IDU-IDU	Max.	m	50	50	50	50	
Wiring connections	Communication	Minimum	mm²	0.75	0.75	0.75	0.75	
		Remark	-	F1, F2	F1, F2	F1, F2	F1, F2	
Refrigerant	Type		-	R410A	R410A	R410A	R410A	
	Factory Charging		kg/tCO ₂ e	21.6/45.10	21.8/45.52	25.1/52.41	25.4/53.04	
Sound ^{3P}	Sound Pressure	Cooling	dB(A)	55	55	55	55	
		Heating		56	57	56	56	
	Sound Power			76	76	77	77	
External Dimension	Net Weight		kg	160 x 2 + 240	160 x 2 + 240	160 + 240 x 2	160 + 240 x 2	
	Shipping Weight		kg	167 x 2 + 250	167 x 2 + 250	167 + 250 x 2	167 + 250 x 2	
	Net Dimensions (WxHxD)		mm	(770 x 1,000 x 545) x 2 + 1,100 x 1,000 x 545	(770 x 1,000 x 545) x 2 + 1,100 x 1,000 x 545	770 x 1,000 x 545 + (1,100 x 1,000 x 545) x 2	770 x 1,000 x 545 + (1,100 x 1,000 x 545) x 2	
	Shipping Dimensions (WxHxD)		mm	(840 x 1,200 x 620) x 2 + 1,170 x 1,200 x 620	(840 x 1,200 x 620) x 2 + 1,170 x 1,200 x 620	840 x 1,200 x 620 + (1,170 x 1,200 x 620) x 2	840 x 1,200 x 620 + (1,170 x 1,200 x 620) x 2	
Operating Temp. Range	Cooling		°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	
	Heating		°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	

2. Specification

Premium Energy Efficiency

Type				DVM S Water		DVM S Water	
Model Name	Outdoor unit module 1			AM520FXWANR2		AM600FXWANR2	
	Outdoor unit module 2			AM210FXWANR		AM200FXWANR	
	Outdoor unit module 3			AM200FXWANR		AM200FXWANR	
	Outdoor unit module 4						
Power Supply Mode				Ø, #, V, Hz	3,4,380-415,50/60	3,4,380-415,50/60	
				-	HEAT RECOVERY	HEAT RECOVERY	
Performance	HP		HP	52	60		
	Ton		Ton	41.4	47.77		
	Capacity (Nominal)	Cooling	kW	145.6	168.0		
			Btu/h	496,800	573,200		
		Heating ²⁾	kW	163.8	189.0		
			Btu/h	558,900	644,900		
		Heating ⁴⁾	kW	-	-		
		Btu/h	-	-			
Maximum number of connectable indoor units			ea	64	64		
	Total capacity of the connected Indoor Units 3)	Min.	kW	72.8	84.0		
		Max.	kW	189.3	218.4		
Power	Power Input (Nominal)	Cooling ¹⁾	kW	28.00	32.31		
		Heating ²⁾		28.23	32.58		
		Heating ⁴⁾		-	-		
	Current Input (Nominal)	Cooling ¹⁾	A	44.9	51.9		
		Heating ²⁾		45.2	52.2		
	Current	Minimum Ssc value	MVA	20.2	23.1		
		MCA	A	83.6	95.4		
MFA		A	100.0	125.0			
COP	Nominal Cooling ¹⁾		W/W	5.20	5.20		
	Nominal Heating ²⁾		W/W	5.80	5.80		
	Nominal Heating ⁴⁾		W/W	-	-		
Casing	Material	Cabinet	-	EGI steel plate	EGI steel plate		
		Base	-	EGI steel plate	EGI steel plate		
Compressor	Type		-	Inverter Scroll	Inverter Scroll		
	Output		kW × n	(4.96) × 4 + (6.13) × 1	(4.96) × 6		
	Model Name		-	DS-GB052FAVBSC × 4 + DS-GB066FAVBSC × 1	DS-GB052FAVBSC × 6		
	Oil	Type	-	PVE	PVE		
		Initial Charge	Liter	3.9+(6.2 × 2)	6.2 × 3		
Condenser	Type		Type	PHE(Plate Heat Exchanger)	PHE(Plate Heat Exchanger)		
	Pipe Size		Ø, inch	PT 1-1/4 × 3	PT 1-1/4 × 3		
	Pressure Drop		kPa	43.0 + 54.0 × 2	54.0 × 3		
	Water Flow Rate		LPM	114.0 + 190.0 × 2	190.0 × 3		
	Max. Pressure		Mpa	1.96	1.96		
Piping Connections	Liquid Pipe		Type	Braze connection	Braze connection		
			Ø, mm	19.05	19.05		
			Ø, inch	3/4"	3/4"		
	Gas Pipe		Type	Braze connection	Braze connection		
			Ø, mm	41.28	41.28		
			Ø, inch	1 5/8"	1 5/8"		
	Discharge Gas Pipe		Ø, mm	34.92	34.92		
			Ø, inch	1 3/8"	1 3/8"		
	Heat insulation		-	Both liquid and gas pipes	Both liquid and gas pipes		
	Piping length	ODU-IDU	Max.	m	170 (190)	170 (190)	
		After branch	Max.	m	90	90	
	Total piping length	System	Actual	m	500	500	
Level difference	ODU-IDU	Outdoor unit in highest position	m	50	50		
		Indoor unit in highest position	m	40	40		
	IDU-IDU	Max.	m	50	50		
Wiring connections	Communication	Minimum	mm²	0.75	0.75		
		Remark	-	F1, F2	F1, F2		
			-	R410A	R410A		
Refrigerant	Factory Charging		kg/tCO ₂ e	25.6/53.45	29.4/61.39		
Sound ³⁾	Sound Pressure	Cooling	dB(A)	55	56		
		Heating		57	57		
	Sound Power			77	78		
External Dimension	Net Weight		kg	160 + 240 × 2	240 × 3		
	Shipping Weight		kg	167 + 250 × 2	250 × 3		
	Net Dimensions (WxHxD)		mm	770 × 1,000 × 545 + (1,100 × 1,000 × 545) × 2	(1,100 × 1,000 × 545) × 3		
	Shipping Dimensions (WxHxD)		mm	840 × 1,200 × 620 + (1,170 × 1,200 × 620) × 2	(1,170 × 1,200 × 620) × 3		
Operating Temp. Range	Cooling		°C	10.0 ~ 45.0	10.0 ~ 45.0		
	Heating		°C	10.0 ~ 45.0	10.0 ~ 45.0		

2. Specification

Premium Compact

Type				DVM S Water	DVM S Water	DVM S Water	DVM S Water	
Model Name	Outdoor unit module 1			AM300KXWANR	AM380KXWANR1	AM400KXWANR1	AM420KXWANR1	
	Outdoor unit module 2			AM300KXWANR	AM300KXWANR	AM300KXWANR	AM300KXWANR	
	Outdoor unit module 3			-	AM080FXWANR	AM100FXWANR	AM120FXWANR	
	Outdoor unit module 4			-	-	-	-	
Power Supply				Ø, #, V, Hz	3, 4, 380-415, 50/60	3, 4, 380-415, 50/60	3, 4, 380-415, 50/60	
Mode				-	HEAT RECOVERY	HEAT RECOVERY	HEAT RECOVERY	
Performance	HP			HP	30	38	40	
	Ton			Ton	23.9	30.3	31.9	
	Capacity (Nominal)	Cooling	kW	84.0	106.4	112.0	117.6	
			Btu/h	286,600	363,027	382,133	401,240	
		Heating ²⁾	kW	94.5	119.7	126.0	132.3	
			Btu/h	322,400	408,373	429,867	451,360	
		Heating ⁴⁾	kW	-	-	-	-	
Btu/h	-	-	-	-	-			
Maximum number of connectable indoor units				ea	55	64	64	
Power	Total capacity of the connected Indoor Units 3)	Min.	kW	42.0	53.2	56.0	58.8	
		Max.	kW	109.2	138.3	145.6	152.9	
		Cooling ¹⁾		16.80	20.64	21.85	23.26	
	Power Input (Nominal)	Heating ²⁾	kW	16.88	21.00	22.13	23.39	
		Heating ⁴⁾		-	-	-	-	
		Current Input (Nominal)	Cooling ¹⁾	A	26.4	32.6	34.5	36.7
	Heating ²⁾		26.5	33.1	34.9	36.9		
	Current	Minimum Ssc value	MVA	-	-	-	-	
		MCA	A	48	64.1	64.1	68	
		MFA	A	63	75	75	75	
COP	Nominal Cooling ¹⁾		W/W	5.00	5.16	5.13	5.06	
	Nominal Heating ²⁾		W/W	5.60	5.70	5.69	5.66	
	Nominal Heating ⁴⁾		W/W	-	-	-	-	
Casing	Material	Cabinet Base	-	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate	
		-	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate		
Compressor	Type		-	Inverter Scroll	Inverter Scroll	Inverter Scroll	Inverter Scroll	
	Output		kW × n	(6.75)x2	(6.75)x2 + (4.96)x1	(6.75)x2 + (4.96)x1	(6.75)x2 + (6.13)x1	
	Model Name		-	DS-GB070FAV* x 2	DS-GB070FAV* x 2 + DS-GB052FAVBSC x 1	DS-GB070FAV* x 2 + DS-GB052FAVBSC x 1	DS-GB070FAV* x 2 + DS-GB066FAVBSC x 1	
	Oil	Type	-	PVE	PVE	PVE	PVE	
Initial Charge		Liter	6.2	6.2 + 3.9	6.2 + 3.9	6.2 + 3.9		
Condenser	Type		Type	PHE (Plate Heat Exchanger)	PHE (Plate Heat Exchanger)	PHE (Plate Heat Exchanger)	PHE (Plate Heat Exchanger)	
	Pipe Size		Ø, inch	PT2	PT2 + PT 1-1/4	PT2 + PT 1-1/4	PT2 + PT 1-1/4	
	Pressure Drop		kPa	50	50 + 22	50 + 30	50 + 43	
	Water Flow Rate		LPM	285	285 + 80	285 + 96	285 + 114	
	Max. Pressure		Mpa	1.96	1.96	1.96	1.96	
Piping Connections	Liquid Pipe	Type		Braze Connection	Braze Connection	Braze Connection	Braze Connection	
		Ø, mm		19.05	19.05	19.05	19.05	
		Ø, inch		3/4"	3/4"	3/4"	3/4"	
	Gas Pipe	Type		Braze Connection	Braze Connection	Braze Connection	Braze Connection	
		Ø, mm		34.92	41.28	41.28	41.28	
		Ø, inch		1 3/8"	1 5/8"	1 5/8"	1 5/8"	
	Discharge Gas Pipe	Ø, mm		Braze Connection	Braze Connection	Braze Connection	Braze Connection	
		Ø, inch		28.58	34.92	34.92	34.92	
		Ø, inch		1 1/8"	1 3/8"	1 3/8"	1 3/8"	
	Heat insulation		-	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes	
	Piping length	ODU-IDU	Max.	m	170 (190)	170 (190)	170 (190)	170 (190)
		After branch	Max.	m	90	90	90	90
	Total piping length	System	Actual	m	500	500	500	500
		Level difference	ODU-IDU	Outdoor unit in highest position	m	50	50	50
IDU-IDU	Indoor unit in highest position		m	40	40	40	40	
IDU-IDU	Max.		m	50	50	50	50	
Wiring connections	Communication	Minimum	mm²	0.75	0.75	0.75	0.75	
		Remark	-	F1, F2	F1, F2	F1, F2	F1, F2	
Refrigerant	Type		-	R-410A	R-410A	R-410A	R-410A	
	Factory Charging		kg/tCO ₂ e	11.0	19.0	16.8	17.0	
Sound ³⁾	Sound Pressure	Cooling	dB(A)	55	56	56	57	
		Heating		58	59	59	59	
	Sound Power			75	77	77	77	
External Dimension	Net Weight		kg	280	160 + 280	160 + 280	160 + 280	
	Shipping Weight		kg	290	167 + 290	167 + 290	167 + 290	
	Net Dimensions (WxHxD)		mm	1100 x 1000 x 545	(770 X 1000 X 545)+ (1100 x 1000 x 545)	(770 X 1000 X 545)+ (1100 x 1000 x 545)	(770 X 1000 X 545)+ (1100 x 1000 x 545)	
	Shipping Dimensions (WxHxD)		mm	1170 x 1200 x 620	(840 X 1200 X 620)+ (1170 x 1200 x 620)	(840 X 1200 X 620)+ (1170 x 1200 x 620)	(840 X 1200 X 620)+ (1170 x 1200 x 620)	
Operating Temp. Range	Cooling		℃	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	
	Heating		℃	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	

2. Specification

Premium Compact

Type				DVM S Water	DVM S Water	DVM S Water	DVM S Water	
Model Name	Outdoor unit module 1			AM460KXWANR1	AM480KXWANR1	AM500KXWANR1	AM520KXWANR1	
	Outdoor unit module 2			AM300KXWANR	AM300KXWANR	AM300KXWANR	AM300KXWANR	
	Outdoor unit module 3			AM080FXWANR	AM100FXWANR	AM200FXWANR	AM120FXWANR	
	Outdoor unit module 4			-	-	-	-	
Power Supply Mode				Ø, #, V, Hz	3, 4, 380-415, 50/60	3, 4, 380-415, 50/60	3, 4, 380-415, 50/60	3, 4, 380-415, 50/60
Performance	HP			HP	46	48	50	52
	Ton			Ton	36.6	38.2	39.8	41.4
	Capacity (Nominal)	Cooling	kW	128.8	134.4	140.0	145.6	
			Btu/h	439,453	458,560	477,667	496,773	
		Heating ²⁾	kW	144.9	151.2	157.5	163.8	
			Btu/h	494,347	515,840	537,333	558,827	
		Heating ⁴⁾	kW	-	-	-	-	
			Btu/h	-	-	-	-	
Maximum number of connectable indoor units				ea	64	64	64	
Power	Total capacity of the connected Indoor Units 3)	Min.	kW	64.4	67.2	70.0	72.8	
		Max.	kW	188.4	174.7	182.0	189.3	
		Cooling ¹⁾		24.48	25.69	27.57	28.31	
	Power Input (Nominal)	Heating ²⁾	kW	25.12	26.25	27.74	28.64	
		Heating ⁴⁾		-	-	-	-	
		Current Input (Nominal)	Cooling ¹⁾	A	38.8	40.7	43.7	44.8
	Heating ²⁾		39.7		41.5	43.9	45.3	
	Current	Minimum Ssc value		MVA	-	-	-	-
		MCA	A	80.2	80.2	79.8	84.1	
		MFA	A	90	90	90	100	
	COP	Nominal Cooling ¹⁾		W/W	5.26	5.23	5.08	5.14
Nominal Heating ²⁾		W/W	5.77	5.76	5.68	5.72		
Nominal Heating ⁴⁾		W/W	-	-	-	-		
Casing	Material	Cabinet	-	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate	
		Base	-	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate	
Compressor	Type		-	Inverter Scroll	Inverter Scroll	Inverter Scroll	Inverter Scroll	
	Output		kW × n	(6.75)x2 + (4.96)x2	(6.75)x2 + (4.96)x2	(6.75)x2 + (4.96)x2	(6.75)x2 + (6.13)x1 + (4.96)x1	
	Model Name		-	DS-GB070FAV* x 2 + DS-GB052FAVBSC x 2	DS-GB070FAV* x 2 + DS-GB052FAVBSC x 2	DS-GB070FAV* x 2 + DS-GB052FAVBSC x 2	DS-GB070FAV* x 2 + DS-GB066FAVBSC x 1 + DS-GB052FAVBSC x 1	
	Oil	Type	-	PVE	PVE	PVE	PVE	
Initial Charge		Liter	6.2 + (3.9)x2	6.2 + (3.9)x2	(6.2)x2	6.2 + (3.9)x2		
Condenser	Type		Type	PHE (Plate Heat Exchanger)	PHE (Plate Heat Exchanger)	PHE (Plate Heat Exchanger)	PHE (Plate Heat Exchanger)	
	Pipe Size		Ø, inch	PT2 + PT 1-1/4 x 2	PT2 + PT 1-1/4 x 2	PT2 + PT 1-1/4	PT2 + PT 1-1/4 x 2	
	Pressure Drop		kPa	50 + 22 x 2	50 + 22 + 30	50 + 54	50 + 43 + 30	
	Water Flow Rate		LPM	285 + 80 x 2	285 + 80 + 96	285 + 190	285 + 114 + 96	
	Max. Pressure		Mpa	1.96	1.96	1.96	1.96	
Piping Connections	Liquid Pipe	Type		Braze Connection	Braze Connection	Braze Connection	Braze Connection	
		Ø, mm		19.05	19.05	19.05	19.05	
		Ø, inch		3/4"	3/4"	3/4"	3/4"	
	Gas Pipe	Type		Braze Connection	Braze Connection	Braze Connection	Braze Connection	
		Ø, mm		41.28	41.28	41.28	41.28	
		Ø, inch		1 5/8"	1 5/8"	1 5/8"	1 5/8"	
	Discharge Gas Pipe	Ø, mm		Braze Connection	Braze Connection	Braze Connection	Braze Connection	
		Ø, inch		34.92	34.92	34.92	34.92	
		Ø, inch		1 3/8"	1 3/8"	1 3/8"	1 3/8"	
	Heat insulation		-	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes	
	Piping length	ODU-IDU	Max.	m	170 (190)	170 (190)	170 (190)	170 (190)
		After branch	Max.	m	90	90	90	90
	Total piping length	System	Actual	m	500	500	500	500
Level difference	ODU-IDU	Outdoor unit in highest position	m	50	50	50	50	
		Indoor unit in highest position	m	40	40	40	40	
	IDU-IDU	Max.	m	50	50	50	50	
Wiring connections	Communication	Minimum Remark	mm²	0.75	0.75	0.75	0.75	
Refrigerant	Type		-	F1, F2	F1, F2	F1, F2	F1, F2	
	Factory Charging		kg/tCO ₂ e	R-410A	R-410A	R-410A	R-410A	
Sound ³⁾	Sound Pressure	Cooling	dB(A)	57	57	57	57	
		Heating		60	60	59	60	
	Sound Power			78	78	78	78	
External Dimension	Net Weight		kg	160 X 2 + 280	160 X 2 + 280	240 + 280	160 X 2 + 280	
	Shipping Weight		kg	167 X 2 + 290	167 X 2 + 290	250 + 290	167 X 2 + 290	
	Net Dimensions (WxHxD)		mm	(770 X 1000 X 545) X 2+ (1100 x 1000 x 545)	(770 X 1000 X 545) X 2+ (1100 x 1000 x 545)	(1100 x 1000 x 545) X 2	(770 X 1000 X 545) X 2+ (1100 x 1000 x 545)	
	Shipping Dimensions (WxHxD)		mm	(840 X 1200 X 620) X 2+ (1170 x 1200 x 620)	(840 X 1200 X 620) X 2+ (1170 x 1200 x 620)	(1170 x 1200 x 620) X2	(840 X 1200 X 620) X 2+ (1170 x 1200 x 620)	
Operating Temp. Range	Cooling		°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	
	Heating		°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	

2. Specification

Premium Compact

Type				DVM S Water	DVM S Water	DVM S Water	DVM S Water
Model Name				AM540KXWANR1	AM580KXWANR1	AM600KXWANR1	AM620KXWANR1
	Outdoor unit module 1			AM300KXWANR	AM300KXWANR	AM300KXWANR	AM300KXWANR
	Outdoor unit module 2			AM120FXWANR	AM200FXWANR	AM300KXWANR	AM200FXWANR
	Outdoor unit module 3			AM120FXWANR	AM080FXWANR	-	AM120FXWANR
Outdoor unit module 4				-	-	-	-
Power Supply Mode				Ø, #, V, Hz	3, 4, 380-415, 50/60 - HEAT RECOVERY	3, 4, 380-415, 50/60 HEAT RECOVERY	3, 4, 380-415, 50/60 HEAT RECOVERY
Performance	HP			HP	54	58	60
	Ton			Ton	43.0	46.2	47.8
	Capacity (Nominal)	Cooling		kW	151.2	162.4	168.0
				Btu/h	515,880	554,093	573,200
		Heating ²⁾		kW	170.1	182.7	189.0
				Btu/h	580,320	623,307	644,800
		Heating ⁴⁾		kW	-	-	-
			Btu/h	-	-	-	
Maximum number of connectable indoor units				ea	64	64	64
Power	Total capacity of the connected Indoor Units 3)	Min.	kW	75.6	81.2	84.0	86.8
		Max.	kW	221.1	237.5	218.4	225.7
	Power Input (Nominal)	Cooling ¹⁾	kW		29.72	31.41	33.6
		Heating ²⁾			29.90	31.86	33.76
		Heating ⁴⁾			-	-	-
	Current Input (Nominal)	Cooling ¹⁾	A		47	49.9	52.8
		Heating ²⁾			47.3	50.5	53
	Current	Minimum Ssc value	MVA	-	-	-	-
		MCA	A	88	95.9	96	99.8
		MFA	A	100	125	125	125
COP	Nominal Cooling ¹⁾		W/W	5.09	5.17	5.00	5.10
	Nominal Heating ²⁾		W/W	5.69	5.73	5.60	5.70
	Nominal Heating ⁴⁾		W/W	-	-	-	-
Casing	Material	Cabinet Base	-	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate
			-	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate
Compressor	Type			-	Inverter Scroll	Inverter Scroll	Inverter Scroll
	Output			kW × n	(6.75)x2 + (6.13)x2	(6.75)x2 + (4.96)x3	6.75 x 4
	Model Name			-	DS-GB070FAV* x 2 + DS-GB066FAVBGS x 2	DS-GB070FAV* x 2 + DS-GB052FAVBGS x 3	(DS-GB070FAV* x 2) x 2
	Oil	Type	-	PVE	PVE	PVE	PVE
Initial Charge		Liter	6.2 + (3.9)x2	(6.2)x2 + 3.9	6.2 x 2	(6.2)x2 + 3.9	
Condenser	Type			Type	PHE (Plate Heat Exchanger)	PHE (Plate Heat Exchanger)	PHE (Plate Heat Exchanger)
	Pipe Size			Ø, inch	PT2 + PT 1-1/4 x 2	PT2 + PT 1-1/4 x 2	PT2 x 2
	Pressure Drop			kPa	50 + 43x2	50 + 54 + 22	50 x 2
	Water Flow Rate			LPM	285 + 114x2	285 + 190 + 80	285 x 2
	Max. Pressure			Mpa	1.96	1.96	1.96
Piping Connections	Liquid Pipe	Type		Braze Connection	Braze Connection	Braze Connection	Braze Connection
		Ø, mm		19.05	19.05	19.05	22.22
		Ø, inch		3/4"	3/4"	3/4"	7/8"
	Gas Pipe	Type		Braze Connection	Braze Connection	Braze Connection	Braze Connection
		Ø, mm		41.28	41.28	41.28	53.98
		Ø, inch		1 5/8"	1 5/8"	1 5/8"	2 1/8"
	Discharge Gas Pipe	Type		Braze Connection	Braze Connection	Braze Connection	Braze Connection
		Ø, mm		34.92	34.92	34.92	41.28
		Ø, inch		1 3/8"	1 3/8"	1 3/8"	1 5/8"
	Heat insulation			-	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes
	Piping length	ODU-IDU	Max.	m	170 (190)	170 (190)	170 (190)
		After branch	Max.	m	90	90	90
Total piping length	System	Actual	m	500	500	500	
	Level difference	ODU-IDU	Outdoor unit in highest position	m	50	50	50
		Indoor unit in highest position	m	40	40	40	
Wiring connections	Communication	IDU-IDU	Max.	m	50	50	50
		Minimum		mm²	0.75	0.75	0.75
	Remark	-	-	F1, F2	F1, F2	F1, F2	
Refrigerant	Type			-	R-410A	R-410A	R-410A
	Factory Charging			kg/tCO₂e	23.0	26.3	22.0
Sound ³⁾	Sound Pressure	Cooling	dB(A)	58	58	59	58
		Heating		60	60	62	60
	Sound Power			78	78	79	78
External Dimension	Net Weight			kg	160 X 2 + 280	160 + 240 + 280	280 x 2
	Shipping Weight			kg	167 X 2 + 290	167 + 250 + 290	290 x 2
	Net Dimensions (WxHxD)			mm	(770 X 1000 X 545) X 2+ (1100 x 1000 x 545)	(770 X 1000 X 545) + (1100 x 1000 x 545) X 2	(1100 x 1000 x 545) x 2
	Shipping Dimensions (WxHxD)			mm	(840 X 1200 X 620) X 2+ (1170 x 1200 x 620)	(840 X 1200 X 620) + (1170 x 1200 x 620) X 2	(1170 x 1200 x 620) x 2
Operating Temp. Range	Cooling			°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0
	Heating			°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0

2. Specification

Premium Compact

Type				DVM S Water	DVM S Water	DVM S Water	DVM S Water	
Model Name	Outdoor unit module 1			AM680KXWANR1	AM700KXWANR1	AM800KXWANR1	AM900KXWANR1	
	Outdoor unit module 2			AM300KXWANR	AM300KXWANR	AM300KXWANR	AM300KXWANR	
	Outdoor unit module 3			AM300KXWANR	AM300KXWANR	AM300KXWANR	AM300KXWANR	
	Outdoor unit module 4			AM080FXWANR	AM100FXWANR	AM200FXWANR	AM300KXWANR	
Power Supply				Ø, #, V, Hz	3, 4, 380-415, 50/60	3, 4, 380-415, 50/60	3, 4, 380-415, 50/60	
Mode				-	HEAT RECOVERY	HEAT RECOVERY	HEAT RECOVERY	
Performance	HP			HP	68	70	80	
	Ton			Ton	54.2	55.8	63.7	
	Capacity (Nominal)	Cooling		kW	190.4	196.0	224.0	
				Btu/h	649,627	668,733	764,267	
		Heating ²⁾		kW	214.2	220.5	252.0	
				Btu/h	730,773	752,267	859,733	
		Heating ⁴⁾		kW	-	-	-	
				Btu/h	-	-	-	
Maximum number of connectable indoor units				ea	64	64	64	
Power	Total capacity of the connected Indoor Units 3)	Min.	kW	95.2	98.0	112.0	126.0	
		Max.	kW	247.5	254.8	291.2	327.6	
	Power Input (Nominal)	Cooling ¹⁾	kW	37.44	38.65	44.37	50.4	
		Heating ²⁾		37.88	39.01	44.62	50.64	
		Heating ⁴⁾		-	-	-	-	
	Current Input (Nominal)	Cooling ¹⁾	A	59	60.9	70.1	79.2	
		Heating ²⁾		59.6	61.4	70.4	79.5	
	Current	Minimum Ssc value	MVA	-	-	-	-	
		MCA	A	112.1	112.1	127.8	144	
		MFA	A	125	125	150	175	
	COP	Nominal Cooling ¹⁾		W/W	5.09	5.07	5.05	5.00
		Nominal Heating ²⁾		W/W	5.65	5.65	5.65	5.60
Nominal Heating ⁴⁾		W/W	-	-	-	-		
Casing	Material	Cabinet	-	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate	
		Base	-	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate	EGI Steel Plate	
Compressor	Type		-	Inverter Scroll	Inverter Scroll	Inverter Scroll	Inverter Scroll	
	Output		kW × n	(6.75)x4 + (4.96)x1	(6.75)x4 + (4.96)x1	(6.75)x4 + (4.96)x2	6.75 x 6	
	Model Name		-	DS-GB070FAV* x 4 + DS-GB052FAVBGS x 1	DS-GB070FAV* x 4 + DS-GB052FAVBGS x 1	DS-GB070FAV* x 4 + DS-GB052FAVBGS x 2	(DS-GB070FAV* x 2) x 3	
	Oil	Type	-	PVE	PVE	PVE	PVE	
Initial Charge		Liter	6.2x2 + 3.9	6.2x2 + 3.9	(6.2)x3	6.2 x 3		
Condenser	Type		Type	PHE (Plate Heat Exchanger)	PHE (Plate Heat Exchanger)	PHE (Plate Heat Exchanger)	PHE (Plate Heat Exchanger)	
	Pipe Size		Ø, inch	PT2x2 + PT 1-1/4	PT2x2 + PT 1-1/4	PT2x2 + PT 1-1/4	PT2 x 3	
	Pressure Drop		kPa	50x2 + 22	50x2 + 30	50x2 + 54	50 x 3	
	Water Flow Rate		LPM	285x2 + 80	285x2 + 96	285x2 + 190	285 x 3	
	Max. Pressure		Mpa	1.96	1.96	1.96	1.96	
Piping Connections	Liquid Pipe	Type		Braze Connection	Braze Connection	Braze Connection	Braze Connection	
		Ø, mm		22.22	22.22	22.22	22.22	
		Ø, inch		7/8"	7/8"	7/8"	7/8"	
	Gas Pipe	Type		Braze Connection	Braze Connection	Braze Connection	Braze Connection	
		Ø, mm		53.98	53.98	53.98	53.98	
		Ø, inch		2 1/8"	2 1/8"	2 1/8"	2 1/8"	
	Discharge Gas Pipe	Type		Braze Connection	Braze Connection	Braze Connection	Braze Connection	
		Ø, inch		41.28	41.28	41.28	41.28	
		Ø, inch		1 5/8"	1 5/8"	1 5/8"	1 5/8"	
	Heat insulation		-	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes	Both liquid and gas pipes	
	Piping length	ODU-IDU	Max.	m	170 (190)	170 (190)	170 (190)	170 (190)
		After branch	Max.	m	90	90	90	90
	Total piping length	System	Actual	m	500	500	500	500
Level difference	ODU-IDU	Outdoor unit in highest position	m	50	50	50	50	
		Indoor unit in highest position	m	40	40	40	40	
	IDU-IDU	Max.	m	50	50	50	50	
Wiring connections	Communication	Minimum	mm²	0.75	0.75	0.75	0.75	
		Remark	-	F1, F2	F1, F2	F1, F2	F1, F2	
Refrigerant	Type		-	R-410A	R-410A	R-410A	R-410A	
	Factory Charging		kg/tCO ₂ e	27.5	27.8	31.8	33.0	
Sound ³⁾	Sound Pressure	Cooling	dB(A)	59	59	59	60	
		Heating		62	62	62	63	
	Sound Power			79	79	80	80	
External Dimension	Net Weight		kg	160 + 280 X 2	160 + 280 X 2	240 + 280 X 2	280 x 3	
	Shipping Weight		kg	167 + 290 X 2	167 + 290 X 2	250 + 290 X 2	290 x 3	
	Net Dimensions (WxHxD)		mm	(770 X 1000 X 545) + (1100 x 1000 x 545) X 2	(770 X 1000 X 545) + (1100 x 1000 x 545) X 2	(1100 x 1000 x 545) x 3	(1100 x 1000 x 545) x 3	
	Shipping Dimensions (WxHxD)		mm	(840 X 1200 X 620) + (1170 x 1200 x 620) X 2	(840 X 1200 X 620) + (1170 x 1200 x 620) X 2	(1170 x 1200 x 620) x 3	(1170 x 1200 x 620) x 3	
Operating Temp. Range	Cooling		°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	
	Heating		°C	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	10.0 ~ 45.0	

2. Specification

NOTE

- Specification may be subject to change without prior notice.
- 1)* Nominal cooling capacities are based on;
 - Indoor temperature : 27°C DB, 19°C WB, Inlet water temperature : 30°C, Equivalent refrigerant piping : 7.5m, Level differences : 0m
- 2)* Nominal heating capacities are based on;
 - Indoor temperature : 20°C DB, 15°C WB, Inlet water temperature : 20°C, Equivalent refrigerant piping : 7.5m, Level differences : 0m
- 3)* Sound power level is an absolute value that a sound source generates.
 - Sound pressure level is a relative value, depending on the distance and acoustic environment.
 - Sound values are obtained in an anechoic room.
 - Sound values of multi combination are theoretical values based on sound results of individual installed units.
- 4)* Nominal heating capacities are based on Eurovent test conditions:
 - Indoor temperature : 20°C DB, 15°C WB, Inlet water temperature : 10°C, Outlet water temperature : 7°C, Equivalent refrigerant piping : 7.5m, Level differences : 0m
- These products contain R410A(GWP=2,088) which is fluorinated greenhouse gas.
- Total capacity of the connected indoor units can be allowed from 50% to 130% of the total outdoor unit capacity.
 $0.5 \times \Sigma(\text{Outdoor unit capacity}) \leq \text{Total capacity of the connected indoor units} \leq 1.3 \times \Sigma(\text{Outdoor unit capacity})$
- You can connect maximum 64 indoor units to the outdoor unit. Maximum quantity of connectable indoor unit is set to 64 since outdoor unit only support up to 64 communication address. Indoor unit address can be assigned from indoor unit address was assigned from 64~79, E201 error will occur. 0~63. If the indoor unit address was assigned from 64~79, E201 error will occur.

3. Electric Characteristics

Single

Capacity		Model	Power Supply		Voltage Range		Nominal Running Current [A]		Current [A]	
HP	kW		Hz	Voltage	Min. (-10%)	Max. (+10%)	Cooling	Heating	MCA	MFA
8	22.4	AM080FXWANR	50/60	380~415	342	456	6.2	6.6	16.1	20
10	28.0	AM100FXWANR	50/60	380~415	342	456	8.1	8.4	16.1	20
12	33.6	AM120FXWANR	50/60	380~415	342	456	10.3	10.4	20.0	25
20	56.0	AM200FXWANR	50/60	380~415	342	456	17.3	17.4	31.8	40
30	84.0	AM300KXWANR	50/60	380~415	342	456	26.4	26.5	48.1	63.1

Module (Premium energy efficiency type)

Capacity		Model	Power Supply		Voltage Range		Nominal Running Current [A]		Current [A]	
HP	kW		Hz	Voltage	Min. (-10%)	Max. (+10%)	Cooling	Heating	MCA	MFA
16	44.8	AM160FXWANR2	50/60	380~415	342	456	12.4	13.2	32.2	40
18	50.4	AM180FXWANR2	50/60	380~415	342	456	14.3	15	32.2	40
22	61.6	AM220FXWANR2	50/60	380~415	342	456	18.4	18.8	36.1	40
24	67.2	AM240FXWANR2	50/60	380~415	342	456	20.6	20.8	40.0	50
26	72.8	AM260FXWANR2	50/60	380~415	342	456	20.5	21.6	48.3	63
28	78.4	AM280FXWANR2	50/60	380~415	342	456	23.5	24	47.9	63
30	84.0	AM300FXWANR2	50/60	380~415	342	456	25.4	25.8	47.9	63
32	89.6	AM320FXWANR2	50/60	380~415	342	456	27.6	27.8	51.8	63
34	95.2	AM340FXWANR2	50/60	380~415	342	456	28.7	29.2	56.1	63
36	100.8	AM360FXWANR2	50/60	380~415	342	456	29.7	30.6	64.0	75
38	106.4	AM380FXWANR2	50/60	380~415	342	456	31.6	32.4	64.0	75
40	112.0	AM400FXWANR2	50/60	380~415	342	456	34.6	34.6	63.6	75
42	117.6	AM420FXWANR2	50/60	380~415	342	456	35.7	36.2	67.9	75
44	123.2	AM440FXWANR2	50/60	380~415	342	456	37.9	38.2	71.8	80
48	134.4	AM480FXWANR2	50/60	380~415	342	456	40.8	41.4	79.7	90
50	140.0	AM500FXWANR2	50/60	380~415	342	456	42.7	43.2	79.7	90
52	145.6	AM520FXWANR2	50/60	380~415	342	456	44.9	45.2	83.6	100
60	168.0	AM600FXWANR2	50/60	380~415	342	456	51.9	52.2	95.4	125

3. Electric Characteristics

Module (Premium compact type)

Capacity		Model	Power Supply		Voltage Range		Nominal Running Current [A]		Current [A]	
			Hz	Voltage	Min. (-10%)	Max. (+10%)	Cooling	Heating	MCA	MFA
38	106.4	AM380FXWANR1	50/60	380~415	342	456	32.6	33.1	64.1	75
40	112.0	AM400FXWANR1	50/60	380~415	342	456	34.5	34.9	64.1	75
42	117.6	AM420FXWANR1	50/60	380~415	342	456	36.7	36.9	68.0	75
46	128.8	AM460FXWANR1	50/60	380~415	342	456	38.8	39.7	80.2	90
48	134.4	AM480FXWANR1	50/60	380~415	342	456	40.7	41.5	80.2	90
50	140.0	AM500FXWANR1	50/60	380~415	342	456	43.7	43.9	79.8	90
52	145.6	AM520FXWANR1	50/60	380~415	342	456	44.8	45.3	84.1	100
54	151.2	AM540FXWANR1	50/60	380~415	342	456	47	47.3	88.0	100
58	162.4	AM580FXWANR1	50/60	380~415	342	456	49.9	50.5	95.9	125
60	168.0	AM600FXWANR1	50/60	380~415	342	456	52.8	53	96.0	125
62	173.6	AM620FXWANR1	50/60	380~415	342	456	54	54.3	99.8	125
68	190.4	AM680FXWANR1	50/60	380~415	342	456	59	59.6	112.1	125
70	196.0	AM700FXWANR1	50/60	380~415	342	456	60.9	61.4	112.1	125
80	224.0	AM800FXWANR1	50/60	380~415	342	456	70.1	70.4	127.8	150
90	252.0	AM900FXWANR1	50/60	380~415	342	456	79.2	79.5	144.0	175


NOTE

- MCA: Minimum circuit amperes
- MFA: Maximum fuse amperes
- Select wire size based on the value of MCA

4. Dimensional Drawing

AM080/100/120FXWA** (8, 10, 12HP)

Unit : mm

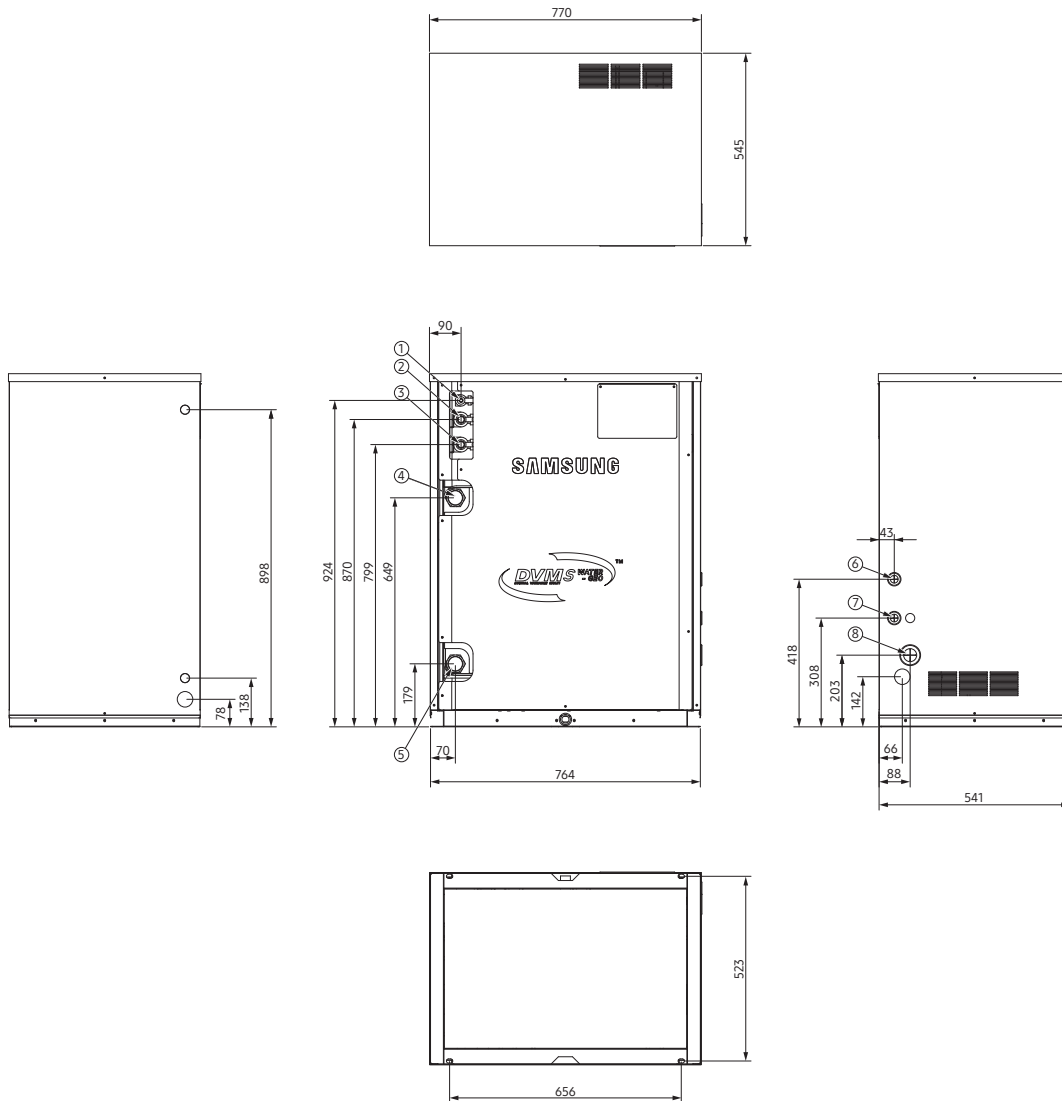


No.	Name	Description			No.	Name	Description		
		8HP	10HP	12HP			8HP	10HP	12HP
①	Liquid ref. pipe	9.52 (3/8")	9.52 (3/8")	12.70 (1/2")	⑤	Water inlet pipe	PT 1-1/4		
②	High pressure gas ref. pipe	15.88 (5/8")	19.05 (3/4")	19.05 (3/4")	⑥	Communication wiring	-		
③	Low pressure gas ref. pipe	19.05 (3/4")	22.22 (7/8")	28.58 (1 1/8")	⑦	External contact wiring	-		
④	Water outlet pipe	PT 1-1/4			⑧	Power wiring	-		

4. Dimensional Drawing

AM200FXWA** (20HP)


Unit : mm

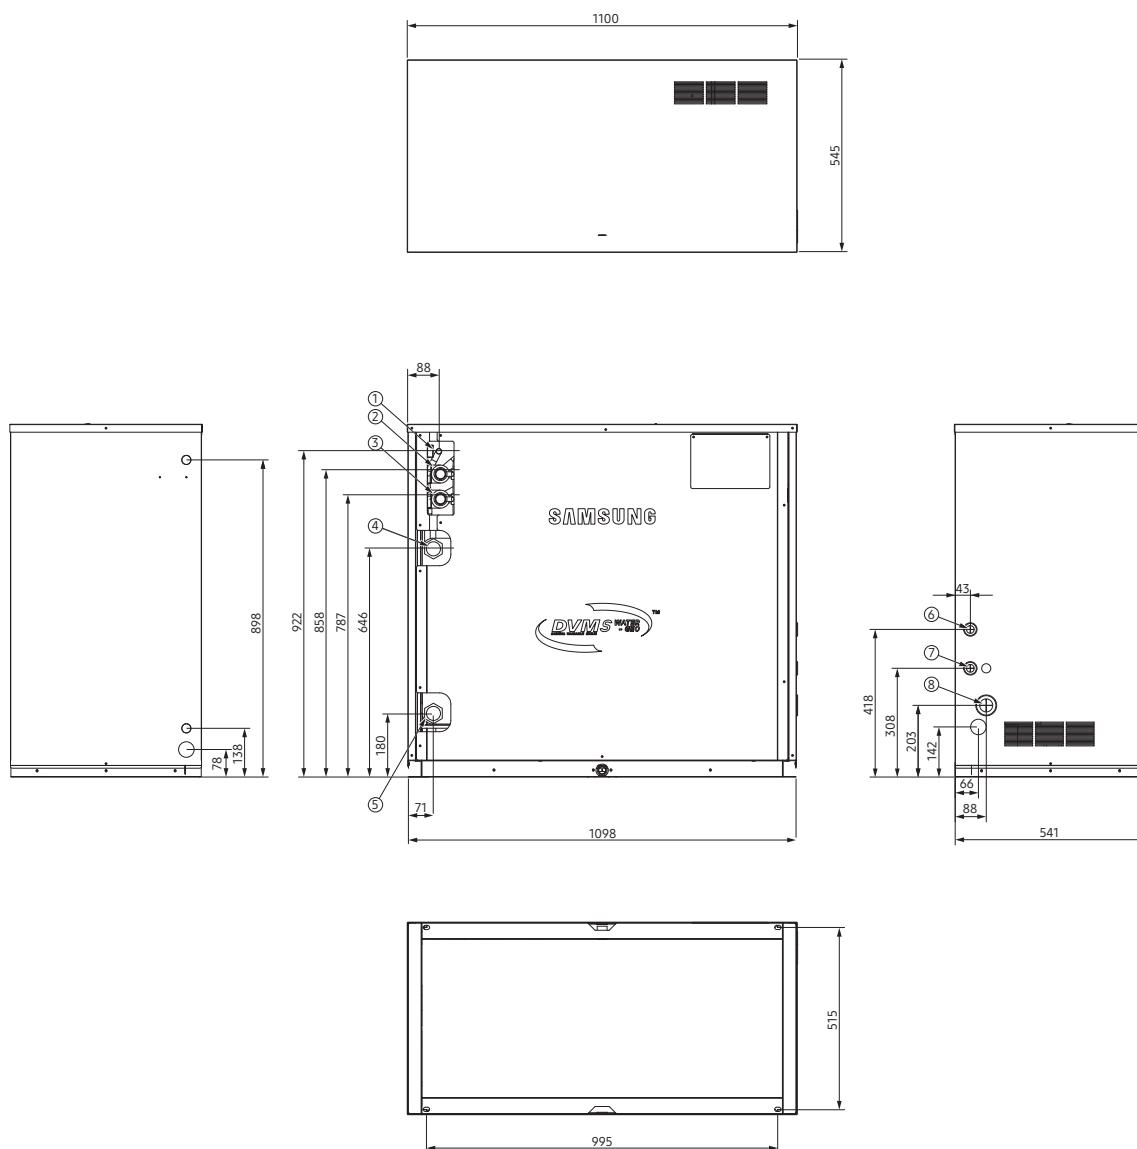

No.	Name	Description	No.	Name	Description
①	Liquid ref. pipe	15.88 (5/8")	⑤	Water inlet pipe	PT 1-1/4
②	High pressure gas ref. pipe	28.58 (1 1/8")	⑥	Communication wiring	-
③	Low pressure gas ref. pipe	28.58 (1 1/8")	⑦	External contact wiring	-
④	Water outlet pipe	PT 1-1/4	⑧	Power wiring	-

4. Dimensional Drawing


AM300KXWA** (30HP)

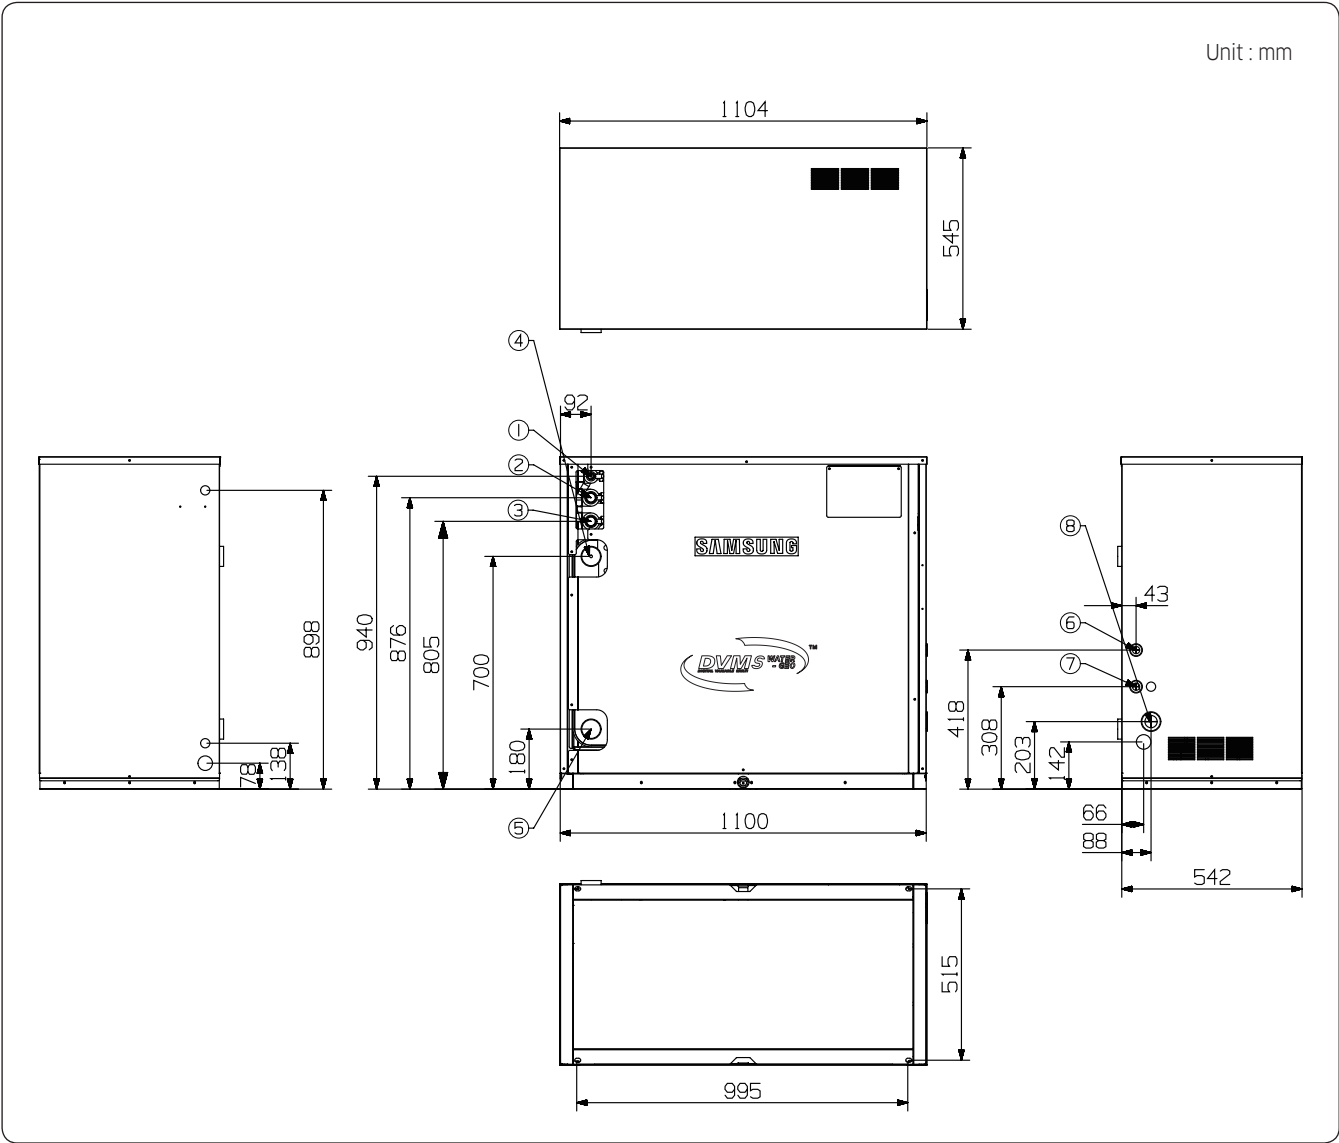

No.	Name	Description	No.	Name	Description
①	Liquid ref. pipe	Ø 19.05 (3/4")	⑤	Water inlet pipe	PT2
②	Gas ref. pipe	Ø 28.58 (1 1/8")	⑥	Communication wiring	-
③	High pressure gas ref. pipe	Ø 34.92 (1 3/8")	⑦	External contact wiring	-
④	Water outlet pipe	PT2	⑧	Power wiring	-

5. Center of Gravity


AM080/100/120FXWA** (8, 10, 12HP)

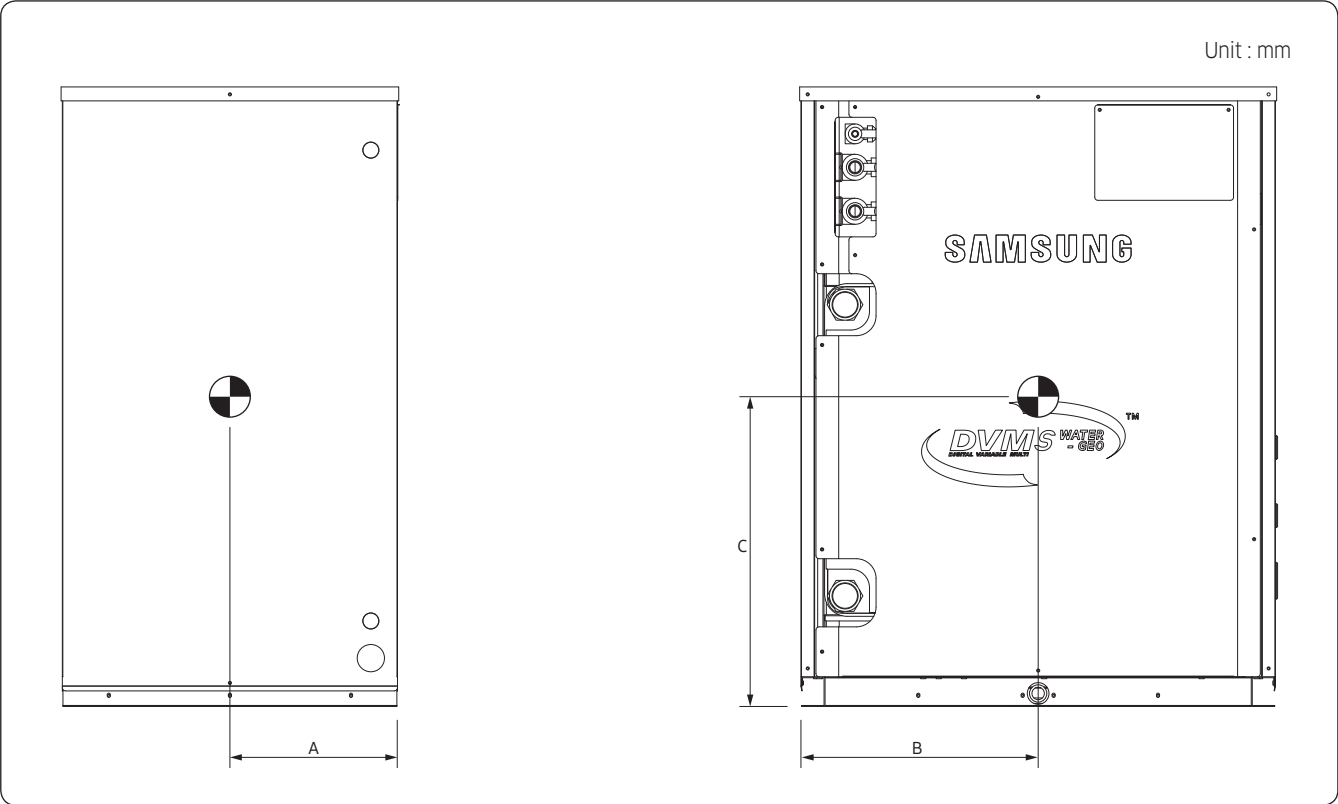

Model	A	B	C
AM080/100/120FXWA**	211	345	353

5. Center of Gravity


AM200FXWA**, AM300KXWA** (20, 30HP)

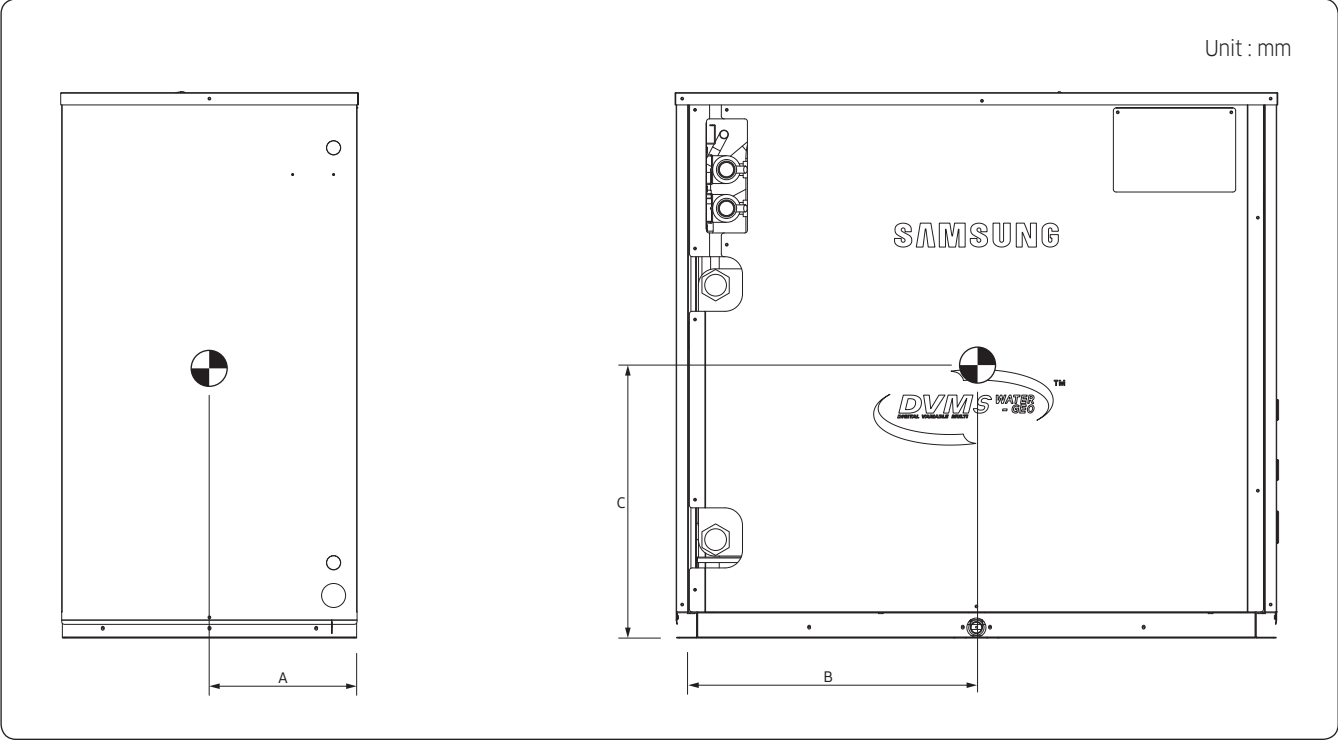

Model	A	B	C
AM200FXWA**	210	476	362
AM300KXWA**	206	461	390

6. Electrical Wiring Diagram

AM080FXWA**~AM200FXWA** (8~20HP)**

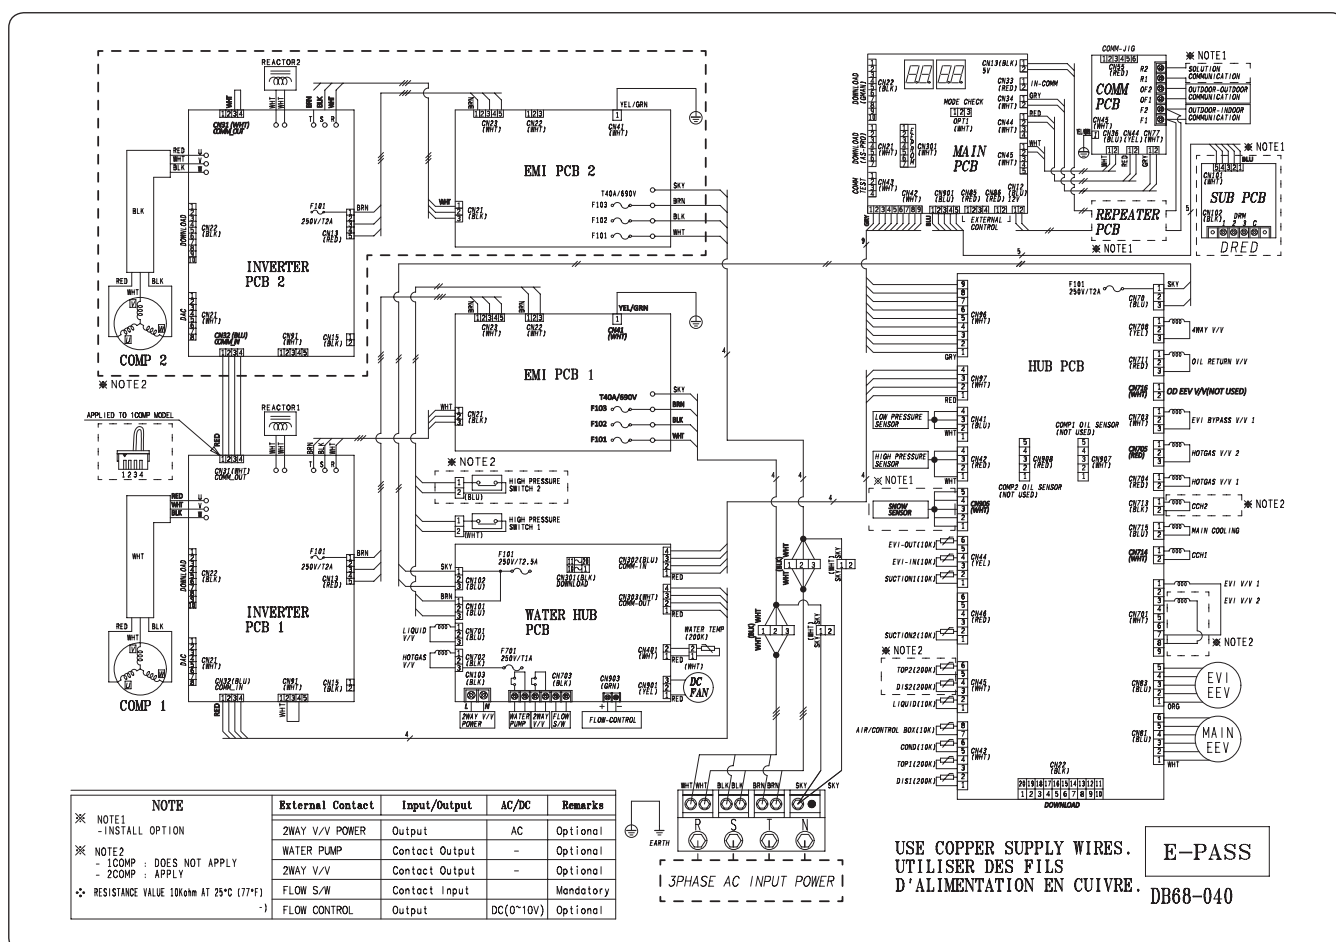


INVERTER PCB1	Printed circuit board (Inverter PBA1)	EEV1	Electrical Expansion Valve 1	HOTGAS V/V 1	Solenoid Valve (Hot Gas Bypass1)
INVERTER PCB2	Printed circuit board (Inverter PBA2)	EEV2	Electrical Expansion Valve 2	HOTGAS V/V 2	Solenoid Valve (Hot Gas Bypass2)
EMI PCB1	Printed circuit board (Noise Filter1)	EVI-OUT (10K)	Temp. Sensor (EVI-out_10kohm)	EVI BYPASS V/V 1	Solenoid Valve (EVI Bypass)
EMI PCB2	Printed circuit board (Noise Filter2)	EVI-IN (10K)	Temp. Sensor (EVI-in_10kohm)	OIL RETURN V/V	Solenoid Valve (Accumulator Oil Return)
WATER HUB PCB	Printed circuit board (Water related load control)	COMP SUCTION1 (10K)	Temp. Sensor (COMP Suction TEMP. 1_10kohm)	4WAY V/V	Solenoid Valve (4Way Valve)
MAIN PCB	Printed circuit board (main)	COMP SUCTION2 (10K)	Temp. Sensor (COMP Suction TEMP. 2_10kohm)	CCH1	Crank Case Heater (COMP1)
HUB PCB	Printed circuit board (hub)	CONTROL BOX TEMP	Temp. Sensor (Inside TEMP. of Control Box_10kohm)	CCH2	Crank Case Heater (COMP2)
COMM PCB	Printed circuit board (Communication)	CONDENSER OUT (10K)	Temp. Sensor (Condenser Out Temp. 10kohm)	MAIN COOLING	Solenoid Valve (Main Cooling)
COMP 1	Motor (Compressor1)	COMP TOP1 (200K)	Temp. Sensor (Compressor1_200kohm)	F101 250V/T2A	FUSE (INVERTER PBA)
COMP 2	Motor (Compressor2)	COMP TOP2 (200K)	Temp. Sensor (Compressor2_200kohm)	690V/T40A	FUSE (NOISE FILTER)
EVI V/V 1	Solenoid Valve (EVI 1)	DISCHARGE1 (200K)	Temp. Sensor (COMP Discharge1_200kohm)	F101 250V/T2.5A	FUSE (WATER HUB)
EVI V/V 2	Solenoid Valve (EVI 2)	DISCHARGE2 (200K)	Temp. Sensor (COMP Discharge2_200kohm)	F701 250V/T1A	FUSE (WATER HUB)
EVI EEV	Enhanced Vapor Injection Electrical Expansion Valve	LIQUID TUBE (10K)	TEMP. Sensor (Liquid Tube Temp._10kohm)		

NOTE

- This wiring diagram applies only to the water-cooled DVM S Water.
- Colors BLK: black, RED: red, BLU: blue, WHT: white, YEL: yellow, BRN: brown, SKY: skyblue
- When operating, don't short circuit the protection device (High Pressure switch)
- For connection wiring indoor-outdoor transmission F1-F2, outdoor-outdoor transmission OF1-OF2, refer to the installation manual.
- ⊕ Protective earth (screw) , □□□ connector, $\frac{1}{2}$: The wire quantity

6. Electrical Wiring Diagram

AM300KXWA** (30HP)

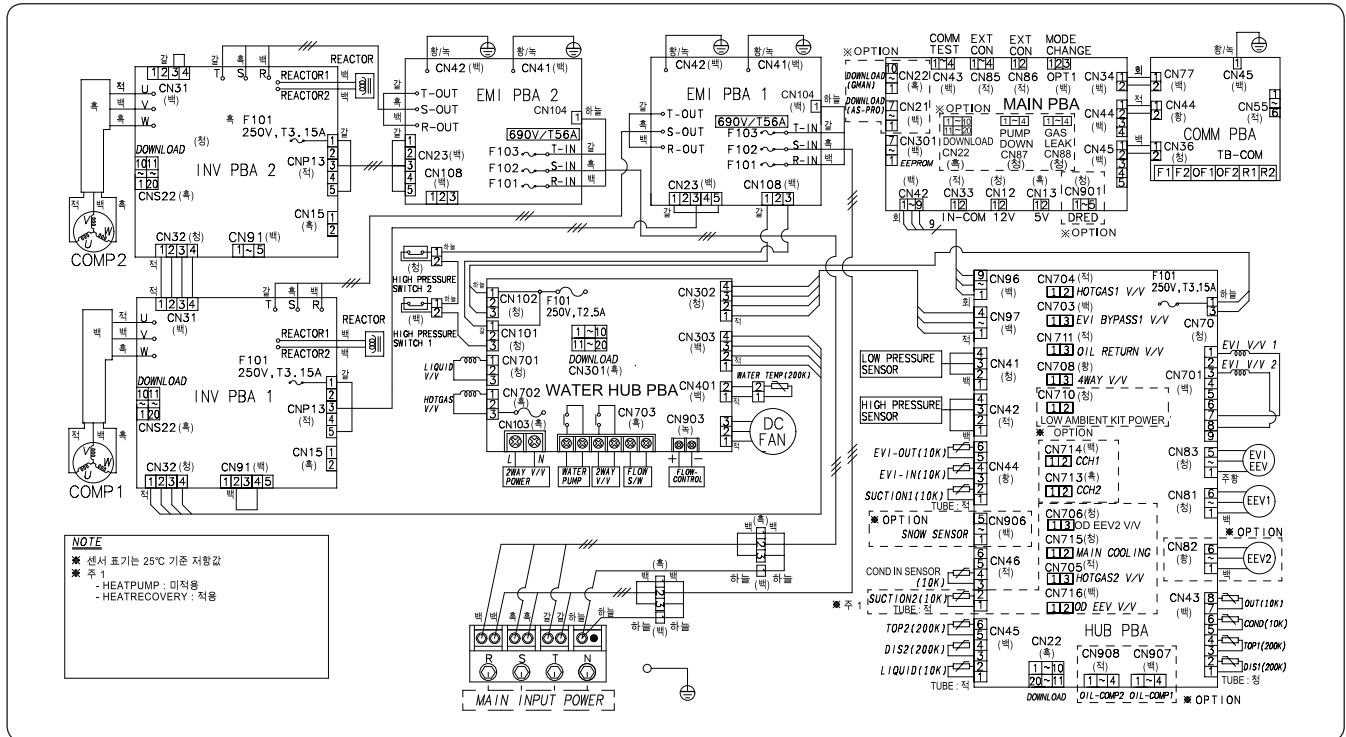

INV PBA1	Printed circuit board(Inverter PBA1)	EEV1	Electrical Expansion Valve 1	LIQUID(10K)	Temp. Sensor (Liquid Tube Temp_10Kohm)
INV PBA2	Printed circuit board(Inverter PBA2)	EEV2	Electrical Expansion Valve 2	HOTGAS1 V/V	Solenoid Valve (Hot Gas Bypass1)
EMI PBA1	Printed circuit board(Noise Filter1)	EVI-OUT(10K)	Temp. Sensor (EVI-out_10kohm)	EVI BYPASS V/V	Solenoid Valve (EVI Bypass)
EMI PBA2	Printed circuit board(Noise Filter2)	EVI-IN(10K)	Temp. Sensor (EVI-in_10kohm)	RETURN V/V	Solenoid Valve (Accumulator Oil Return)
WATER HUB PCB	Printed circuit board(Water related load control)	SUCTION1(10K)	Temp. Sensor (Suction Temp.1_10Kohm)	4WAY V/V	Solenoid Valve (4Way Valve)
MAIN PBA	Printed circuit board(main)	SUCTION2(10K)	Temp. Sensor (Suction Temp.2_10Kohm)	CCH1	Crank Case Heater(Comp1)
HUB PBA	Printed circuit board(hub)	SNOW SENSOR	SNOW SENSOR	CCH2	Crank Case Heater(Comp2)
COMM PBA	Printed circuit board(Communication)	OIL-COMP1	Oil-Sensor (Compressor1)	MAIN COOLING	Solenoid Valve (Main Cooling)
COMP1	Motor (Compressor1)	OIL-COMP2	Oil-Sensor (Compressor2)	HOTGAS2 V/V	Solenoid Valve (Hot Gas Bypass2)
COMP2	Motor (Compressor2)	OUT(10K)	Temp. Sensor (Ambient Temp_10Kohm)	OD EEV V/V	Solenoid Valve (Outdoor EEV)
FAN1	Motor (Outdoor Fan1)	COND(10K)	Temp. Sensor (Cond Out Temp_10Kohm)	690V/T56A	FUSE(Noise Filter)
FAN2	Motor (Outdoor Fan2)	TOP1(200K)	Temp. Sensor (Compressor Top1_200Kohm)	MODE CHANGE	Connector (Remote switching cool/heat selector)
EVI V/V 1	Solenoid Valve(EVI 1)	TOP2(200K)	Temp. Sensor (Compressor Top2_200Kohm)	EXT CON	Connector (Output EXT CON)
EVI V/V 2	Solenoid Valve(EVI 2)	DIS1(200K)	Temp. Sensor (Discharge Temp.1_200Kohm)	ERROR/COMP EXT	Connector (Output ERROR/COMP EXT CON)
EVI EEV	Enhanced Vapor Injection Electrical Expansion Valve	DIS2(200K)	Temp. Sensor (Discharge Temp.2_200Kohm)		

NOTE

- This wiring diagram applies only to the water-cooled DVM S Water.
- Colors BLK: black, RED: red, BLU: blue, WHT: white, YEL: yellow, BRN: brown, SKY: skyblue
- When operating, don't short circuit the protection device (High Pressure switch)
- For connection wiring indoor-outdoor transmission F1-F2, outdoor-outdoor transmission OF1-OF2, refer to the installation manual.
- Protective earth (screw), connector, : The wire quantity

7. Sound Level

Summary

Single

Capacity		Model	Sound Pressure dB(A)		Sound Power (dBA)
HP	KW		Cooling	Heating	
8	22.4	AM080FXWANR	48	51	70
10	28.0	AM100FXWANR	48	51	70
12	33.6	AM120FXWANR	50	52	70
20	56.0	AM200FXWANR	51	52	73
30	84.0	AM300KXWANR	56	58	75

Module (Premium energy efficiency type)

Capacity		Model	Sound Pressure dB(A)		Sound Power (dBA)
HP	KW		Cooling	Heating	
16	44.8	AM160FXWANR2	51	54	73
18	50.4	AM180FXWANR2	51	54	73
22	61.6	AM220FXWANR2	52	55	73
24	67.2	AM240FXWANR2	53	55	73
26	72.8	AM260FXWANR2	53	56	75
28	78.4	AM280FXWANR2	53	55	75
30	84.0	AM300FXWANR2	53	55	75
32	89.6	AM320FXWANR2	54	55	75
34	95.2	AM340FXWANR2	54	56	75
36	100.8	AM360FXWANR2	54	56	76
38	106.4	AM380FXWANR2	54	56	76
40	112.0	AM400FXWANR2	54	55	76
42	117.6	AM420FXWANR2	55	56	76
44	123.2	AM440FXWANR2	55	57	76
48	134.4	AM480FXWANR2	55	56	77
50	140.0	AM500FXWANR2	55	56	77
52	145.6	AM520FXWANR2	55	57	77
60	168.0	AM600FXWANR2	56	57	78

7. Sound Level

Summary

Module (Premium compact type)

Capacity		Model	Sound Pressure dB(A)		Sound Power (dBA)
HP	KW		Cooling	Heating	
38	106.4	AM380FXWANR1	57	59	77
40	112.0	AM400FXWANR1	57	59	77
42	117.6	AM420FXWANR1	57	59	77
46	128.8	AM460FXWANR1	58	60	78
48	134.4	AM480FXWANR1	58	60	78
50	140.0	AM500FXWANR1	58	60	78
52	145.6	AM520FXWANR1	58	60	78
54	151.2	AM540FXWANR1	58	60	78
58	162.4	AM580FXWANR1	58	60	78
60	168.0	AM600FXWANR1	60	62	79
62	173.6	AM620FXWANR1	58	60	78
68	190.4	AM680FXWANR1	60	62	79
70	196.0	AM700FXWANR1	60	62	79
80	224.0	AM800FXWANR1	60	62	80
90	252.0	AM900FXWANR1	61	63	80


NOTE

- Sound Pressure Level
 - Sound Pressure level is obtained in an anechoic room.
 - Sound Pressure level is a relative value, depending on the distance and acoustic environment.
 - Sound Pressure level may differ depending on operation condition.
 - dBA = A-weighted sound power level.
 - Reference acoustic pressure 0 dB = 20μPa
- Sound Power Level
 - Sound power level is an absolute value that a sound source generates.
 - dBA = A-weighted sound power level.
 - Reference power: 1pW.
 - Measured according to ISO 3741.

7. Sound Data

Sound Pressure level


Unit: dB(A)

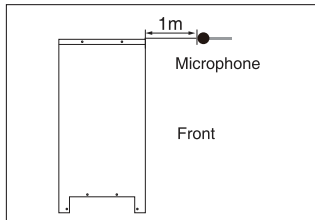


Model	Cooling
AM080FXWA**	48
AM100FXWA**	48
AM120FXWA**	50
AM200FXWA**	51
AM300KXWA**	56

NR Curve


1) AM080FXWA**

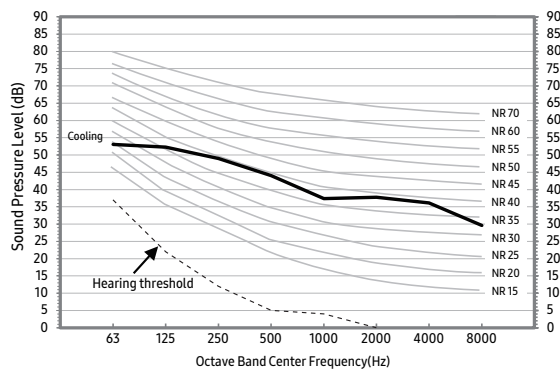


2) AM100FXWA**

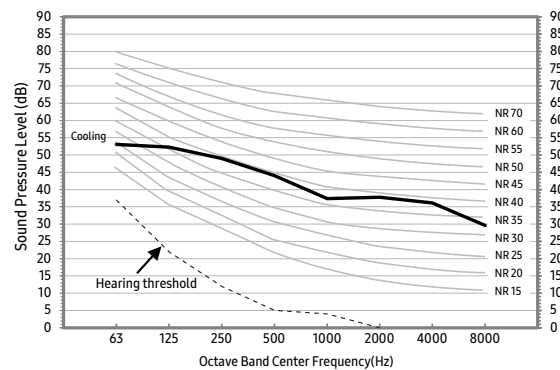


3) AM120FXWA**

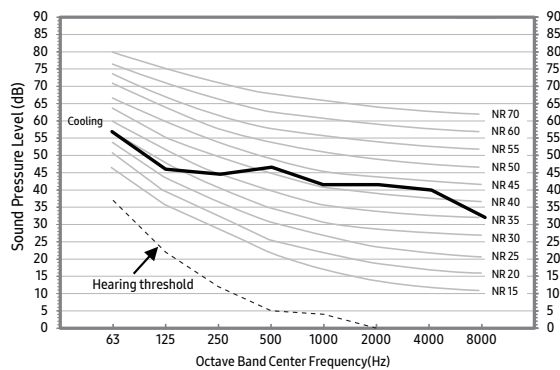

4) AM200FXWA**

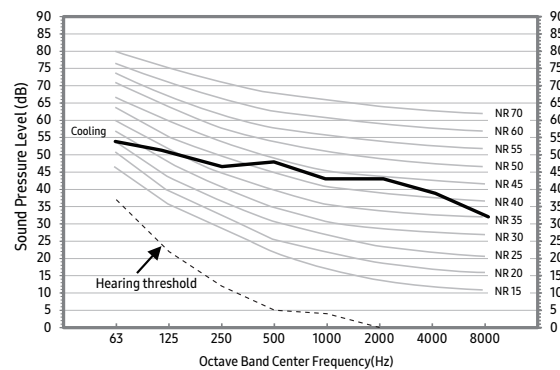

5) AM300KXWA**

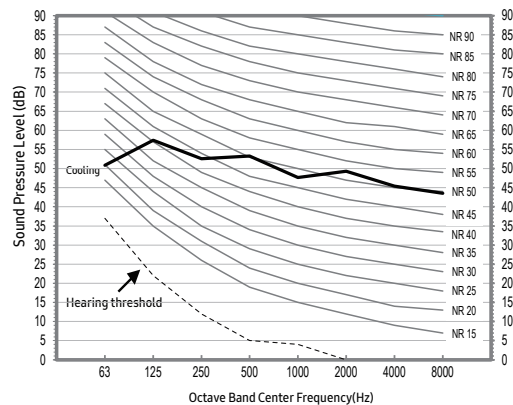


7. Sound Data

Sound Power Level


Unit: dB(A)

Model	Power
AM080FXWA**	70
AM100FXWA**	70
AM120FXWA**	70
AM200FXWA**	73
AM300KXWA**	75


1) AM080FXWA**

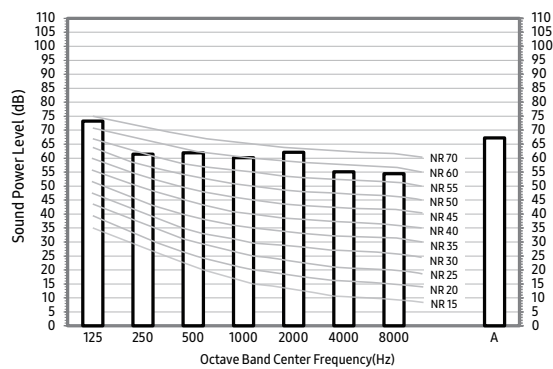


2) AM100FXWA**

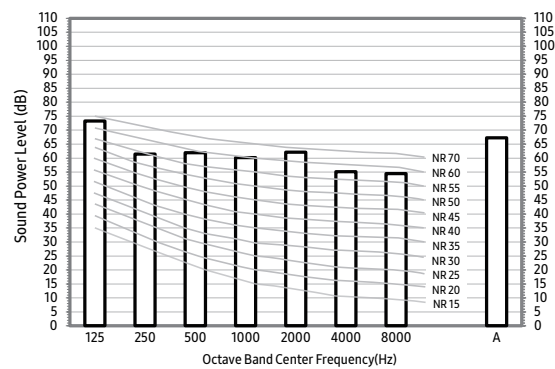


3) AM120FXWA**

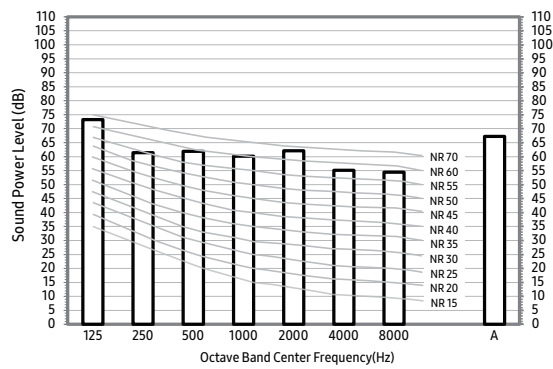

4) AM200FXWA**

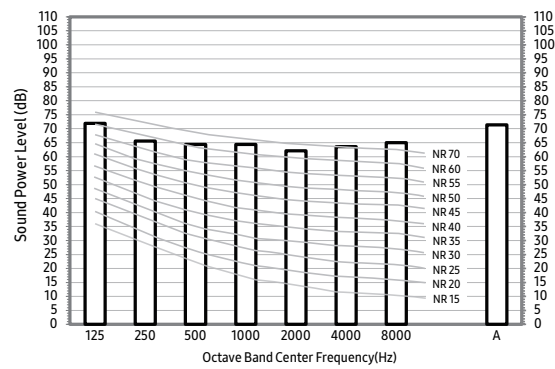


5) AM300KXWA**

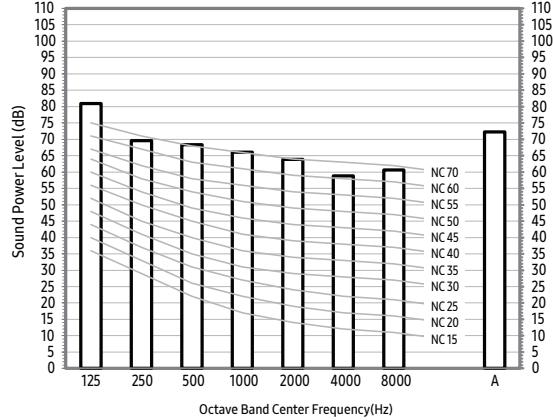

8. Operating Range


Cooling

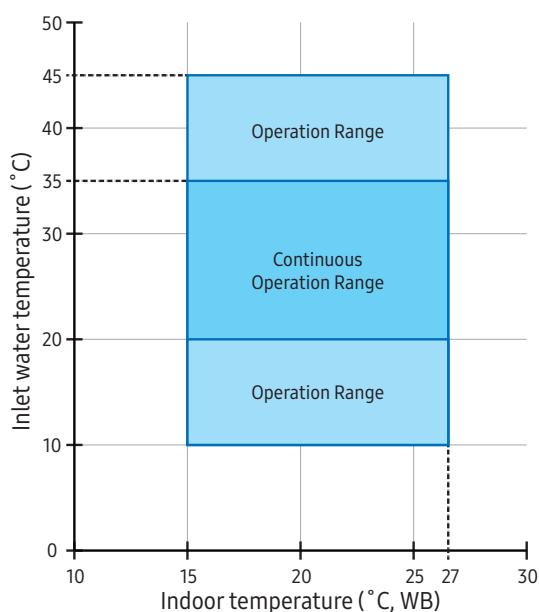

NOTE

- In the range except for the continuous operation range, the protection control can be active depending on the heat source flow rate. (It is not a failure but a way of cycle protection against hot or cold water.)

Heating

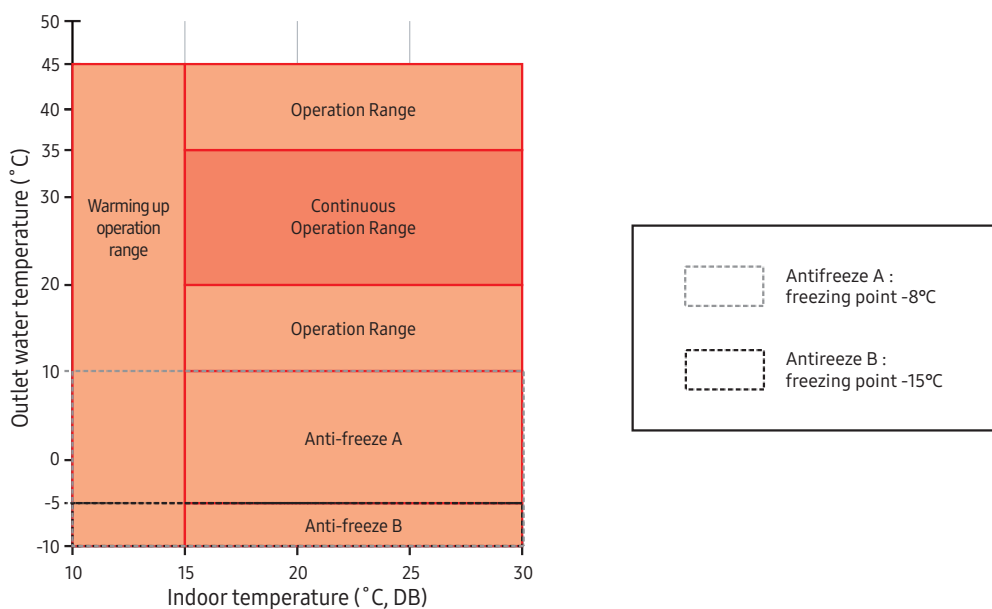


NOTE

- In the range except for the continuous operation range, the protection control can be active depending on the heat source flow rate. (It is not a failure but a way of cycle protection against hot or cold water.)
- For use in the antifreeze condition, the antifreeze concentration must be rigidly managed.

8. Operating Range

Heat Recovery

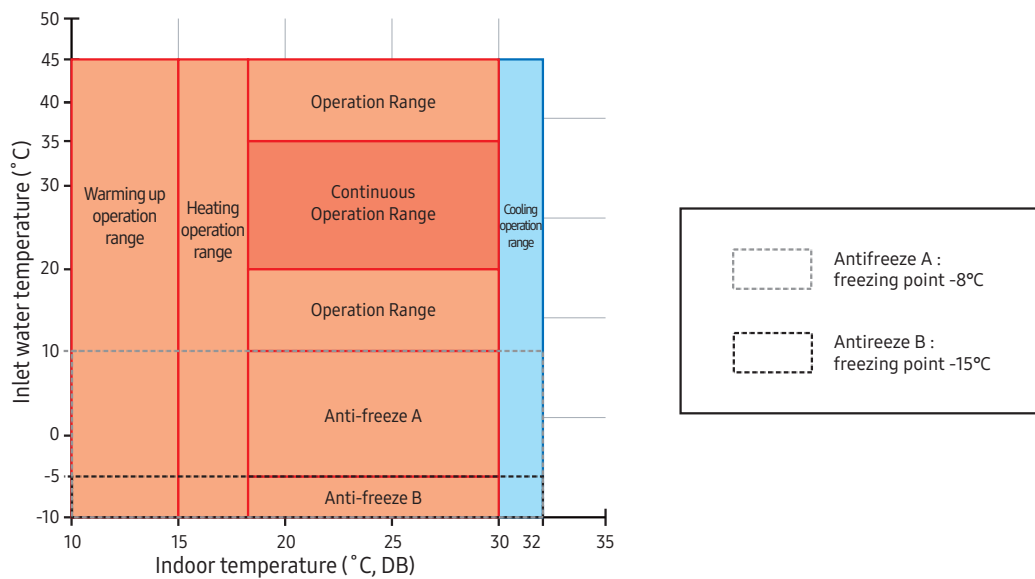

NOTE

- In the range except for the continuous operation range, the protection control can be active depending on the heat source flow rate. (It is not a failure but a way of cycle protection against hot or cold water.)
- For use in the antifreeze condition, the antifreeze concentration must be rigidly managed.

Design standard

Type	Circulating water	Operation	Inlet water temperature (°C)		
			Standard	Main usage	Operation limit
Heat source water	Water loop	Cooling	30	20~35	10~45
		Heating	20	20~35	
Ground heat source ¹⁾	Ground water	Cooling	15	15~35	Cooling: 10~45 Heating: -5~45 (Heating: -5~45) ²⁾
		Heating	10	5~25	
	Ground loop	Cooling	25	15~35	
		Heating	5	5~25	

1) Anti-freeze must be used when temperature of water inlet for heating is below 10°C or ground heat is used. Maintain appropriate concentration level of anti-freeze according to temperature of water inlet.

2) Strict management of anti-freeze concentration level is required. Consult Samsung before application.




Anti-freeze standard

Type of anti-freeze (Based on 15°C)	Concentration [% Wt.]	Freezing temperature [°C]	Density [kg/m ³]
Ethylene glycol	10	-3.2	1014.87
	20	-7.8	1031.39
	30	-14.1	1047.07
	40	-22.3	1061.65
Propylene glycol	10	-3.3	1009.75
	20	-7.1	1020.91
	30	-12.7	1030.51
	40	-21.1	1038.65

8. Operating Range

Water Flow rate

Section	Water Flow Rate (LPM)				
	8HP	10HP	12HP	20HP	30HP
Standard condition	80	96	114	190	285
Operation range	48~96	58~115	68~137	114~228	170~342

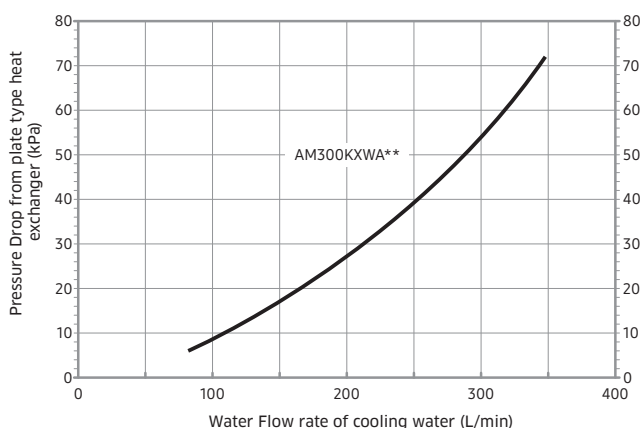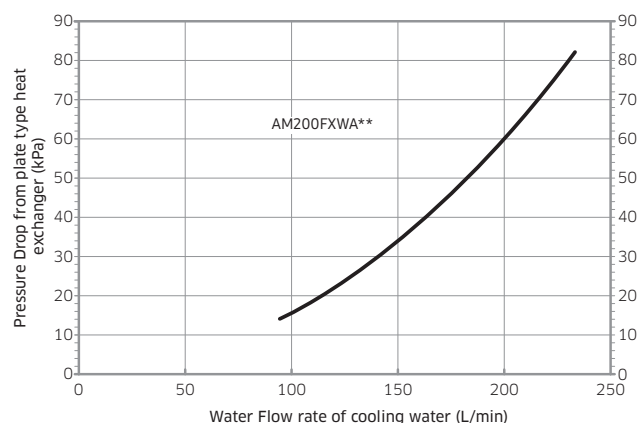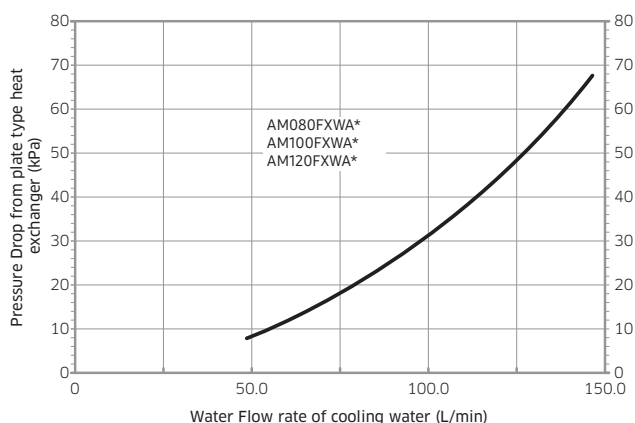


NOTE

- When the water flow rate is out of the operation range, stop the outdoor unit and take care of the cause before restarting the operation. (Allowable range: 60~120% of the standard water flow rate)
- For the piping work, set the pump capacity considering the pressure drop of the plate heat exchanger to maintain a proper flow rate.


9. Piping Diagram

AM080/100/120FXWA**

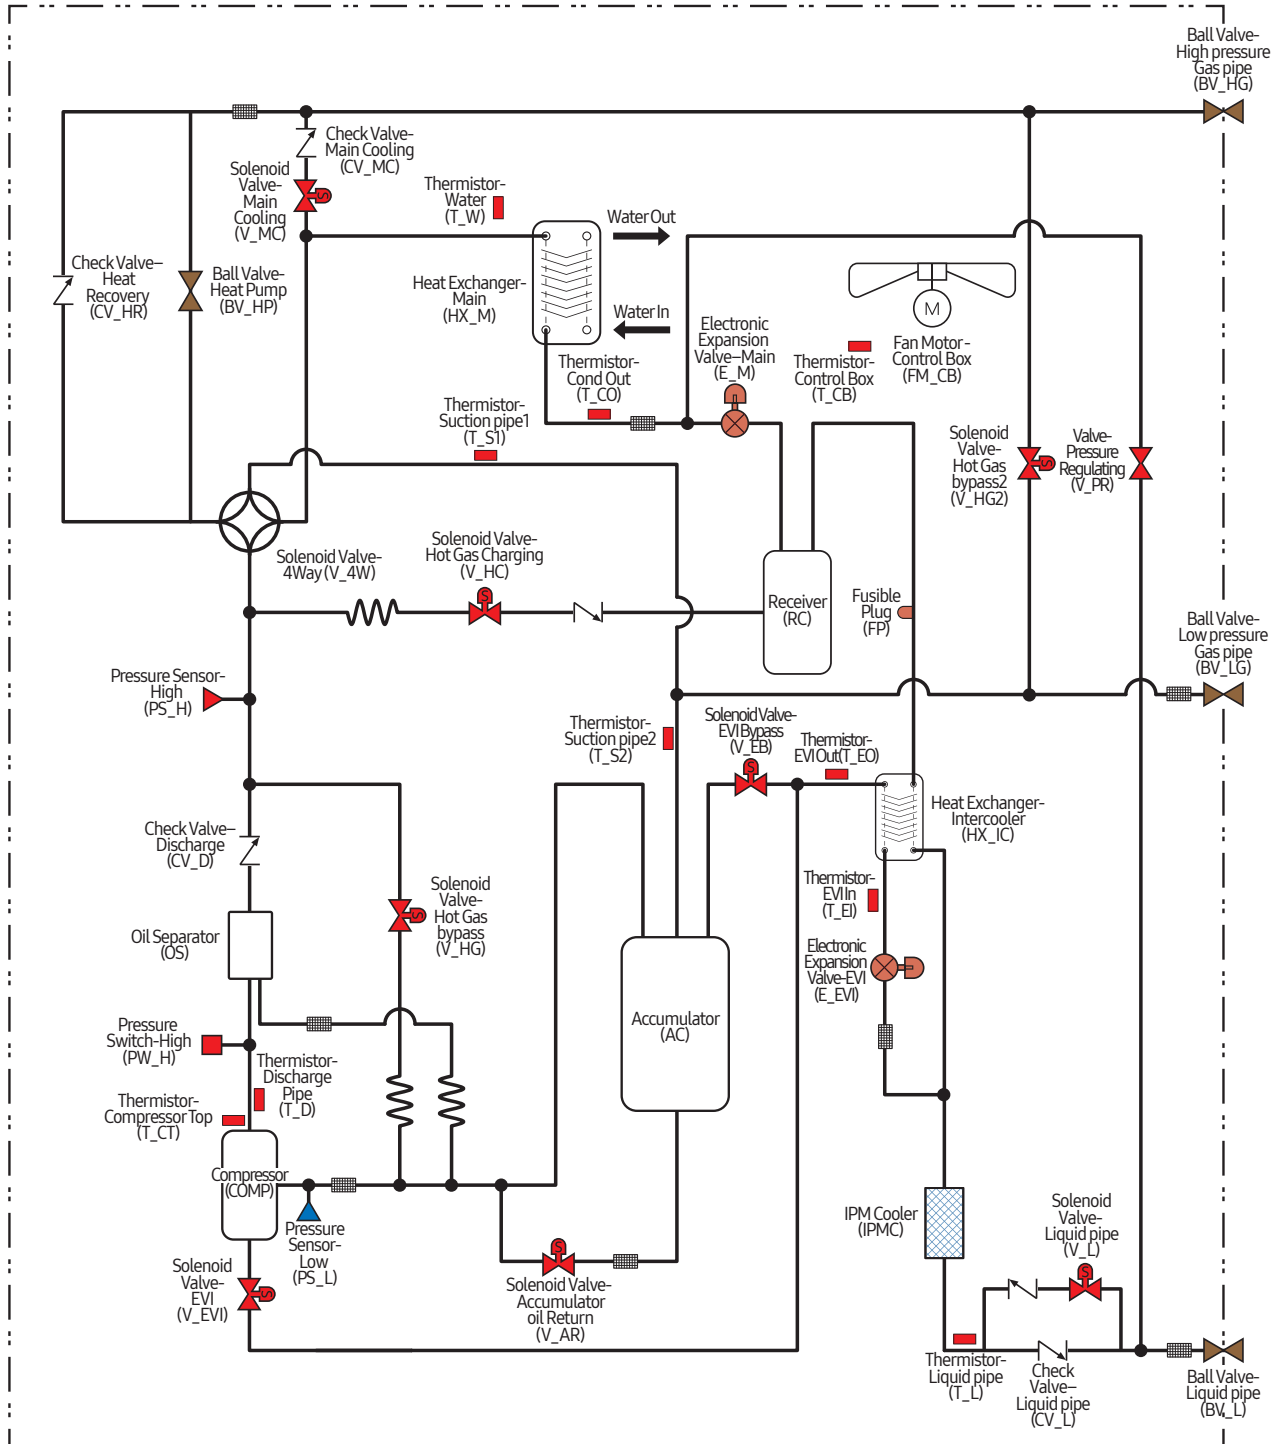


9. Piping Diagram

AM200FXWA**

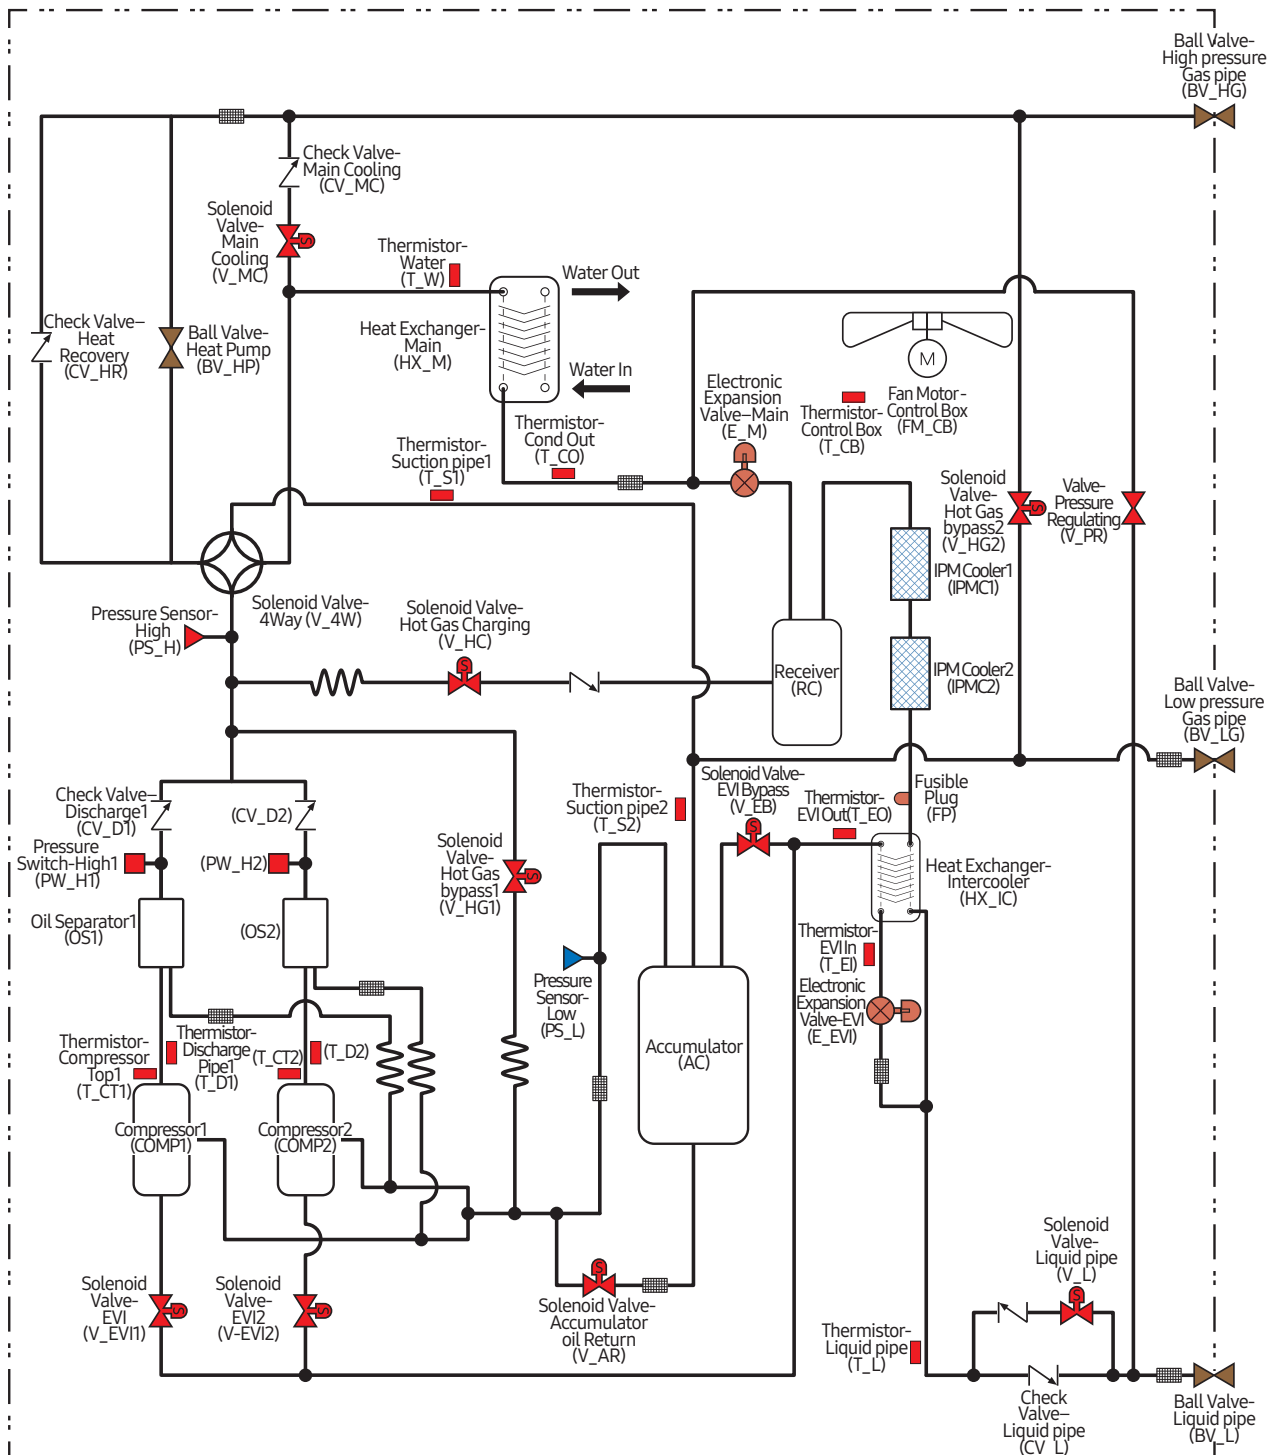

9. Piping Diagram

AM300KXWA**

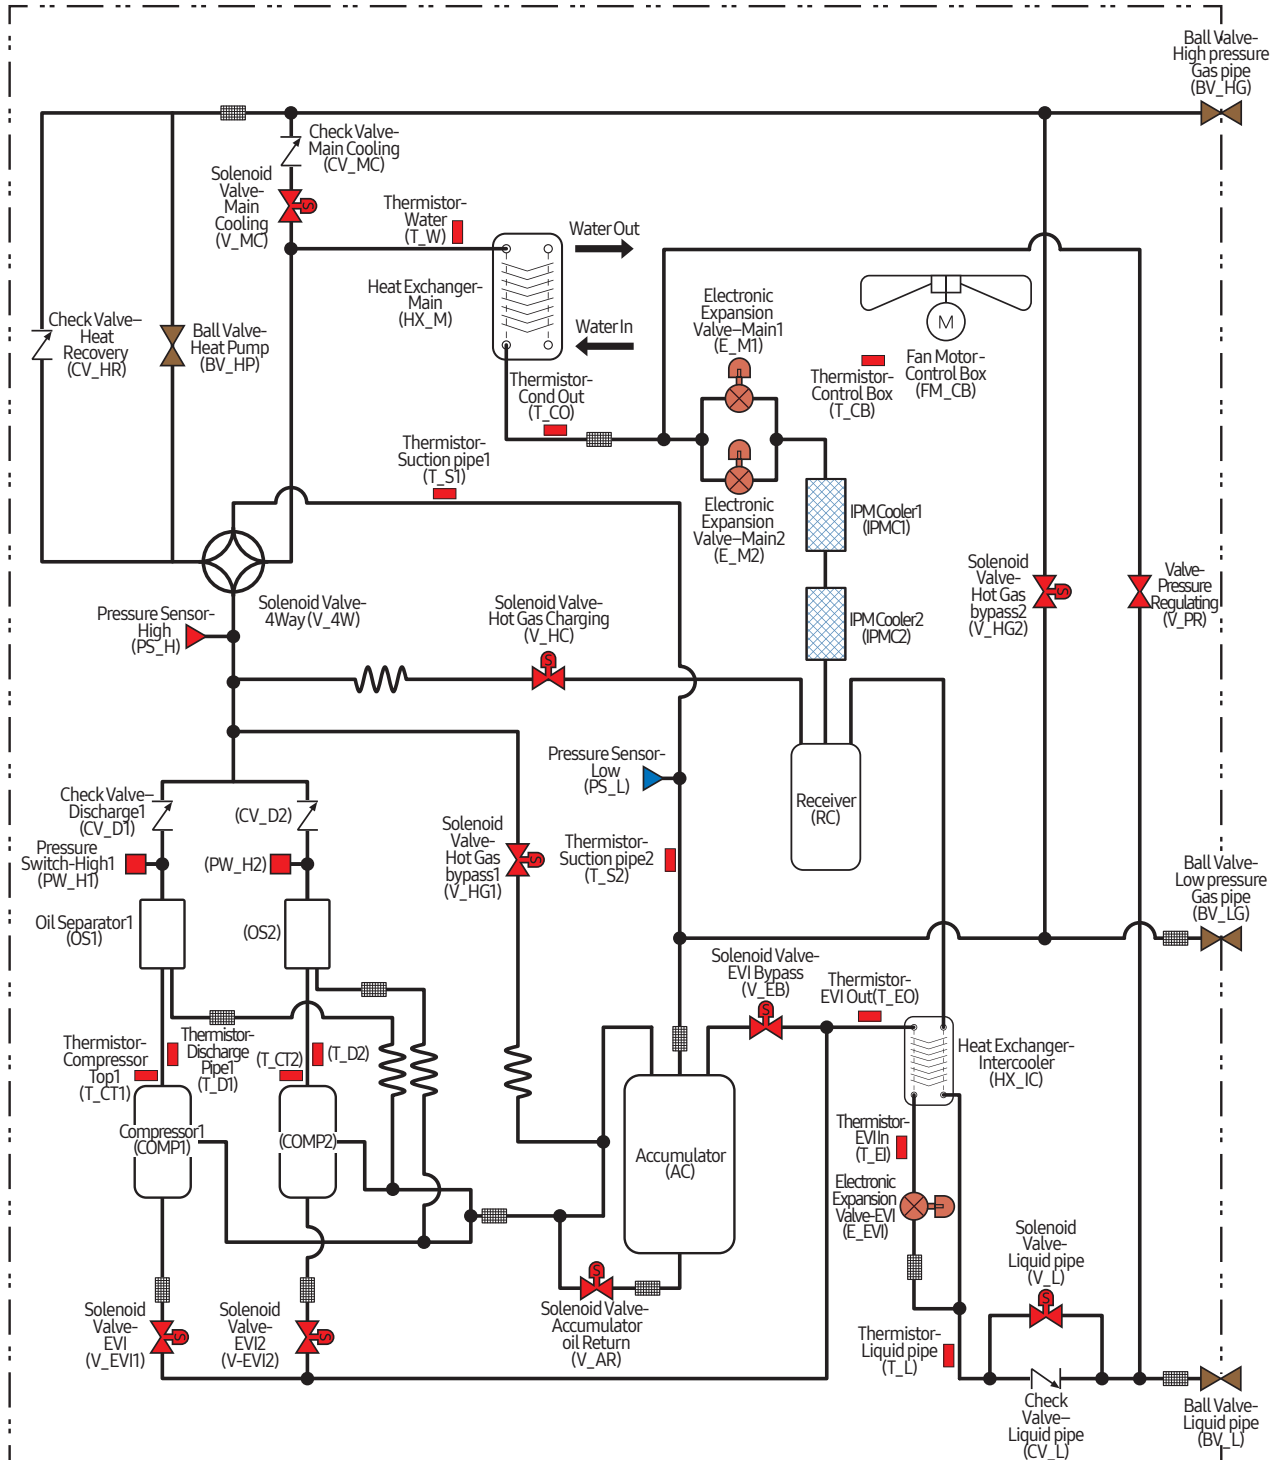

10. Installation


Electrical wiring work

Specification of the circuit breaker and power cable

Power Supply cords of parts of appliances for outdoor use shall not be lighter than polychloroprene sheathed flexible cord. (Code designation IEC:60245 IEC 66 / CENELEC: H07RN-F)

※ When installing outdoor units in module, select the power supply cable according to the sum of outdoor unit capacity. (Refer to the table for each model)

ex) Outdoor unit installation (AM100FXW* + AM120FXW*)

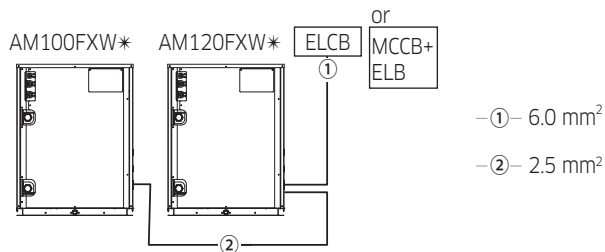

- This device is intended for the connection to a power supply system with a maximum permissible system impedance shown in the table (on the left page) at the interface point (power service box) of the user's supply.
- The user must ensure that this device is connected only to a power supply system which fulfills the requirement above. If necessary, the user can ask the public power supply company for the system impedance at the interface point.
- This equipment complies with IEC 61000-3-12 provided that the short-circuit power S_{sc} is greater than or equal to $S_{sc}(*2)$ at the interface point between the user's supply and the public system. It is the responsibility of the installer or user of the equipment to ensure, by consultation with the distribution network operator if necessary, that the equipment is connected only to a supply with a short-circuit power S_{sc} greater than or equal to $S_{sc}(*2)$.

[$S_{sc}(*2)$]


Model	S_{sc} [MVA]
AM080FXW***	3.9
AM100FXW***	3.9
AM120FXW***	4.8
AM200FXW***	7.7
AM300KXWA**	11.5

10. Installation



Caution for electrical work


- You must install ELCB or MCCB + ELB
 - ELCB: Earth leakage breaker
 - MCCB: Molded case circuit breaker
 - ELB: Earth leakage breaker
- Do not operate the outdoor unit before completing the refrigerant pipe work.
- Do not disconnect or change the cable inside the product. It may cause damage to the product.
- Specification of the power cable is selected based on following installation condition; culvert installation/ ambient temperature 30 °C/ single multi conductor cables. If the condition is different from the ones stated, please consult an electrical installation expert and re-select the power cable.
 - If the length of power cable exceed 50m, re-select the power cable considering the voltage drop.
- Use a power cable made out of incombustible material for the insulator (inner cover) and the sheath (outer cover).
- Do not use the power cable with the core wire exposed due to insulator damage occurred during removal of the sheath. When the core wire is exposed, it may cause fire.

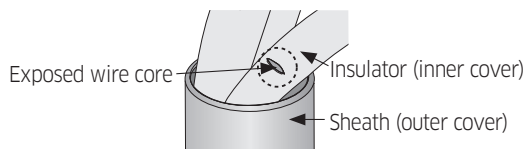

<The example of exposed core wire>

Power and communication cable configuration

- ▶ Main power and the ground cable must be withdrawn through the knock-out hole on the bottom-right or right side of the cabinet.
- ▶ Withdraw the communication cable from the designated knock-out hole on the bottom-right side of the front part.
- ▶ Install the power and communication cable using separate cable protection tube.
- ▶ Fix a protection tube to the knock-out hole on the outdoor unit by using a CD connector or bushing. Make sure to use insulating bushing.
- ▶ Make sure that power and communication cables do not block the front panel.

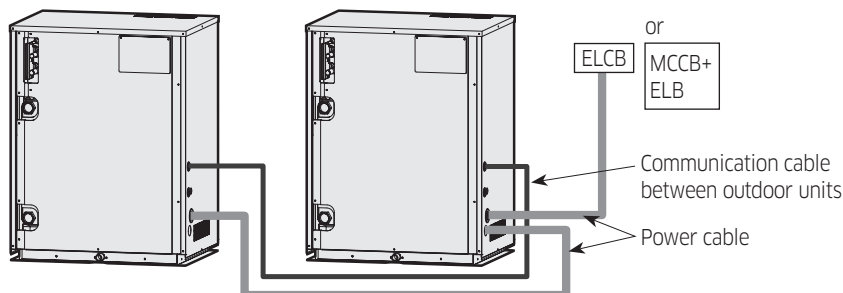

10. Installation

Specification of the protection tube

Name	Temper grade	Applicable conditions
Flexible PVC conduit	PVC	When the protection tube is installed indoor and not exposed to outside, because it is embedded in concrete structure
Class 1 flexible conduit	Galvanized steel sheet	When the protection tube is installed indoor but exposed to outside so there are risk of damage to the protection tube
Class 2 flexible conduit	Galvanized steel sheet and Soft PVC compound	When the protection tube is installed outdoor and exposed to outside so there are risk of damage to the protection tube and extra waterproof is needed




Caution for perforating the knock-out hole

- Perforate a knock-out hole by punching it with a hammer.
- After perforating the knock-out hole, apply rust resisting paint around the hole.
- When you need to pass the cables through the knock-out hole, remove burrs on the hole and protection the cable with a protection tape or bushing etc.

Power wiring diagram

Supplying 3 phase 4 wires (380-415 V~)

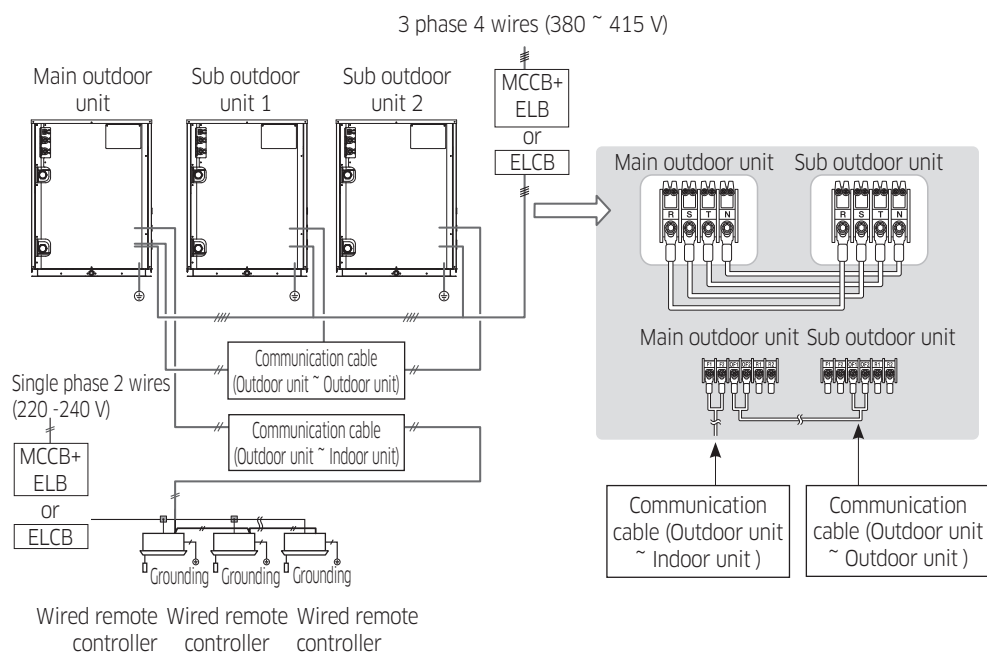


- ▶ Connect a power cable of the outdoor unit after checking that R-S-T-N (3 phase 4 wire) is properly connected. (If the 380-415 V power is supplied to the N phase, PCB and other electrical part will be damaged.)
- ▶ Communication cable between indoor and outdoor units and communication cable between outdoor units has no polarity.
- ▶ Arrange the cables with a cable tie.
- ※ ELCB and ELB must be installed since there is risk of electric shock or fire when they are not installed.

10. Installation

Connecting the power terminal

- ▶ Connect the cables to the terminal board with solderless ring terminals.
- ▶ Properly connect the cables by using certified and rated cables and make sure to fix them properly so that external force is not applied to the terminal.
- ▶ Use a driver and wrench that can apply the rated torque when tightening the screws on the terminal board.
- ▶ Tighten the terminal screws by complying rated torque value. If the terminal is loose, fire can occur due to arc heat generation and if the terminal is too tight, terminal board could get damaged.

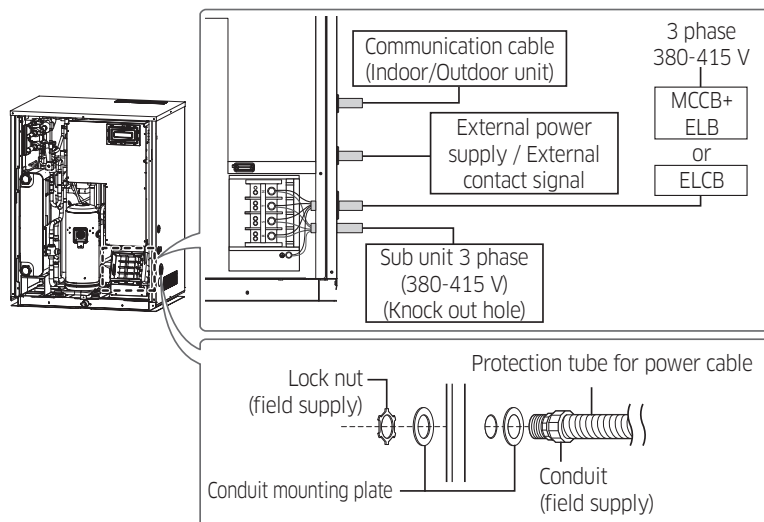

Screw	Tightening torque for terminal (N•m)	
M4	1.2~1.8	Single phase (220-240 V) power cable
M8	5.5~7.3	3 phase (380-415 V) power cable




- When removing the outer sheath of the power supply cable, be careful not to scratch the inner sheath of the cable.
- Make sure that more than 20mm of the outer sheath of the indoor unit power and communication cable are inside the electrical component box.
- Install the communication cable separately from power cable and other communication cables.

10. Installation

Installing the Solution device

► When the number of indoor units installed with the outdoor unit is 16 or less



R2	Solution device terminal
R1	
OF2	Communication cable terminal (Outdoor unit ~ Outdoor unit)
OF1	
F2	Communication cable terminal (Outdoor unit ~ Indoor unit)
F1	

※ When connecting the communication cable, use a wire holder to fix it.

→ Location of the interface module

※ To connect old communication type upper level controller, interface module must be installed. For detail instruction of installation, refer to the installation manual of corresponding interface module.


Space requirement for installation

Minimum space requirement for installation

- Secure minimum installation space as shown in the following figures, considering service area and path for people etc.
 - If the installation space is narrow, installer or other worker may get injured during work and may also cause problem to the product.
- If the conditions does not meet the space requirement in this manual, please contact qualified installation agent.


Single installation

When the water pipe passes through top of the product

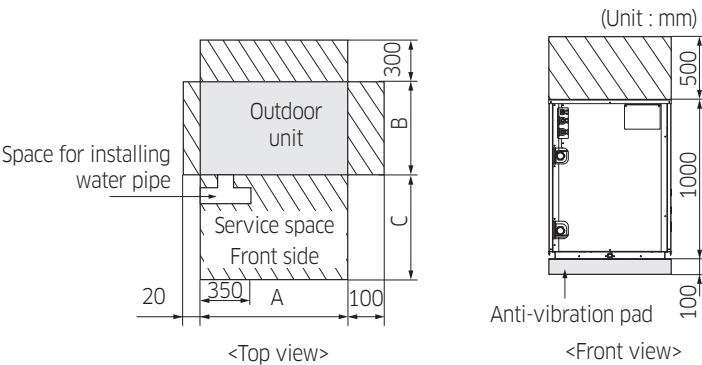


10. Installation

When the water pipe passes through back of the product

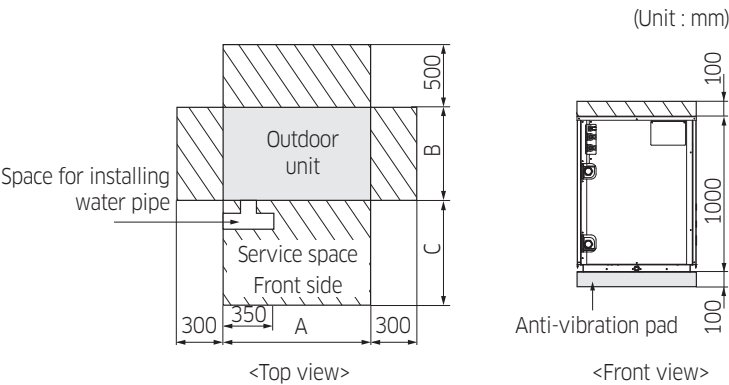

Module or continuous installation

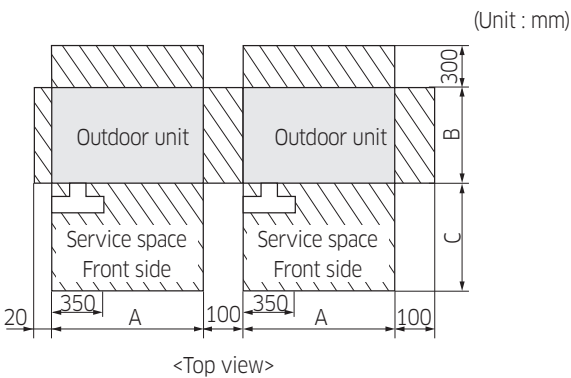


Model name of outdoor unit	A	B	C
AM080/100/120FXWA**	770	545	600
AM200FXWA** / AM300KXWA**	1100	545	600



- If the outdoor unit is needed to be installed close to the walls unavoidably, prevent the vibration from being transferred to the walls with cushioning materials etc.

10. Installation

Double installation

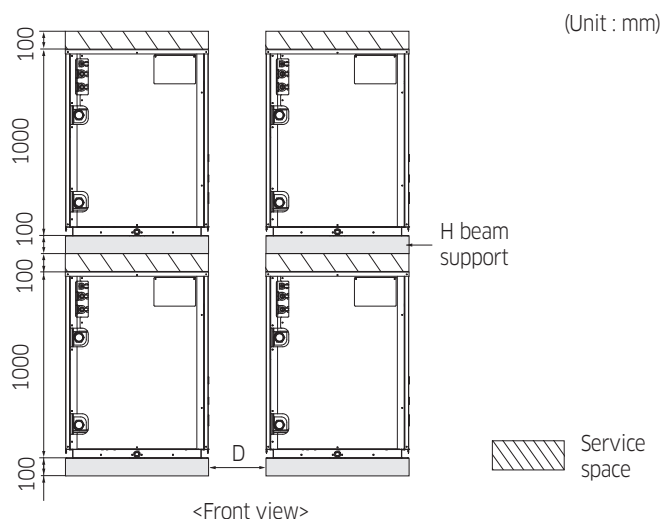

- ▶ For the double installation, service space is required for the front, rear, and sides of the product. For the size of the service space, refer to the service space size of single, module or continuous installation.
- ▶ Clear enough space for D (space between outdoor units), so that water pipes connected to outdoor units does not block the front side of the outdoor units next to it.

Base construction and installation of the outdoor unit


CAUTION • Make sure to remove the wooden pallet before installing the outdoor unit. If you do not remove the wooden pallet, there is risk of fire during welding the pipes. If the outdoor unit is installed with wooden pallet on, and it was used for long period time, wooden palette may break and cause electrical hazard or high pressure may damage the pipes.

- ※ Fix an outdoor unit firmly on the base ground with anchor bolts.
 - ※ Manufacturer is not responsible for the damage occurred by not following the installation standards.
1. Make sure that the height of the base ground is 150 mm or higher to protect the outdoor unit from rain water or other external conditions. Also, install a draining pit around the base ground and connect the drain pipe to the drainage.
 2. Considering the vibration and weight of the outdoor unit, strength of the base ground must be strong to prevent noise and the top surface of it should be flat.
 3. Base ground should be 1.5 times larger than the bottom of the outdoor unit.
 4. Outdoor unit must be fixed firmly so that it can withstand the wind speed of 30 m/s. If you cannot fix the outdoor unit on the base ground, fix it by side or use extra structure.
 5. In heating operation, defrost water may form so you must really care about the drainage and waterproofing the floor. To prevent defrost water from stagnating or freezing, construct a drainage with over 1/50 slope. (Ice may form on the floor in winter time.)
 6. It is necessary to add wire mesh or steel bar during concrete construction for the base ground to prevent damages or cracks.


10. Installation

7. When installing multiple outdoor units at the same place, construct a H beam or an anti-vibration frame on the base ground to install the outdoor unit.
8. After installing a H beam or an anti-vibration frame, apply corrosion protection and other necessary coating.
9. When concrete construction for outdoor unit installation is completed, install an anti-vibration pad (t=20 mm or more) or an anti-vibration frame to prevent vibration of the outdoor unit from transferring to the base ground.
10. Place the outdoor unit on a H beam or an anti-vibration frame and fix it with the bolt, nut and washer. (The bearing force has to be over 3.5 kN)


Foundation



Outdoor unit installation

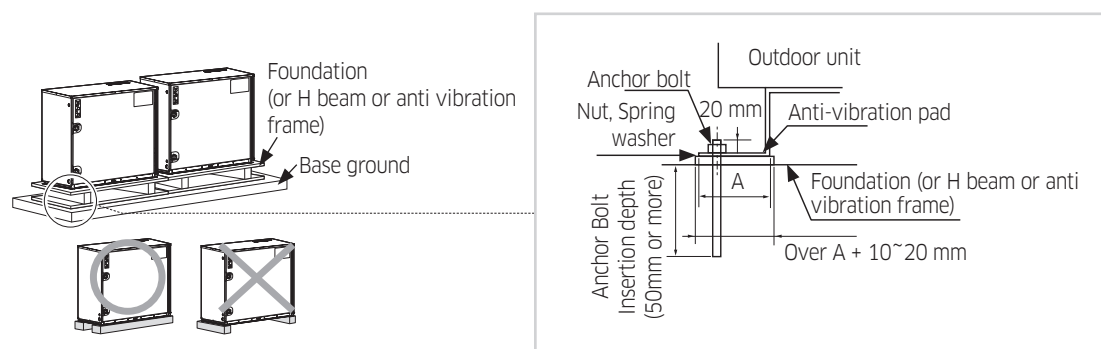

Fixing the outdoor unit

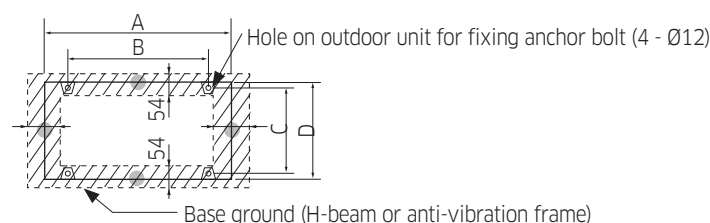

(Unit : mm)

Classification	Small type	Large type
Models	AM080/100/120FXWA**	AM200FXWA** / AM300KXWA**
A	770	1100
B	656	995
C	523	515
D	550	550

※ For adding the anti-vibration frame on the base ground, the specification for the fixing hole depends on the specification of the anti-vibration frame.

10. Installation

Refrigerant pipe installation



- When installing, make sure there is no leakage. When collecting the refrigerant, stop the compressor first before removing the connection pipe. If the refrigerant pipe is not properly connected and the compressor is working with the service valve open, the pipe sucks the air in which makes the pressure inside of the refrigerant cycle abnormally high which may lead to explosion and injury.


Refrigerant pipe work

- The length of refrigerant pipe should be as short as possible and the height difference between an indoor and outdoor unit should be minimized.
- Piping work must be done within allowable piping length, height difference, and the allowable length after branching.
- The pressure of the R-410A is high. Use only certified refrigerant pipe and follow the installation method.
- After installing the pipes, calculate the total length of the pipe to check if additional refrigerant is needed. When you need to charge the additional refrigerant, make sure to use R-410A refrigerant.
- The inside of the refrigerant pipe must be clean and contain no harmful ions, oxides, dust, iron particles or moisture.
- Use tools and accessories compatible with R-410A refrigerant gas.

Tool	Installation process/purpose	Compatibility with conventional tool	
Pipe cutter	Refrigerant pipe installation	Pipe cutting	Compatible
Flaring tool		Pipe flaring	
Refrigerant machine oil		Apply refrigerant oil on flared part	Exclusive ether oil, ester oil, alkali benzene oil or synthetic oil
Torque wrench		Connect flare nut with pipe	Compatible
Pipe bender		Pipe bending	
Nitrogen gas	Air tightness test	Prevent oxidation within the pipe	
Welder		Pipe welding	
Manifold gage	Air tightness test ~ additional refrigerant charging	Vacuuming, charging refrigerant and checking operation	Need exclusive one to prevent mixture of R-22 refrigerant oil use and also the measurement is not available due to high pressure
Refrigerant charging hose			Need exclusive one since there is risk of refrigerant leakage or contamination
Vacuum pump	Pipe drying		Compatible (Use products which contain the check valve to prevent the oil from flowing backward into the outdoor unit.) Use the one that can be vacuumed up to -100.7kpa(5Torr).
Scale for refrigerant charging			Compatible
Gas leak detector		Gas leak test	Need exclusive one (Ones used for R-134a is compatible)
Flare nut	Must use the flare nut supplied with the product. Refrigerant leakage may occur when the conventional flare nut for R-22 is used.		

10. Installation

Selecting refrigerant pipe

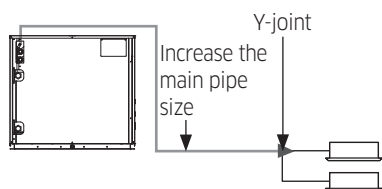

- ▶ Install the refrigerant pipe according to main pipe size of each outdoor unit capacity.
- ▶ When the pipe length (including elbow) between the outdoor unit and the farthest indoor unit exceeds 90m, the size of the pipe (main pipe) connecting the outdoor unit to the first branch joint must be increased by one grade.
- ▶ For HR System, when the pipe length (including elbow) between an outdoor unit and the farthest indoor unit exceeds 90 m, you must increase the size of the liquid pipe by one grade among the pipes(main pipe) which connects between the outdoor unit to the first branch joint

Main pipe size (Outer diameter, mm) If total pipe length is less than 90 m	Main pipe size (Outer diameter, mm) If total pipe length is 90 m or longer
9.52	12.70
12.70	15.88
15.88	19.05
19.05	22.22
22.22	25.40 note1)
28.58	31.75 note2)
34.92	38.10 note3)
41.28	53.98

Note1) If Ø 25.40 pipe is not available on site, use Ø 28.58 pipe.



Note2) If Ø 31.75 pipe is not available on site, use Ø 34.92 pipe.

Note3) If Ø 38.10 pipe is not available on site, use Ø 41.28 pipe

10. Installation

Pipe installation for an outdoor unit

- Please read the following instructions to connect the refrigerant pipe to an outdoor unit.
 - For H/P System, connect liquid and gas pipes to an indoor unit.
 - For HR System, connect liquid and high/low pressure gas pipes to a MCU. Close the internal heat pump valve and set the following option switch.
 - For module installation, make sure that each heat pump valve and K5 switch setting is adjusted according to each purpose. (When installing outdoor units in module, E573 error may occur when settings are different between outdoor units.)

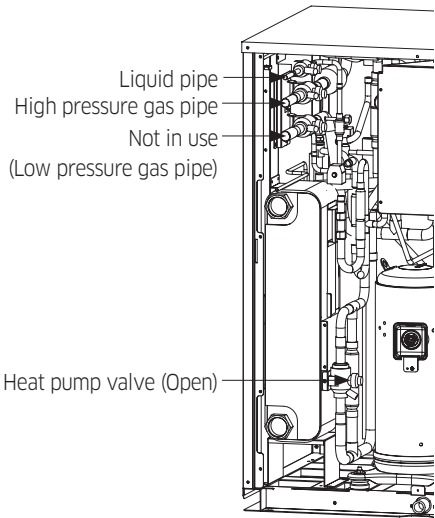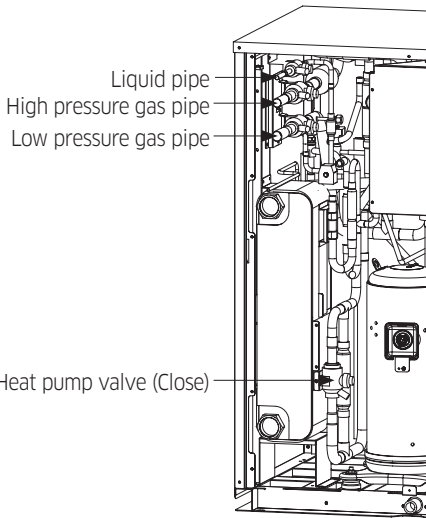Classification		H/P System	HR System
Service valve			
Heat pump valve		Open (Factory default)	Close (Set during installation)
Option switch	A Type PBA (K5)	ON (Factory default)	OFF (Set during installation)
	B Type PBA Key mode (K1+K2)	Set as "ht 00" (Factory default)	Set as "ht 01" (Set during installation)

※ Refer to the outdoor unit key function option switch and key function.








Caution for welding the pipe to an outdoor unit

- When welding the pipe, the unit may get damaged by the heat and flame from welding. Use a flame proofing cloth to protect the unit from a brazing fire or flame.
- The O-ring and Teflon packing inside service valve may get damaged by the heat from welding. Wrap the bottom side of the service valve with a wet cloth and weld it. Also, water dripping from the wet cloth may interrupt the welding. Make sure the water does not drip from the wet cloth.
- Make sure that connected pipes does not interrupt each other or make contact with the product. If they contact each other or contact with the outdoor unit, vibration will occur and it may cause damage to the pipes.
- When removing the sealed pipe on the bottom side of the service valve, cut it with a pipe cutter first and then start the welding. When the sealed pipe is welded without cutting, you may get injured by the refrigerant within the pipe.



10. Installation

Refrigerant pipe installation

- 2. Connect refrigerant pipes between outdoor units.
- ▶ To connect pipes between outdoor units, branch joints (that needs to be purchased separate) must be installed.
- ※ **For optimal distribution of the refrigerant, you must use Y-joint for connecting outdoor units. (Do not use T-joint)**
- ▶ When outdoor units are installed in module, there are no restrictions on the order of installation.

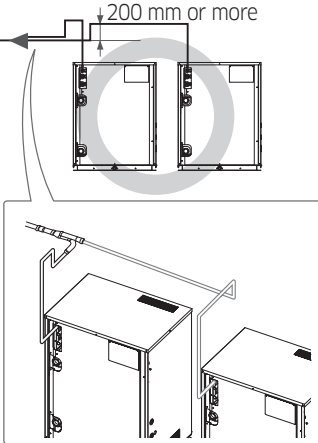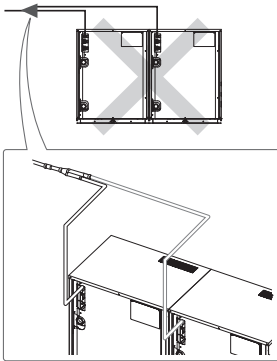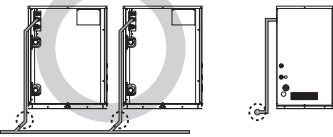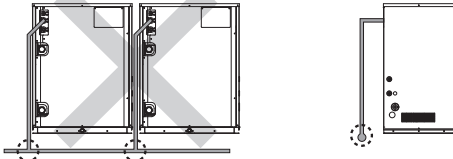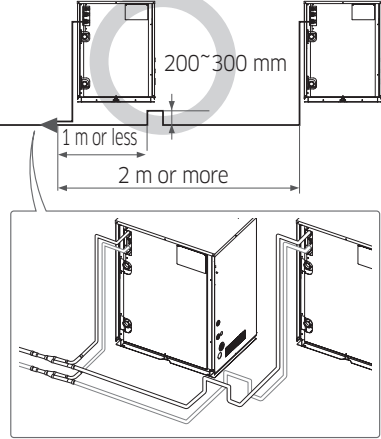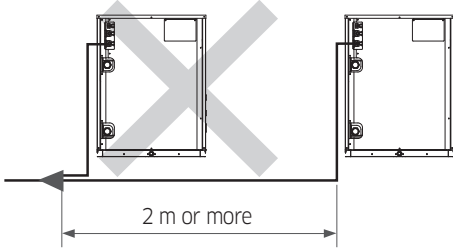Caution	Correct installation	Incorrect installation
When refrigerant pipe is installed at higher level than the pipe connection part of the outdoor unit, you must install a trap at the gas pipe.		
Branch joint between outdoor units must be installed horizontally.		
When the piping length between outdoor unit and the branch joint exceeds 2 m, install a vertical trap as show in the figure.		

10. Installation


Classification				Example		Remarks
Maximum allowable pipe length	Outdoor unit ~ Indoor unit	Actual pipe length (Equivalent length)	170 m and below (190 m and below)	Installing only with Y-joint	$a+b+c+d+e+f+g+p \leq 170 \text{ (190) m}$	Equivalent length - Y-joint: 0.5 m - Distribution header: 1 m
				Installing with Y-joint and distribution header	$a+b+h \leq 170 \text{ (190) m}$, $a+i+k \leq 170 \text{ (190) m}$	
				Installing only with distribution header	$a+i \leq 170 \text{ (190) m}$	
		Total length of pipe (m)	500 m or less	Installing only with Y-joint	$a+b+c+d+e+f+g+p+h+i+j+k+l+m+n \leq 500 \text{ m}$	
				Installing with Y-joint and distribution header	$a+b+c+d+e+f+g+h+i+j+k \leq 500 \text{ m}$	
				Installing only with distribution header	$a+b+c+d+e+f+g+h+i \leq 500 \text{ m}$	
	Outdoor unit ~ Outdoor unit (Module installation)	Pipe length	10 m or less	$r \leq 10 \text{ m}$, $s \leq 10 \text{ m}$, $t \leq 10 \text{ m}$		
		Equivalent length	13 m or less	$r \leq 13 \text{ m}$, $s \leq 13 \text{ m}$, $t \leq 13 \text{ m}$		
		High difference	1.5 m or less	$H5 \leq 1.5 \text{ m}$		
Maximum allowable height difference	Outdoor unit ~ Indoor unit	50/40 m Note 2)		$H1 \leq 50/40 \text{ m}$		
	Indoor unit ~ Indoor unit	50 m or less		$H2 \leq 50 \text{ m}$		
Maximum allowable length after branch joint	First branch joint ~ Farthest Indoor unit	Pipe length	45 m or less	$b+c+d+e+f+g+p \leq 45 \text{ m}$, $i \leq 45 \text{ m}$		
			45 m ~ 90 m note 1)	Required conditions must be satisfied		

EEV kit			Model name		Remarks
EEV kit ~ Indoor unit	Actual pipe length	2 m	MEV-E24SA	1 indoor	Apply to products without EEV (Wall mount & ceiling)
			MEV-E32SA		
		20 m or less	MXD-E24K132A	2 indoor	
			MXD-E24K200A		
			MXD-E32K200A		
			MXD-E24K232A	3 indoor	
			MXD-E24K300A		
			MXD-E32K224A		
			MXD-E32K300A		

※ Please refer to the EEV Kit manual.

10. Installation

Note 1) Required condition

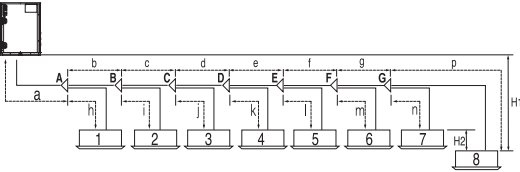
Classification	Condition	Example
First branch joint ~ Farthest Indoor unit	$45\text{ m} \leq b+c+d+e+f+g+p \leq 90\text{ m}$: Size of the branch pipe (b, c, d, e, f, g) must be increased by one grade	
Total length of extended pipe	If the size of the main pipe (pipe that connects between the outdoor unit ~ first branch joint) was not increased by one grade: $a+(b+c+d+e+f+g) \times 2 + h+i+j+k+l+m+n+p \leq 500\text{ m}$	
	If the size of the main pipe (pipe that connects between the outdoor unit ~ first branch joint) was increased by one grade: $(a+b+c+d+e+f+g) \times 2 + h+i+j+k+l+m+n+p \leq 500\text{ m}$	
Each Y-joint ~ Each indoor unit	$h, i, j, \dots p \leq 45\text{ m}$	
Difference between the distance of the outdoor unit to the farthest indoor unit and nearest indoor unit $\leq 45\text{ m}$ $(a+b+c+d+e+f+g+p)-(a+h) \leq 45\text{ m}$		

Note 2) When indoor unit is located at higher level than outdoor unit, allowable height difference is 40m, but when the indoor unit is located at lower level than outdoor unit, allowable height difference is 50 m.

* Total refrigerant amount of the system must be less than 100kg. If total refrigerant amount of system is over than 100kg, the system has to be divided into smaller system, each less than 100kg.


Installing the branch joint between outdoor units

Installation of outdoor joints

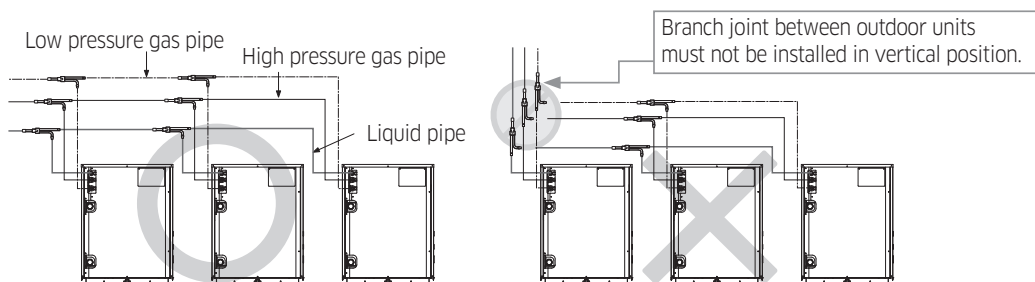

- * For HR System, connect liquid pipe, high pressure gas pipe and low pressure gas pipe.
- * For H/P System, connect liquid pipe and high pressure gas pipe.


10. Installation

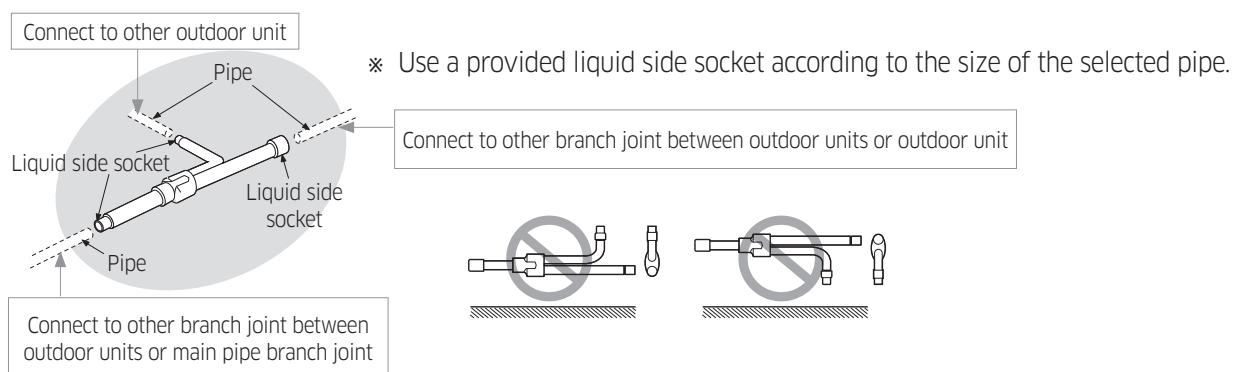

<Liquid pipe, High pressure gas pipe, Low pressure gas pipe>



- Cut the connection part of the outdoor unit connection pipe or the provided socket, according to the diameter of the connection pipe, before connecting them.

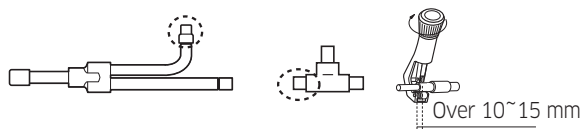










Installing the MCU

MCU specification

Model	MCU-S6NEK2N	MCU-S4NEK3N	MCU-S2NEK2N	MCU-S1NEK1N
Exterior of MCU				
Number of connectable indoor units at one port	Up to 8 units	Up to 8 units	Up to 8 units	Up to 8 units
The maximum capacity of the connectable indoor units at one port	16 kW	16 kW	16 kW	16 kW
The maximum capacity of the connectable indoor units	61.6 kW	61.6 kW	32.0 kW	16 kW
Internal EEV	Not included			


10. Installation

Installing the indoor units

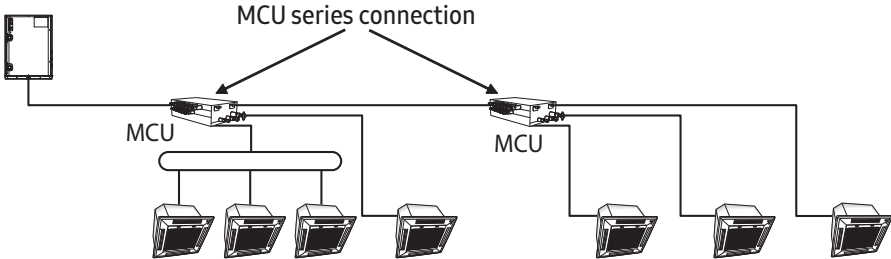Model	MCU-S6NEK2N	MCU-S4NEK3N	MCU-S2NEK2N	MCU-S1NEK1N
Example installing (Each port connection)				
Example installing (MCU series connection)				
Installing indoor units	Under 16.0 kW indoor unit : Don't use Y-connector 16.0 kW ~ 28.0 kW indoor unit : Use Y-connector at the Gas & Liquid line In case of using Y-connector, it is only connectable for port combination at below Connectable port combination for Y-connector : A + B port, C + D port, E + F port Non-connectable port combination for Y-connector : B + C port, D + E port, non-continuous port Set Dip Switch option for using Y-connector S/W Option  Default S/W Option  Combination of A+B port S/W Option  Combination of C+D port S/W Option  Combination of E+F port In case of MCU connection in series, the maximum capacity of indoor units in MCU series connection is 61.6 kW			This unit is only connectable for one port under 16 Kw This unit is impossible to connect MCU to MCU in series.

10. Installation

How to connect the pipes

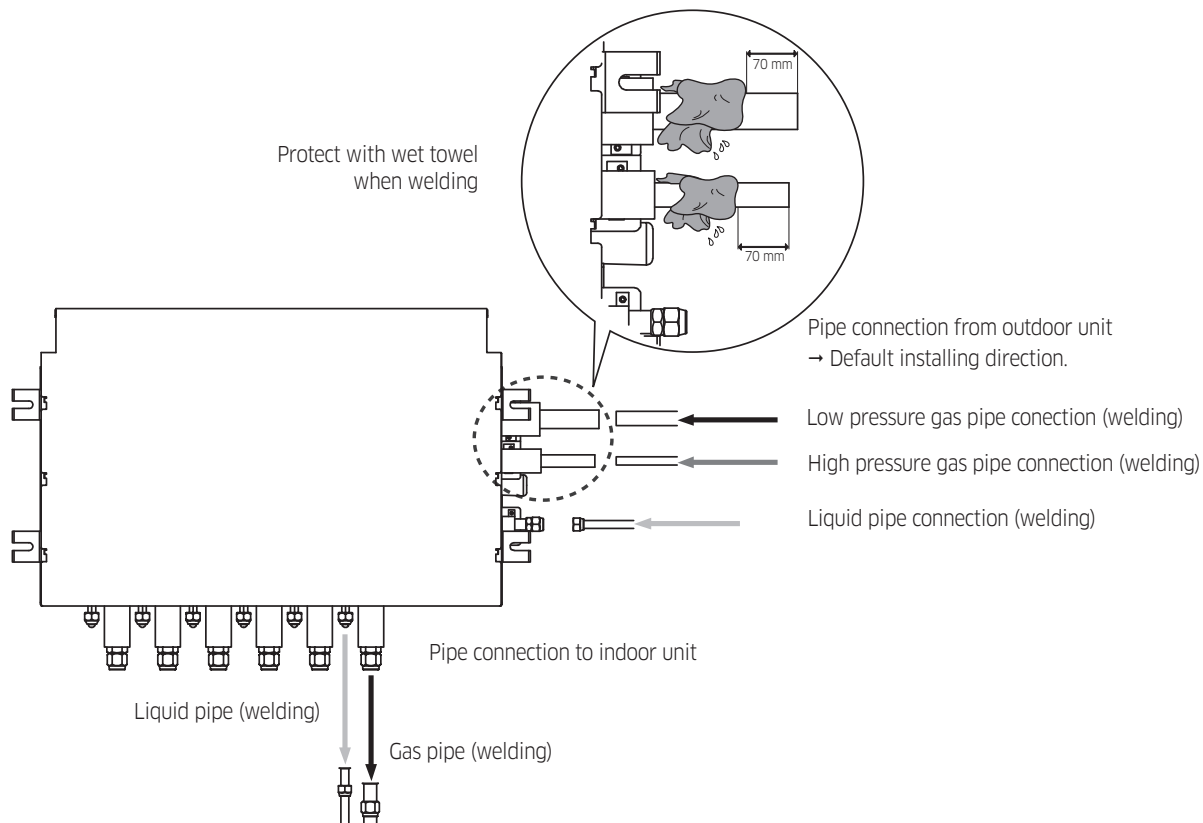


- ※ When installing MCU, use the pattern sheet for installation that is provided with the product.
- ※ When welding the gas pipes, protect the product with the flame-proof sheet.
- ※ When connecting the MCU with outdoor units, default direction is set in the MCU.
If installing opposite direction, weld the enclosed copper cap in each high pressure, low pressure and liquid pipes.

10. Installation

Water pipe installation

It is recommended to use closed circuit cooling tower. If open cooling tower is applied, use intermediate heat exchanger and make sure that supplied heat source water system is closed circuit.

Water pipe installation

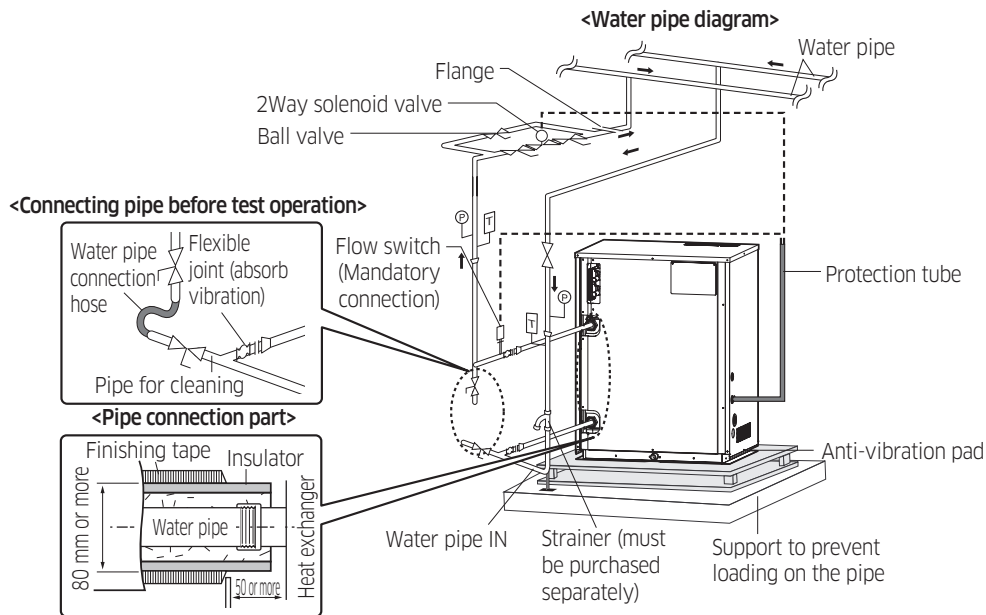

- ※ From above illustration, flow switch (mandatory) and 2way solenoid valve (optional) must be at least equivalent to the specification recommended by our company and they should be installed horizontally.



When water pipe circuit freezes, it will cause damage to the plate type heat exchanger and therefore preventive measure must be taken according to the situation.

- Drain remaining water in the water pipe when it will not be used for long period of time
- Constantly operate the water pump to circulate the water within the water pipe
- Install self-regulating heat cable on the water pipes

- ※ Design condition

Type	Circulating water	Operation	Inlet water temperature		Remarks
			Main usage range	Usage range limit ^{Note 3)}	
Heat source water	Water loop	Cooling	20 ~ 35 °C	10 ~ 45 °C	Refer to 'Cooling water management' on page 96
		Heating			
Ground heat source ^{Note 1)}	Ground loop	Cooling	15 ~ 35 °C	10 ~ 45 °C	
		Heating	5 ~ 25 °C	-5 ~ 45 °C (-10 ~ 45 °C) ^{Note 2)}	

Note 1): Anti-freeze must be used when temperature of water inlet for heating is below 10°C or ground heat source is used.

Maintain appropriate concentration level of anti-freeze according to temperature of water inlet.

Note 2): Strict management of anti-freeze concentration level is required. Consult Samsung before application.

Note 3): When inlet water temperature is outside of limit, consult Samsung before application.


10. Installation

1. Diameter of the outdoor unit connection part where water pipe will be connected is 32A. If you install outdoor units with different capacities, install a flow control valve to secure rated flow for each outdoor unit. Socket must be connected within below tightening torque. If the tightening torque exceeds below value, it may cause product breakage.

Outer diameter of water pipe (mm)	Tightening torque (N·m)
10 ~ 20	25
21 ~ 30	50
31 ~ 50	100
51 ~ 80	220
81 ~ 115	600

2. Use certified parts for water pipe system and the water pressure of the water pipe system connected to outdoor unit must remain under 1.96 MPa.
3. Outdoor unit water pipes must be equipped with valves and other instrumentations as shown in the figure on the previous page. Strainer and flow switch must be installed within 1~2 m from the entrance pipe of the outdoor unit. (Strainer must be installed on entrance side)
 - When strainer is not installed, sand, dust or rust debris may cause product breakage.
 - Make sure to install a flow switch that works at minimum discharge. When optimal discharge level is not reached, heat exchanger within the outdoor unit may break.
4. Water inlet pipe is located at the bottom part of the heat exchanger and the water outlet pipe is at the top part of the heat exchanger.
5. Outdoor unit must be installed indoor at room temperature and the water inlet and outlet of the outdoor unit must be insulated with the heat exchanger as shown in the illustration.
6. Damp-proof, cold reserving and insulation work must be done thoroughly to prevent condensation from forming on the surface of the product and drain pipes of indoor/outdoor units. When the necessary work is not done thoroughly, you will waste energy caused by thermal loss and may get property damage during cold seasons when water pipe freezes and bursts.
7. If you stop the product for long time or in night time, water pipe circuit may freeze naturally when the temperature around the outdoor unit is under 0°C. When water pipe circuit freezes, it will cause damage to the plate type heat exchanger and therefore preventive measure must be taken according to the situation.
 - Drain remaining water in the water pipe
 - Operate continuous water circulation pump during outdoor unit operation, 1~5 minutes before the operation and 1~5 minutes after operation stops
 - Install self-regulating heat cable on the water pipes
8. When inlet water temperature is lower than 10°C, appropriate anti-freeze must be used according to the temperature. (Set the outdoor unit option switches K21 and K22 according to the usage temperature.)
 - When lowest inlet water temperature is -5°C, freezing point of anti-freeze must be lower than -8°C
 - When lowest inlet water temperature is -10°C, freezing point of anti-freeze must be lower than -15°C
9. Install number of auto air vent valve at a point where air may remain within the pipe (such as vertical water pipe). If the air within the pipe is not vented, it may cause performance decrease or corrosion on the product or pipes.
10. Keep the inlet water temperature within 'Main usage range'. If not, product may not work continuously.
11. Water scale may occur on the plate type heat exchanger depending on the water quality and the type of plate heat exchanger so regular chemical cleaning is necessary. When installing water pipes, install a heat source water shut-off valve and also install the flushing pipe with a ball valves (for chemical cleaning) on the pipe installed between the shut-off valve and the outdoor unit.

10. Installation

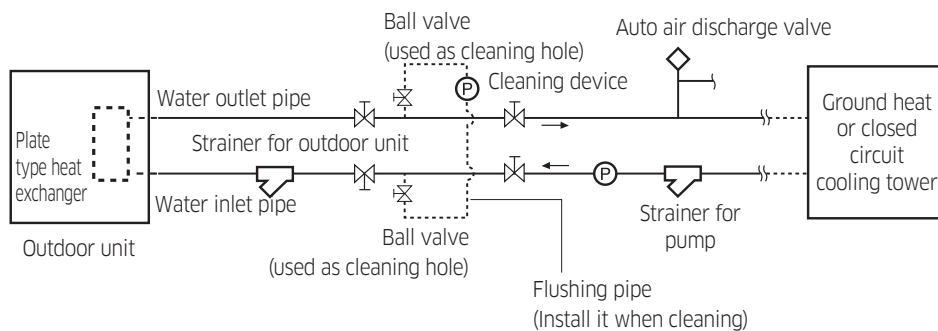


12. Before trial operation, connect the cleaning pipes installed on inlet and outlet as shown in above illustration. Then, take appropriate measures (such as blind flange etc) to stop the circulation water from entering the outdoor unit plate type heat exchanger, and use circulating pump to remove foreign substance within the water pipes and clean the strainer. When foreign substances accumulates on outdoor unit plate type heat exchanger, it may break the heat exchanger or cause problem to it.
13. For legal facilities, install digital sensor and flow meter on the water pipe for monitoring.









- Open the valve of the water pipe connected to the outdoor unit after flushing (cleaning foreign substances in water pipe) is completed.
- Check that air is vented from the water pipe and circulation amount is secured before opening the service valve on the refrigerant side of the outdoor unit.
- When circulating water stops during outdoor unit operation, it may cause breakage on plate type heat exchanger. Check the flow of circulation with flow switch or other devices.

11. Accessory



Controller

Classification	Product	Model	Image	Remark	Using
Individual Control System	Wireless Remote Controller	MR-EH00			DVM, CAC
	Wireless Remote Controller	AR-KH00E		360 CST Only	DVM, CAC
	Wired Remote Controller	MWR-WE11N			DVM, CAC
	Wired Remote Controller - Simple Type	MWR-SH00N			DVM, CAC
	Wired Remote Controller - Touch Simple Type	MWR-SH10N			DVM, CAC
	ERV Wired Remote Controller	MWR-VH12N		ERV Only	DVM, CAC
	Wired Remote Controller	MWR-WW00N		EHS Only	EHS
	Receiver KIT	MRK-A10N			DVM, CAC
	Zone Controller	MWR-ZS00N		Master controller + Damper controller	DVM, CAC
	Zone Controller	MWR-ZS10N		Slave controller	DVM, CAC
	Zone Controller	MRW-TS		External room sensor	DVM, CAC

11. Accessory

Classification	Product	Model	Image	Remark	Using
Centralized Control System	Onoff Controller	MCM-A202DN			DVM, CAC
	Touch Centralized Controller	MCM-A300N			DVM, CAC
	WIFI KIT	MIM-H03N			DVM, CAC
	Interface Module	MIM-N01			DVM, CAC
	ERV Interface Module	MIM-N10			DVM, CAC
Integrated management System	DMS2.5	MIM-D01AN			DVM, CAC
	S-NET3	MST-P3P			DVM, CAC
Gate Way	BACnet Gateway	MIM-B17BN			DVM, CAC
	Lonworks Gateway	MIM-B18BN			DVM, CAC
	External Contact Interface Module	MIM-B14			DVM, CAC
	MTFC (Multi Tenant Function Controller)	MCM-C210N			DVM
	SIM (Signal Interface Module)	MIM-B12N			DVM, CAC
	PIM (Pulse Interface Module)	MIM-B16N			DVM, CAC

11. Accessory

Classification	Product	Model	Image	Remark	Using
Installation /Test run Solution	S-Converter	MIM-C02N			DVM, CAC
Others	External Room Sensor	MRW-TA			DVM, CAC
	Operation Mode Selection Switch	MCM-C200			DVM
	Module Controller	MCM-A00N		CHILLER Only	CHILLER
	FCU Interface Module	MIM-F10N		CHILLER Only	CHILLER

NOTE

- In case you want more information about the accessories, please refer to the control and accessories TDB on pvi.Samsung.com site.


11. Accessory

	Item	NASA (DVM S)	Non-NASA (DVM +3/+4)	Remark
Individual Control System	Wireless Remote Controller	MR-EH00	MR-EH00	DVM, CAC
	Wireless Remote Controller	AR-KH00E	AR-KH00E	DVM, CAC (360 CST)
	Wired Remote Controller	MWR-WE11N	MWR-WE10	DVM, CAC
	Wired Remote Controller - Simple Type	MWR-SH00N	MWR-SH00	DVM, CAC
	Wired Remote Controller - Touch Simple Type	MWR-SH10N	-	DVM, CAC
	ERV Wired Remote Controller	MWR-VH12N	-	DVM, CAC (ERV)
	Wired Remote Controller	MWR-WW00N	MWR-WW00	EHS
	Receiver KIT	MRK-A10N	-	DVM, CAC
	Zone Controller	MWR-ZS00N	MWR-ZS00	DVM, CAC
	Zone Controller	MWR-ZS10N	MWR-ZS10	DVM, CAC
	Zone Controller	MRW-TS	MRW-TS	DVM, CAC
Centralized Control System	Onoff Controller	MCM-A202DN	MCM-A202D	DVM, CAC
	Touch Centralized Controller	MCM-A300N	-	DVM, CAC
	WIFI KIT	MIM-H03N	MIM-H03	DVM, CAC
	Interface Module	MIM-N01	MIM-N01	DVM, CAC
	ERV Interface Module	MIM-N10	MIM-N10	DVM, CAC
Integrated management System	DMS2.5	MIM-DO1AN	MIM-DO0A	DVM, CAC
	S-NET3	MST-P3P	MST-P3P	DVM, CAC
Gate Way	BACnet Gateway	MIM-B17BN	MIM-B17	DVM, CAC
	Lonworks Gateway	MIM-B18BN	MIM-B18	DVM, CAC
	External Contact Interface Module	MIM-B14	MIM-B14	DVM, CAC
	MTFC (Multi Tenant Function Controller)	MCM-C210N	-	
	SIM (Signal Interface Module)	MIM-B12N	MIM-B12	DVM, CAC
	PIM (Pulse Interface Module)	MIM-B16N	MIM-B16	DVM, CAC
	Module Controller	MCM-A00N	-	CHILLER ONLY
	FCU KIT	MIM-F00N	-	CHILLER ONLY
	FCU Interface Module	MIM-F10N	-	CHILLER ONLY
Installation / Test run Solution	S-Converter	MIM-C02N	MIM-C02	DVM, CAC
Others	External Room Sensor	MRW-TA	MRW-TA	DVM, CAC
	Operation Mode Selection Switch	MCM-C200	MCM-C200	DVM

NOTE

- In case you want more information about the accessories, please refer to the control and accessories TDB on pvi.Samsung.com site.

11. Accessory

Product	Image	Model	Remark
Y-Joint		MXJ-YA1509M	15.0 kW and below
		MXJ-YA2512M	Over 15.0 kW ~ 40.0 kW and below
		MXJ-YA2812M	Over 40.0 kW ~ 45.0 kW and below
		MXJ-YA2815M	Over 45.0 kW ~ 70.3 kW and below
		MXJ-YA3419M	Over 70.3 kW ~ 98.4 kW and below
		MXJ-YA4119M	Over 98.4 kW ~ 135.2 kW and below
		MXJ-YA4422M	Over 135.2 kW
Y-Joint (Only H/R)		MXJ-YA1500M	22.4 kW and below
		MXJ-YA2500M	Over 22.4 kW ~ 70.3 kW and below
		MXJ-YA3100M	Over 70.3 kW ~ 135.2 kW and below
		MXJ-YA3800M	Over 135.2 kW
Y-Joint Outdoor Unit		MXJ-TA3419M	135.2 kW and below
		MXJ-TA4122M	140.2 kW and Over
Y-Joint (Only H/R) Outdoor Unit		MXJ-TA3100M	135.2 kW and below
		MXJ-TA3800M	140.2 kW and Over
Distribution Header		MXJ-HA2512M	45.0 kW and below (for 4 rooms)
		MXJ-HA3115M	70.3 kW and below (for 8 rooms)
		MXJ-HA3819M	Over 70.3 kW ~ 135.2 kW and below (for 8 rooms)
MCU		MCU-S6NEK2N	6 ports, max 61.6kW (~16kW/1port)
		MCU-S4NEK3N	4 ports, max 61.6kW (~16kW/1port)
		MCU-S2NEK2N	2 ports, max 32.0kW (~16kW/1port)
		MCU-S1NEK1N	1 port, max 16.0kW (~16kW/1port)
EEV KIT		MEV-E24SA	1 Indoor
		MEV-E32SA	
		MXD-E24K132A	2 Indoor
		MXD-E24K200A	
		MXD-E32K200A	
		MXD-E24K232A	3 Indoor
		MXD-E24K300A	
		MXD-E32K224A	
		MXD-E32K300A	
PDM KIT		MXD-A38K2A	8~12 HP
		MXD-A12K2A	14~16 HP
		MXD-A58K2A	18~26 HP



NOTE

- In case you want more information about the accessories, please refer to the control and accessories TDB on pvi.Samsung.com site.

11. Accessory

Product	Image	Model	Remark
Panel		PC1NUSMAN	1Way CST (JSF-1)
		PC1NUPMAN	1Way CST (JSF-1) (Z-sliding)
		PC1MWSKAN	1Way CST (JSF-0)
		PC1NWSMAN	1Way CST (JSF-1)
		PC1BWSMAN	1Way CST (JSF-2)
		PC2NUSMEN	2Way Cassette
		PC4SUSMAN	4Way Cassette S (600x600) (Waffle)
		PC4SUSMEN	4Way Cassette S (600x600) (Classic)
		PC4NUSKAN	4way Cassette S (Waffle)
		PC4NUSKEN	4way Cassette S (Classic)
		PC4NBSKAN	4way Cassette S (Waffle, Black)
		PC4NUDMAN	360 CST Square (White)
		PC4NUNMAN	360 CST Circular (White)
		PC4NBDMAN	360 CST Square (Black)
		PC4NBNMAN	360 CST Circular (Black)
S-Plasma Ion KIT		MSD-CAN1	[Option] 1Way, 4Way, 4Way (600x600), 360, Big Ceiling [Include] Console
		MSD-EAN1	[Option] Duct S, Big Duct, ERV, ERV Plus
Motion detect Sensor		MCR-SMA	4Way Cassette S (600x600)

11. Accessory

Product	Image	Model	Remark			
ERV CO2 Sensor		MOS-C1	ERV, ERV PLUS			
External room sensor		MRW-TA	Cassette, Wall-mount, Ceiling, Duct, Console			
Drain Pump		MDP-N047SNC0D	OAP Duct (14.0 kW)			
		MDP-N047SNC1D	HSP Duct (22.0 / 28.0 kW) OAP Duct (22.4 / 28.0 kW)			
		MDP-M075SGU1D	MSP-0 / 1 Duct (9.2 / 11.2 kW)			
		MDP-M075SGU2D	MSP-2 Duct (12.8 / 14.0 kW) HSP Duct (11.2 / 12.8 / 14.0 kW)			
		MDP-M075SGU3D	MSP-S Duct (5.6 / 7.1 kW)			
		MDP-E075SEE3D	Slim Duct (2.0~14.0 kW)			
		MDP-G075SP	Duct S (External, All Capacities) BIG Duct			
		MDP-G075SQ	Duct S (Internal, 3.5 kW~14 kW) BIG Duct			
AHU KIT		MXD-K025AN	7.0 kW~8.75 kW			
		MXD-K050AN	14.0 kW~17.5 kW			
		MXD-K075AN	21.0 kW~26.25 kW			
		MXD-K100AN	28.0 kW~35.0 kW			
	 MXD-A64K100E	MCM-D201N	28kW~35kW MDX-A64K100E X 1 EA	56kW~70kW MDX-A64K100E X 2 EA	84kW~105kW MDX-A64K100E X 3 EA	112kW~140kW MDX-A64K100E X 4 EA
Transformer kit		MVR-TK024	Transformer for variable flow control Valve Input/Output : AC 220V/AC 24V, 10VA			

NOTE

- In case you want more information about the accessories, please refer to the control and accessories TDB on pvi.Samsung.com site.

11. Accessory

Product	Model	Remark	1way			2way	4way	360	Mini 4way	Slim duct	MSP Duct				Duct-S	Big Duct	HSP Duct	OAP Duct		RAC	Ceiling	B-Ceiling	Console	PAC	Floor Standing	ERV Plus	AHU
			JSF-0	JSF-1	JSF-2						MSP-S	MSP-0	MSP-1	MSP-2				5HP	8,10HP								
Panel	PC4NUDMAN	Ceiling						O																			
	PC4NBDMAN	Ceiling (Black)						O																			
	PC4NUNMAN	Open						O																			
	PC4NBNMAN	Open (Black)						O																			
	PC4NUSKAN	Waffle					O																				
	PC4NBSKAN	Waffle (Black)					O																				
	PC4NUSKEN	Classic					O																				
	PC4SUSMAN	Waffle						O																			
	PC4SUSMEN	Classic						O																			
	PC1NUSMAN	Stripe		O																							
	PC1NUPMAN	Z-Slide		O																							
	PC1MWSKAN	Fluid	O																								
	PC1NWSMAN			O																							
	PC1BWSMAN				O																						
	PC2NUSMEN	Stripe				O																					
DRAIN PUMP	MDP-N047SNC0D	-																O									
	MDP-N047SNC1D	-															O	O									
	MDP-M075SGU1D	-										O	O														
	MDP-M075SGU2D	-											O														
	MDP-M075SGU3D	-								O																	
	MDP-E075SEE3D	-							O																		
	MDP-G075SP	External, All Capacities													O	O											
	MDP-G075SQ	Internal													O	O											
S-Plasma Ion KIT	MSD-CAN1	-					O		O																		
	MSD-EAN1	-																							O		
Motion detect Sensor	MCR-SMA	-							O																		
ERV CO2 Sensor	MOS-C1	-																							O		
EEV KITS	MEV-E**SA	1 Indoor																	O								
	MXD-E**K***A	2,3 Indoor																	O								
MCU-KIT	MCU-S6NEK2N	6 ports, max 61.6kW	O	O	O	O	O	O	O	O	O	O	O	O	O	O	O			O	O	O	O	O	O	O	O
	MCU-S4NEK3N	4 ports, max 61.6kW	O	O	O	O	O	O	O	O	O	O	O	O	O	O	O			O	O	O	O	O	O	O	
	MCU-S2NEK2N	2 ports, max 32.0kW	O	O	O	O	O	O	O	O	O	O	O	O	O	O	O			O	O	O	O	O	O	O	
	MCU-S1NEK1N	1 port, max 16.0kW	O	O	O	O	O	O	O	O	O	O	O	O	O	O	O			O	O	O	O	O	O	O	
AHU-KIT	MXD-K025AN	only for 2.5Hp's AHU																								O	
	MXD-K050AN	only for 5Hp's AHU																								O	
	MXD-K075AN	only for 7.5Hp's AHU																								O	
	MXD-K100AN	only for 10Hp's AHU																								O	
	MCM-D201N	only for 10~40Hp's AHU																								O	

NOTE

- In case you want to know more information the accessories, please refer to the control and accessories TDB on pvi.samsung.com site



2016. 12
Ver. 3.0

Samsung Electronics Co., LTD.
B2B PM / SE

Head Office (Suwon Korea) 129, Samsung-Ro, Yeongtong-Gu, Suwon City, Gyeonggi-Do, Korea 16677
Website : www.samsung.com, <http://btsp.samsungsbn.com> Email : airconditioner@samsung.com
Images and data in this book may subject to change without prior notice.